



## SUGGESTED SPECIFICATION

Furnish and install louvers as hereinafter specified where shown on plans or as described in schedules. Louvers shall be stationary double drainable with drain gutters in each blade and downspouts in jambs and mullions. Stationary drainable blades shall be contained within a 4" (102) frame. Louver components (heads, jambs, sills, blades & mullions) shall be factory assembled by the louver manufacturer. Louver sizes too large for shipping shall be built up by the contractor from factory assembled louver sections to provide overall sizes required. Louver design shall limit span between visible mullions to 10 ft. (3) and shall incorporate structural supports required to withstand a wind load of 20 lbs. per sq. ft. (.96kPa) (equivalent of a 90 mph wind [145 KPH] - specifier may substitute any loading required).

Louvers shall be Ruskin Model ELF811DD extruded 6063T5 aluminum alloy construction as follows:

Frame: .090" (2.3) wall thickness.

Blades: .081" (2.1) wall thickness at 45° angle on approximately 5<sup>3</sup>/<sub>32</sub>" (129) centers.

Screen: 3/4" x .051" (19 x 1.3) expanded, flattened aluminum bird screen in removable frame.

Finish: Select finish specification from Ruskin Finishes Brochure.

Published louver performance data bearing the AMCA Certified Ratings Seal for Air Performance & Water Penetration must be submitted for approval prior to fabrication and must demonstrate pressure drop and water penetration equal to or less than the Ruskin model specified.

## PERFORMANCE DATA


AMCA Standard 500 provides a reasonable basis for testing and rating louvers. Testing to AMCA 500 is performed under a certain set of laboratory conditions. This does not guarantee that other conditions will not occur in the actual environment where louvers must operate.

The louver system should be designed with a reasonable safety factor for louver performance. To ensure protection from water carryover, design with a performance level somewhat below maximum desired pressure drop and .01 oz./sq. ft. of water penetration.

### WATER PENETRATION

Test size 48" wide x 48" high (1219 x 1219)

Beginning point of water penetration at .01 oz./sq. ft. is 974 fpm (297 m/min).

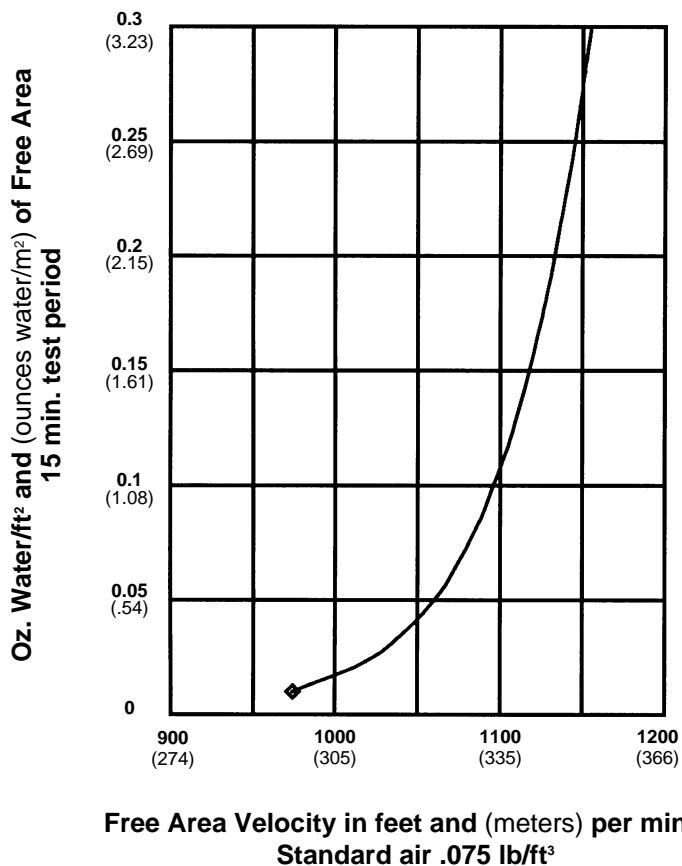


## FREE AREA GUIDE

Free Area Guide shows free area in ft<sup>2</sup> and m<sup>2</sup> for various sizes of 811DD.

Width – Inches and Meters

Height – Inches and Meters	12 0.30	18 0.46	24 0.61	30 0.76	36 0.91	42 1.07	48 1.22	54 1.37	60 1.52	66 1.68	72 1.83	78 1.98	84 2.13	90 2.29	96 2.44	102 2.59	108 2.74	114 2.90	120 3.05
12 0.30	0.17	0.27	0.38	0.48	0.59	0.69	0.80	0.90	1.01	1.11	1.21	1.32	1.42	1.53	1.63	1.74	1.84	1.94	2.05
18 0.46	0.41	0.66	0.91	1.16	1.41	1.65	1.90	2.15	2.40	2.65	2.90	3.15	3.40	3.65	3.90	4.15	4.40	4.65	4.90
24 0.61	0.65	1.06	1.46	1.86	2.27	2.67	3.07	3.47	3.88	4.28	4.68	5.08	5.49	5.89	6.29	6.70	7.10	7.50	7.90
30 0.76	0.90	1.46	2.01	2.57	3.13	3.68	4.24	4.79	5.35	5.90	6.46	7.01	7.57	8.13	8.68	9.24	9.79	10.35	10.90
36 0.91	1.15	1.86	2.57	3.28	3.99	4.69	5.40	6.11	6.82	7.53	8.24	8.95	9.65	10.36	11.07	11.78	12.49	13.20	13.91
42 1.07	1.26	2.04	2.82	3.60	4.38	5.16	5.93	6.71	7.49	8.27	9.05	9.82	10.60	11.38	12.16	12.94	13.72	14.49	15.27
48 1.22	1.50	2.42	3.34	4.26	5.18	6.10	7.02	7.95	8.87	9.79	10.71	11.63	12.55	13.47	14.39	15.31	16.24	17.16	18.08
54 1.37	1.74	2.81	3.88	4.95	6.02	7.09	8.16	9.23	10.30	11.37	12.44	13.51	14.58	15.65	16.72	17.79	18.86	19.93	21.00
60 1.52	1.99	3.21	4.43	5.66	6.88	8.10	9.33	10.55	11.77	13.00	14.22	15.44	16.67	17.89	19.11	20.33	21.56	22.78	24.00
66 1.68	2.24	3.61	4.99	6.36	7.74	9.12	10.49	11.87	13.24	14.62	16.00	17.37	18.75	20.12	21.50	22.88	24.25	25.63	27.00
72 1.83	2.48	4.01	5.54	7.07	8.60	10.13	11.66	13.19	14.72	16.25	17.77	19.30	20.83	22.36	23.89	25.42	26.95	28.48	30.01
78 1.98	2.59	4.19	5.78	7.38	8.97	10.57	12.16	13.76	15.35	16.95	18.54	20.14	21.73	23.33	24.92	26.52	28.11	29.71	31.30
84 2.13	2.82	4.56	6.30	8.04	9.77	11.51	13.25	14.99	16.73	18.46	20.20	21.94	23.68	25.41	27.15	28.89	30.63	32.36	34.10
90 2.29	3.07	4.96	6.85	8.74	10.63	12.53	14.42	16.31	18.20	20.09	21.98	23.87	25.76	27.65	29.54	31.43	33.32	35.21	37.10

## PRESSURE DROP

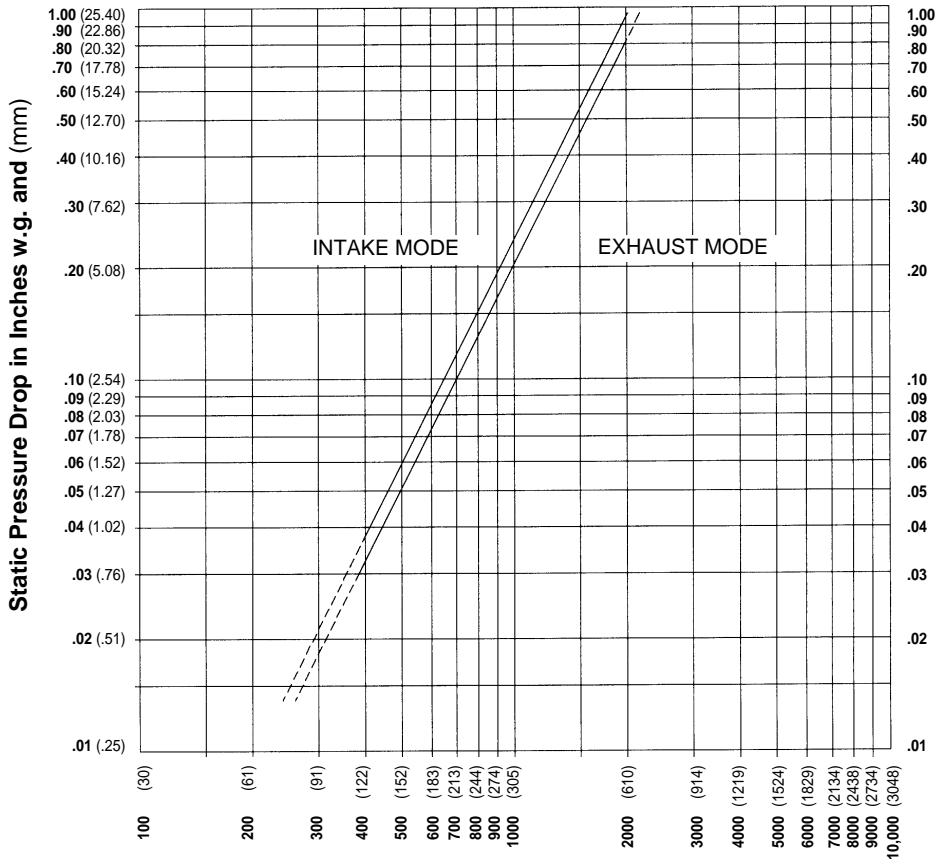

Ratings do not include the effect of a bird screen.




Ruskin Manufacturing Company certifies that the ELF811DD Louvers shown herein are licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Ratings Seal applies to air performance ratings and water penetration ratings only.


Air Velocity in feet and (meters) per minute through Free Area

## TYPICAL INSTALLATION DETAILS


**Masonry  
Wall**

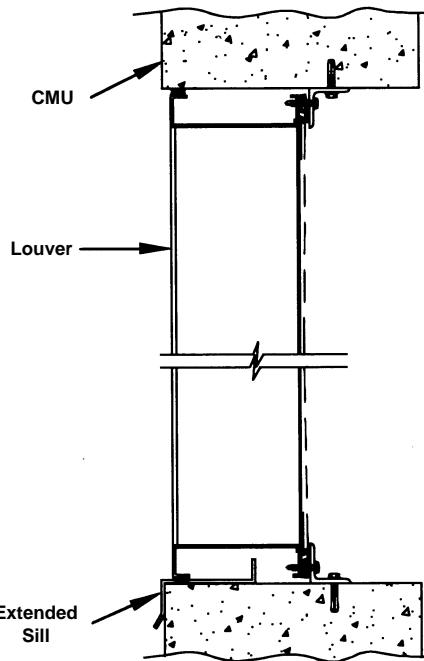


**Metal Panel  
Wall**

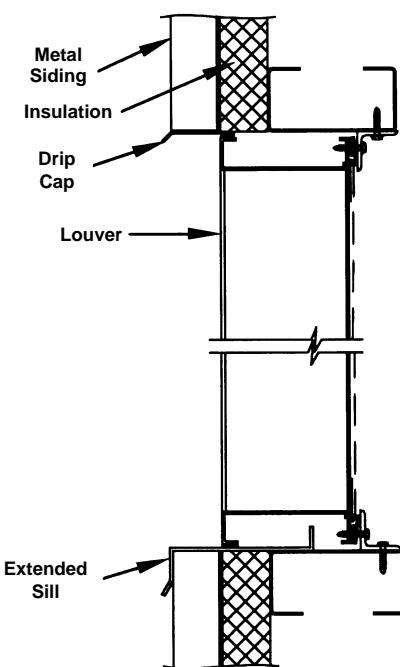

**Wood  
Installation**

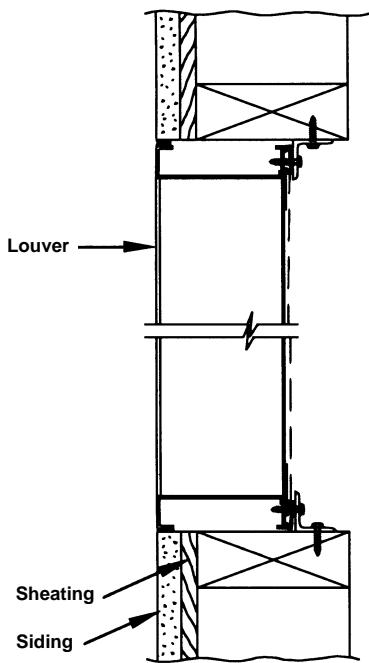

**Flange  
Mount**

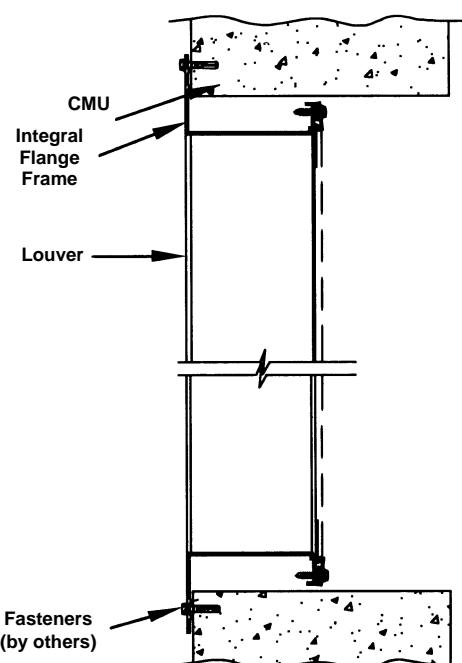

Accessories at additional cost.

**RUSKIN®**

3900 Dr. Greaves Rd.  
Kansas City, MO 64030  
(816) 761-7476  
FAX (816) 765-8955