



Application

Model DFDAF-330 is a multi-blade fire damper with airfoil style blades for use in walls, floors, and partitions with fire resistance rating of 3 hours or more. The DFDAF-330 is qualified to 4,000 fpm (20.3 m/s) and 8 in. wg (2 kPa) for dynamic closure in emergency fire situations. Model DFDAF-330 may be installed vertically or horizontally (with blades running horizontal) and is rated for airflow in either directions.

Ratings

UL 555 Fire Resistance Rating

Fire Rating: 3 Hour

Dynamic Closure Rating: Actual ratings are size dependent

Velocity: Up to 4,000 fpm (20.3 m/s) on sizes up to 32 in. x 36 in. (813mm x 914mm); 2,000 fpm (10.2 m/s) on sizes greater than 32 in. x 36 in. (813mm x 914mm)

Pressure: Up to 8 in. wg (2 kPa)

| Construction | Standard | Optional |
|--------------------------|--------------------------------------------------|---------------------------------------------|
| Frame Material | Galvanized steel | - |
| Frame Material Thickness | 16 ga. (1.5mm) | - |
| Frame Type | 5 in. x 1 in. (127mm x 25mm) hat channel | - |
| Blade Material | Galvanized steel | - |
| Blade Material Thickness | 14 ga. (2mm) equivalent | - |
| Blade Type | Double skin airfoil | - |
| Linkage | Plated steel out of airstream, concealed in jamb | - |
| Axle Bearings | 316SS | - |
| Axle Material | Plated steel | - |
| Jamb Seals | Stainless Steel | - |
| Closure Device | Fusible link | - |
| Closure Temperature | 165°F (74°C) | 212°F (100°C), 286°F (141°C), 350°F (177°C) |
| Actuator | Manual quadrant | - |

Features

- Frames are constructed with reinforced corners. Low profile head and sill are used on sizes less than 17 in. (432mm) high.
- Blades are double skin airfoil shape of galvanized steel with full length structural reinforcement.

Model DFDAF-330 Multi-blade FIRE DAMPER

Steel Airfoil Blades
UL555 3 Hour Fire Resistance Rating



*W & H dimensions furnished approximately ¼ in. (6 mm) undersize in case of nominal sizing only.
(Add sleeve thickness for overall sleeved damper dimension)

Model DFDAF-330 meets the requirements for fire dampers established by:

National Fire Protection Association
NFPA Standards 80, 90A & 101
IBC International Building Codes



See complete marking on product.

UL 555 Classification
R13317

| W x H | Minimum Size | Maximum Size | | |
|--------|--------------|---------------------------------------|----------------------------------|---------------------|
| | | Single Section | Multi-Section | |
| | | | 2000 fpm (10.2 m/s) | 4000 fpm (20.3 m/s) |
| Inches | 8 x 6 | 32 x 36 (V) or 30 x 48 (H or V) | 120 x 96 (V) | 30 x 48 (V) |
| mm | 203 x 152 | 813 x 914 or 762 x 1219 | 3048 x 2438 or 3658 x 2438 | 762 x 1219 |

Installation instructions available at www.greenheck.in

Options available for DFDAF-330:

- Factory mounted accessories
 - Retaining angles
 - Quick connect breakaway connections
 - Slip & Drive connections
 - TDF Flange
- OCI (Open Closed Indication switches): Units will be supplied with one OCI per row per separately controlled section
- POC retaining angles
- Sleeves
- Transitions (R)

Pressure Drop Data

This pressure drop testing was conducted in accordance with AMCA Standard 500-D using the three configurations shown. All data has been corrected to represent standard air at a density of .075 lb/ft³(1.201 kg/m³).

Actual pressure drop found in any HVAC system is a combination of many factors. This pressure drop information along with an analysis of other system influences should be used to estimate actual pressure losses for a damper installed in a given HVAC system.

AMCA Test Figures

Figure 5.3 Illustrates a fully ducted damper. This configuration has the lowest pressure drop of the three test configurations because entrance and exit losses are minimized by straight duct runs upstream and downstream of the damper.

Figure 5.2 Illustrates a ducted damper exhausting air into an open area. This configuration has a lower pressure drop than Figure 5.5 because entrance losses are minimized by a straight duct run upstream of the damper.

Figure 5.5 Illustrates a plenum mounted damper. This configuration has the highest pressure drop because of extremely high entrance and exit losses due to the sudden changes of area in the system.

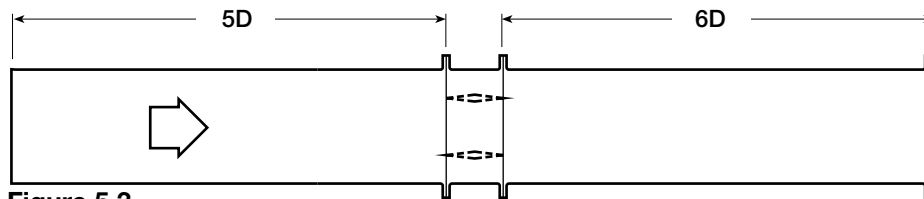


Figure 5.3

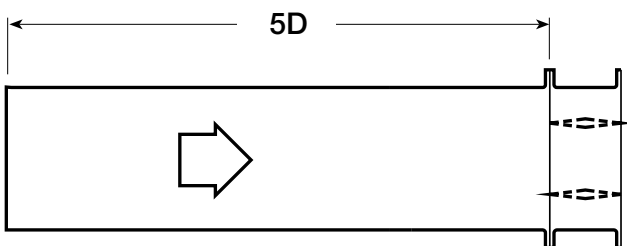


Figure 5.2

$$D = \sqrt{\frac{4(W)(H)}{3.14}}$$

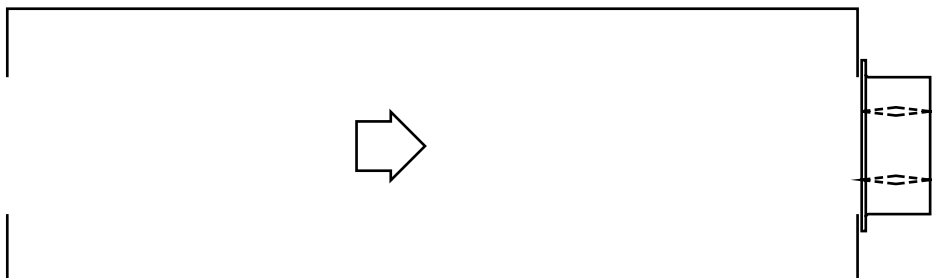


Figure 5.5

AMCA Figure 5.2

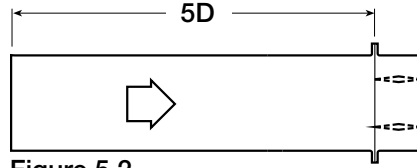


Figure 5.2

12 in. x 12 in. (305mm x 305mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.03 |
| 1000 | 0.12 |
| 1500 | 0.26 |
| 2000 | 0.46 |
| 2500 | 0.72 |
| 3000 | 1.04 |
| 3500 | 1.41 |
| 4000 | 1.84 |

24 in. x 24 in. (610mm x 610mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.01 |
| 1000 | 0.06 |
| 1500 | 0.12 |
| 2000 | 0.22 |
| 2500 | 0.34 |
| 3000 | 0.49 |
| 3500 | 0.67 |
| 4000 | 0.87 |

36 in. x 36 in. (914mm x 914mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.01 |
| 1000 | 0.06 |
| 1500 | 0.12 |
| 2000 | 0.22 |
| 2500 | 0.34 |
| 3000 | 0.49 |
| 3500 | 0.67 |
| 4000 | 0.88 |

12 in. X 48 in. (305mm x 1219mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.01 |
| 1000 | 0.05 |
| 1500 | 0.12 |
| 2000 | 0.21 |
| 2500 | 0.33 |
| 3000 | 0.48 |
| 3500 | 0.65 |
| 4000 | 0.85 |

48 in. x 12 in. (1219mm x 305mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.02 |
| 1000 | 0.08 |
| 1500 | 0.18 |
| 2000 | 0.33 |
| 2500 | 0.51 |
| 3000 | 0.74 |
| 3500 | 1.00 |
| 4000 | 1.31 |

AMCA Figure 5.3

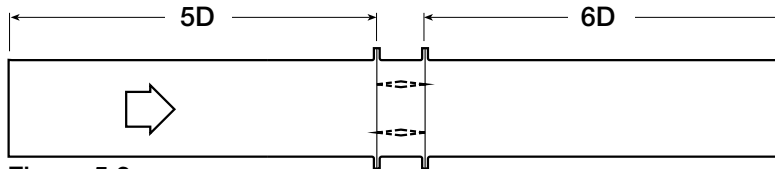


Figure 5.3

12 in. x 12 in. (305mm x 305mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.01 |
| 1000 | 0.06 |
| 1500 | 0.13 |
| 2000 | 0.23 |
| 2500 | 0.37 |
| 3000 | 0.53 |
| 3500 | 0.73 |
| 4000 | 0.95 |

24 in. x 24 in. (610mm x 610mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.01 |
| 1000 | 0.02 |
| 1500 | 0.06 |
| 2000 | 0.10 |
| 2500 | 0.16 |
| 3000 | 0.23 |
| 3500 | 0.32 |
| 4000 | 0.42 |

36 in. x 36 in. (914mm x 914mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.01 |
| 1000 | 0.02 |
| 1500 | 0.05 |
| 2000 | 0.09 |
| 2500 | 0.14 |
| 3000 | 0.21 |
| 3500 | 0.29 |
| 4000 | 0.38 |


12 in. X 48 in. (305mm x 1219mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.01 |
| 1000 | 0.02 |
| 1500 | 0.06 |
| 2000 | 0.10 |
| 2500 | 0.16 |
| 3000 | 0.24 |
| 3500 | 0.33 |
| 4000 | 0.43 |

48 in. x 12 in. (1219mm x 305mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.01 |
| 1000 | 0.04 |
| 1500 | 0.10 |
| 2000 | 0.18 |
| 2500 | 0.29 |
| 3000 | 0.42 |
| 3500 | 0.57 |
| 4000 | 0.74 |

AMCA Figure 5.5

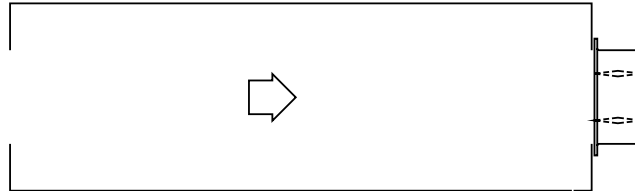

12 in. x 12 in. (305mm x 305mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.04 |
| 1000 | 0.18 |
| 1500 | 0.42 |
| 2000 | 0.75 |
| 2500 | 1.17 |
| 3000 | 1.68 |
| 3500 | 2.29 |
| 4000 | 2.99 |

24 in. x 24 in. (610mm x 610mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.03 |
| 1000 | 0.13 |
| 1500 | 0.29 |
| 2000 | 0.52 |
| 2500 | 0.81 |
| 3000 | 1.17 |
| 3500 | 1.60 |
| 4000 | 2.14 |

36 in. x 36 in. (914mm x 914mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.03 |
| 1000 | 0.12 |
| 1500 | 0.27 |
| 2000 | 0.48 |
| 2500 | 0.75 |
| 3000 | 1.08 |
| 3500 | 1.48 |
| 4000 | 1.93 |

12 in. X 48 in. (305mm x 1219mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.03 |
| 1000 | 0.12 |
| 1500 | 0.27 |
| 2000 | 0.49 |
| 2500 | 0.77 |
| 3000 | 1.11 |
| 3500 | 1.51 |
| 4000 | 1.97 |

48 in. x 12 in. (1219mm x 305mm)

| Velocity (fpm) | Pressure Drop (in. wg) |
|----------------|------------------------|
| 500 | 0.03 |
| 1000 | 0.14 |
| 1500 | 0.32 |
| 2000 | 0.57 |
| 2500 | 0.89 |
| 3000 | 1.28 |
| 3500 | 1.75 |
| 4000 | 2.29 |




Greenheck India Private Limited certifies that the model DFDAF-330 shown herein is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Programs. The AMCA Certified Ratings Seal applies to air performance ratings only.


Damper Sizing Information

Dampers larger than maximum single section size are supplied as a factory assembly of two or more sections of equal size. The following figures show maximum damper section size and assembly configurations for multi-section dampers. Larger damper sizes may ship in multiple sections.

Single Section

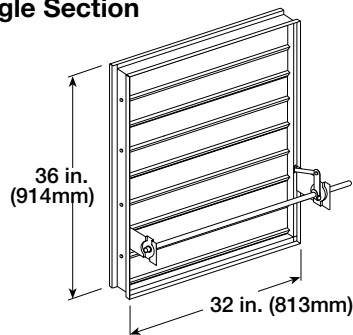


Multi-Section

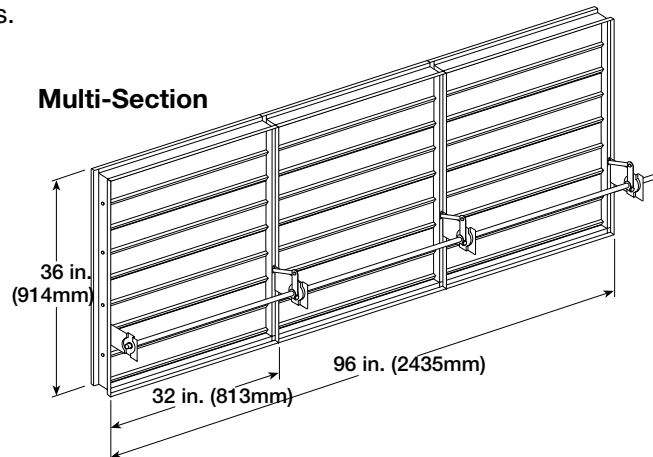


Damper Sleeve Dimensional Data

The drawings below and corresponding table show the position of the DFDAF-330 damper when mounted in a factory sleeve. The standard mounting locations provide enough space for the mounting of manual quadrant, controls and allow space for installation of retaining angles and duct connections.

The "A" dimension is the location of the damper mounted in a factory sleeve. The table below shows the Standard and Maximum "A" dimensions.

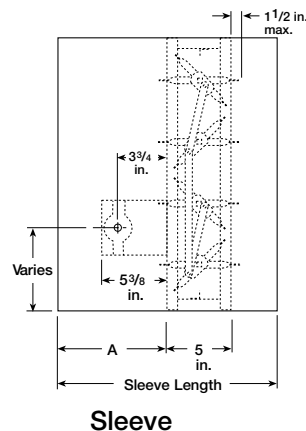

Sideplate

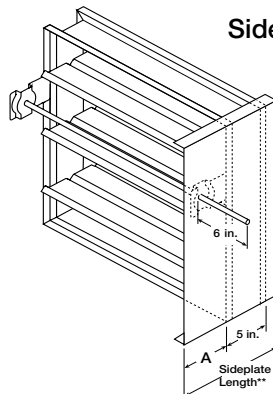

| in. (mm) | "A" Dimension | | |
|----------------------------------------------|------------------|------------|--------------|
| | Sleeve Std | Sleeve Max | Sideplate |
| All Dampers | 7 3/16 in. (183) | 16 (406) | 6 3/16 (157) |
| When Height is 11 in. (279) or less with OCI | 12 (305) | 16 (406) | 12 (305) |

NOTE: Entire damper frame is not required to be installed within the wall. The damper blades, when closed should be contained within the wall.

Specifications

Fire Dampers meeting the following specifications shall be furnished and installed where shown on plans and/or as described in schedules. Dampers shall meet the requirements of the latest edition of NFPA 80, 90A and 101.

Dampers shall be tested, rated and labeled in accordance with the latest edition of UL Standard 555. Dampers shall have a UL 555 fire rating of 3 hours. Each damper shall be equipped with a heat responsive device which has been tested and approved for use with the damper assembly in accordance with UL 555. The heat responsive device shall have a temperature rating of (specifier select one of the following) 165°F (74°C), 212°F (100°C), or 350°F (177°C).

Dampers shall be UL labeled for use in dynamic systems. The damper shall have a dynamic closure pressure rating of 4 in. wg (1 kPa) or 8 in. wg (2 kPa). UL 555 Dynamic Closure Ratings shall be qualified for airflow and pressure in either direction through the damper. UL ratings shall allow for mounting damper vertically (with blades running horizontal) or horizontally.

Damper actuator shall be manual quadrant. Manufacturer's submittal data shall indicate actuator space requirements around the damper.

Damper blades shall be 14 ga. (2mm) galvanized steel airfoil style. Blades shall be completely symmetrical relative to their axle pivot point, presenting identical resistance to airflow and operation in either direction through the damper (blades that are non-symmetrical relative to their axle pivot point or utilize blade stops larger than 1/2 in. (13mm) are unacceptable).

Damper frame shall be 16 ga. (1.5mm) galvanized steel formed into a structural hat channel shape with reinforced corners. Bearings shall be 316SS type rotating in extruded holes in the damper frame for maximum service. Axles shall be square and positively locked into the damper blade. Jamb seals shall be stainless steel compression type.

Testing and ratings to be in accordance with AMCA standard 500-D. Basis of design is Greenheck Model DFDAF-330.



Greenheck India: 201-202, 2nd Floor, Landmark Cyber Park, Sector 67, Gurgaon

Copyright © 2019 Greenheck Fan Corporation
DFDAF-330 Rev. 4 November 2019