



Vibrantech (Malaysia) Sdn. Bhd. certifies that the series AXV-F shown herein are licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 211 and AMCA Publication 311 and comply with the requirements of the AMCA Certified Ratings Program.

**Air in Motion.**  
Wolter Fans.

**A09-F**



# Table of Content




Content.....	1
Technical Information.....	2~4
Fan Type Code.....	2
Design Features.....	2
Types and Duty Range.....	2
Application.....	2
Casing.....	2
Impellers.....	2
Motor.....	2
Fan Performance Curves.....	2
Sound Levels.....	2
Belt Driven Design.....	2
Ordering Designations.....	2
Fan Selection and Installation.....	3
Forms of Running.....	3
Selection Example.....	4
Fan Efficiency Grade - 50Hz.....	5
Performance Curve - 50Hz.....	6~23
Fan Efficiency Grade - 60Hz.....	24
Performance Curve - 60Hz.....	25~42
Dimension.....	43~46
Sound Information.....	47~51

Subject to change without prior notice.

# Technical information

## Fan type code

AXV-F 1400 / 20°

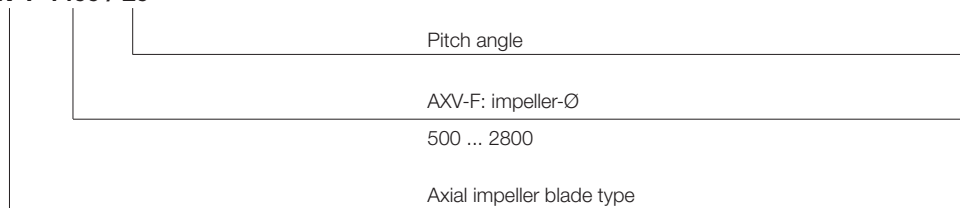

## Design features

### Types and duty range

**Wolter** axial mixflow high pressure fans can be used for various applications in ventilation and process air technology. Standard diameters range from 500 to 2,800 mm, with airflow rates of up to 260 m<sup>3</sup>/s at static pressure increases of up to 2,500 Pa. The high efficiencies and high pressures are achieved by the use of the aerodynamically designed guide vanes.

### Application

The AXV-F range of axial mixflow fans is designed, tested and certified to operate at standard temperatures as well as at elevated temperatures of maximum up to 600deg/C for 240 minutes inclusive of F600 (600deg/120mins), F400 (400deg/120mins) and F300 (300deg/60mins) according to EN 12101-3:2015. The following fan curves are valid for standard temperatures and 300°/60(120) minutes operation. To select a fan for 400°C/120 minutes and 600°C/240 minutes operation, please contact our technical support. For F600, fans come in bifurcated and belt driven configuration with motor out of air flow.

Well suited for industrial applications, ventilation, smoke exhaust, stair case pressurisation and for conveying clean and dusty air where medium to high pressures are required with high airflow volume and fan efficiency.

### Casing

Fan are made of steel, with flanges rolled on both sides. The pitch circles of holes are in accordance with DIN 24 154, R2. The fan casings are hot dipped galvanised as standard. Optional: Optimal corrosion protection by powder-coating.

If motors require additional lubrication, tubes and grease-nipples are fitted to the outside of the fan casing. An inspection hole, closed by a rubber plug, allows controlling the direction of rotation.

### Impellers

Hubs and impeller blades are made of highly corrosion resistant pressure-cast aluminium alloy. Optional: Hub and aerofoil profiled blades made of steel for F600. The aero dynamical profile of the impeller blades guarantees a high level of efficiency and low noise. The blade angle is adjustable during standstill. The variable number of blades expands the performance range. Dynamically balanced according to DIN ISO 1940-1, balancing quality G6.3.

## Motors

**Wolter** uses closed squirrel cage motors according to IEC 34, if required also in accordance with EPACT. Standard motors are class F with IP 55 protection class. Multi speed versions with 2 or 3 speeds (Dahlander circuit or separate windings) are also available, as well as explosion-proof versions or specific industrial executions such as marine-type fans. The motor bearings have a L 10 life. For high temperature applications, three phase motor according to EN 12101-3 in protection class IP55, insulation class H.

## Fan performance curves

The performance curves for size 500 to 1250 have been established in installation type - D (according to AMCA 210, ducted inlet and ducted outlet) while installation type A (free inlet and free outlet) is for size 1400 to 2800 and represent the total pressure increase  $\Delta p$ , as a function of the volume flow. The dynamic pressure  $p_{a2}$  refers to the outlet area of the fan.

## Sound levels

The ascertaining of sound level follows the Reverberant Room Method according to AMCA 300. The A-weighted inlet sound power levels  $L_{wIA}$  or outlet sound power levels  $L_{wOA}$  are shown on the performance curves.



## Belt driven design


Belt driven fan with single / dual motors can be mounted in various positions to suit the actual site condition. Belt driven fans are used for applications to extract more heavily polluted air i.e. presence of corrosive or hazardous fumes, or dirt-laden, moist air or hot air. Various mounting positions are illustrated.

## Ordering designations

When ordering, please provide the following information:

- ▶ Fan type
- ▶ Fan code and type
- ▶ Quantity required
- ▶ Duty required at standard air and temperature (air volume in m<sup>3</sup>/h at static pressure in Pa).
- ▶ Motor power rating in kW
- ▶ Electrical supply
- ▶ Ancillaries required

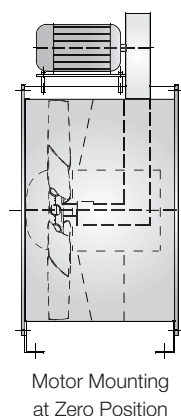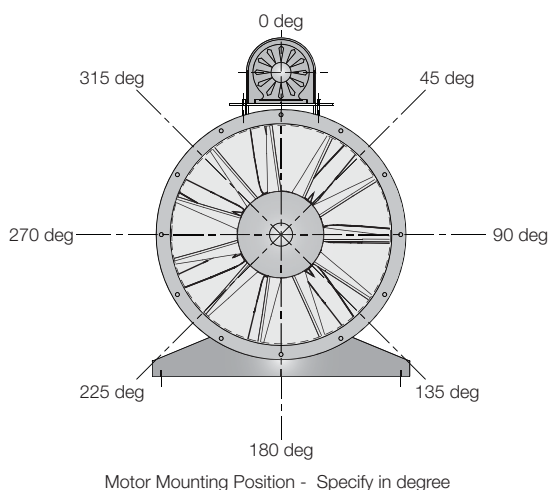



AXV-F

## Fan selection and installation

### Fan selection

Please select fans according to the nearest performance curve above the required duty point. The middle range of each fan curve is the area of highest efficiency. Do not select fans at the upper end of the fan curve, as this might cause the fan to work in stall. In order to avoid motor overloading, please select motors according to the peak power of the respective performance curve. Please refer to the selection example on the following page.

### Fan installation

When installing the fan, please consider the following instructions:






► Fans with free inlet and outlet should be installed with an unobstructed distance of at least 1,5 x fan diameter on suction and pressure sides. Fans should have a bellmouth on the inlet side in order to assure optimal incoming flow. A diffusor mounted on the pressure side will increase efficiency.

► When installing fans in a ducted system, adequate distance to other structural parts such as bends, filters and silencers should be provided for. A sharp bend radius of the duct near the suction or pressure side of the fan is to be avoided. Flexible connections are to be installed in a way that does not obstruct the outlet cross section of the fan (see following page).

### Forms of running

Wolter axial flow fans are available for all forms of running. The chart below shows all standard forms of running. Please indicate the required configuration when ordering. Arrows outside the fan casing indicates the correct direction of rotation and airflow.

Form S, SU and SO are not licensed by AMCA International.

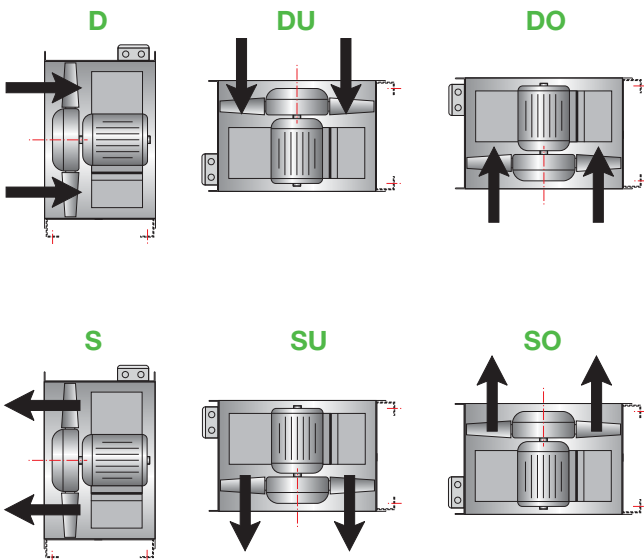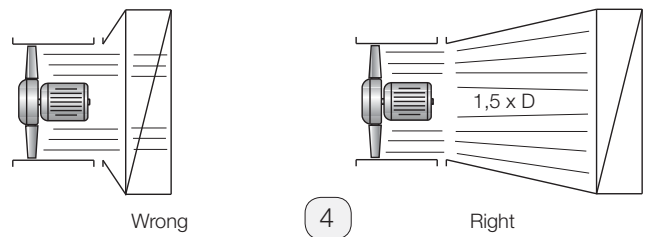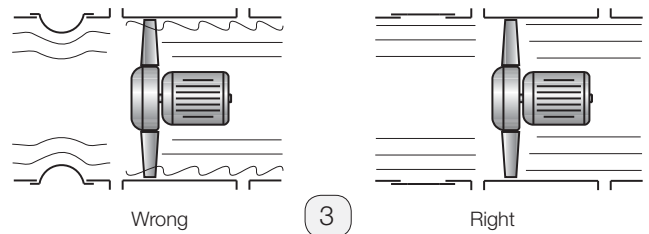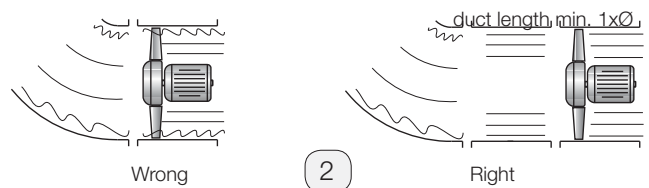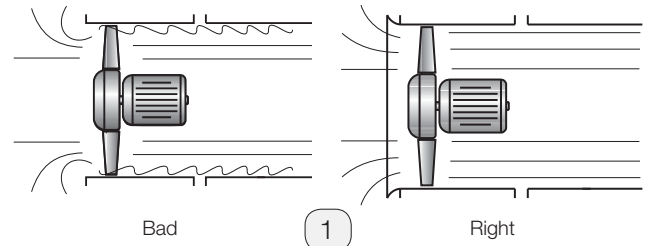

# Technical information

## Selection example

### Required duty point

- Volume flow: 50000 m<sup>3</sup>/h
- Static pressure: 735 Pa

In order to calculate the total pressure, please add velocity pressure to static pressure (185 Pa dynamic pressure + 735 Pa static pressure = 920 Pa total pressure)

- Fan speed: 1.500 1/min (4-pole)

### Using the fan curve

Having chosen a fan with adequate performance range for the required duty point, plot volume flow and pressure.

At the point of intersection, the following data can be read:



- Motor speed or number of poles 1.500 1/min - 4-pole
- Pitch angle: 30 degrees
- Absorbed power: 19,30 kW
- Sound Power Level: 114 dBA

## Calculation of motor power

There are two possibilities to calculate the motor power:

- Calculation of absorbed power by using the fan curve in duty point:  
19,30 kW  
Motor power: 22 kW
- Calculation according to peak absorbed power, see table below the fan curve: 19,49 kW  
Motor power: 22 kW

The given peak absorbed power is the maximum shaft absorbed power over the whole pitch angle curve in.

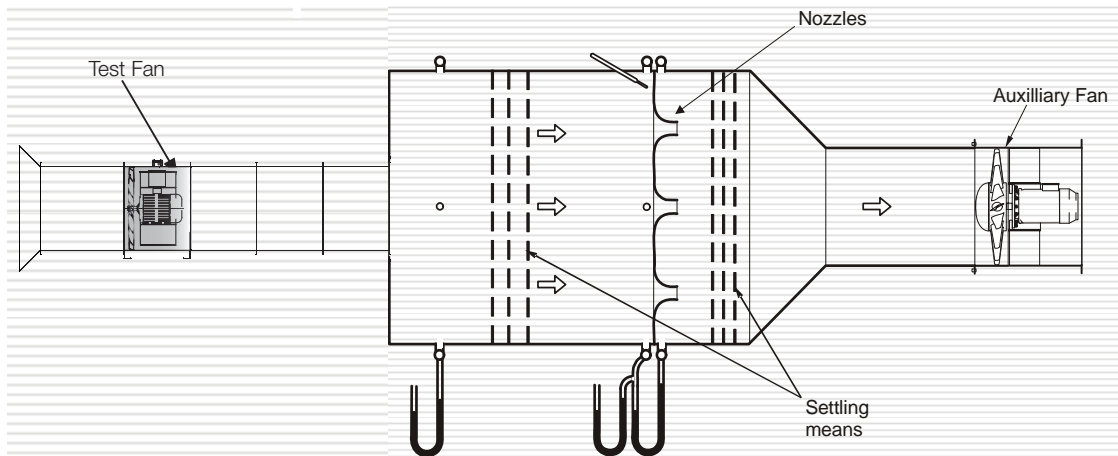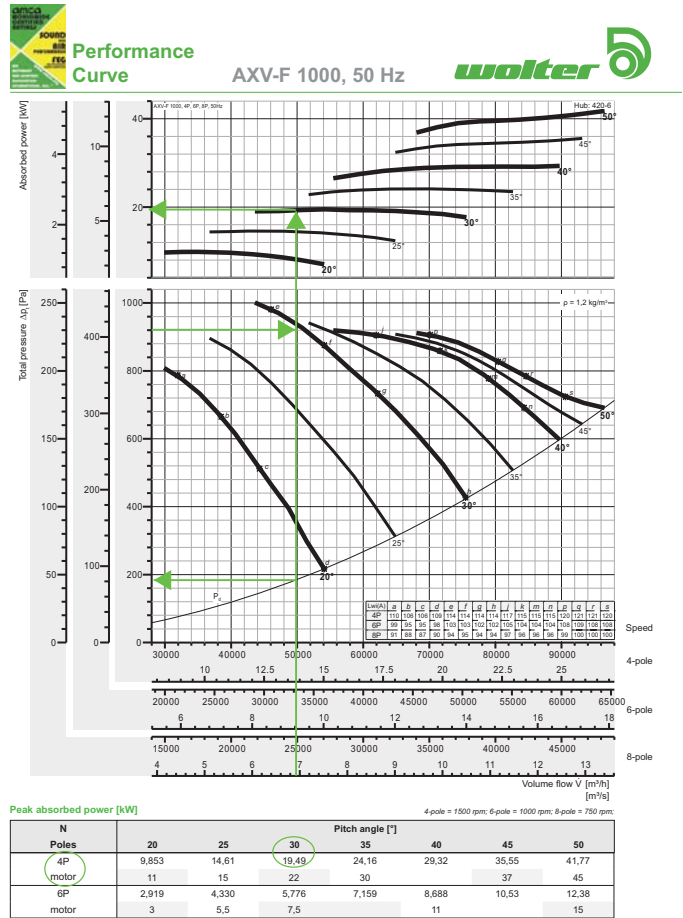

AMCA 210 Figure 12  
ISO 5801 Figure 73b

# AMCA - FEG rating


## Fan Efficiency Grade: AXV-F



Certified FEGs are determined in accordance with AMCA 205-12 Energy Efficiency Classification for fans. In conjunction with AMCA 211-13 (Rev. 2015) Certified Ratings Program, Product Rating Manual for Fan Air Performance. This classification is based on fan peak (optimum) total efficiency for a given fan speed, fan size and application category. For the purpose of energy classification, the peak efficiency can be determined at a speed not higher than the maximum design speed of the fan.

The AMCA Certified Ratings Seal applies to the Fan Efficiency Grade (FEG) for AXV-F series Axial Fan model AXV-F 500 to AXV-F 2800 as shown in the table below.


Fan Model No.	Fan Speed (rpm)	Fan Outlet Area (m2)	Fan Efficiency Grades	Fan Model No.	Fan Speed (rpm)	Fan Outlet Area (m2)	Fan Efficiency Grade
AXV-F 500	3000/1500/1000	0,1987	FEG 80	AXV-F 1400	1500/1000/750	1,5504	FEG 80
AXV-F 560	3000/1500/1000	0,2507	FEG 75	AXV-F 1600	1500/1000/750	2,0232	FEG 80
AXV-F 630	3000/1500/1000	0,3157	FEG 75	AXV-F 1800	1000/750/600	2,5588	FEG 80
AXV-F 710	3000/1500/1000	0,3970	FEG 75	AXV-F 2000	1000/750/600	3,1573	FEG 80
AXV-F 800	1500/1000/750	0,4989	FEG 75	AXV-F 2200	750/600/500	3,8186	FEG 80
AXV-F 900	1500/1000/750	0,6277	FEG 75	AXV-F 2400	750/600/500	4,5428	FEG 80
AXV-F 1000	1500/1000/750	0,7901	FEG 75	AXV-F 2500	750/600/500	4,9284	FEG 80
AXV-F 1120	1500/1000/750	0,9940	FEG 75	AXV-F 2600	750/600/500	5,3297	FEG 80
AXV-F 1250	1500/1000/750	1,2272	FEG 75	AXV-F 2800	750/600/500	6,1795	FEG 80

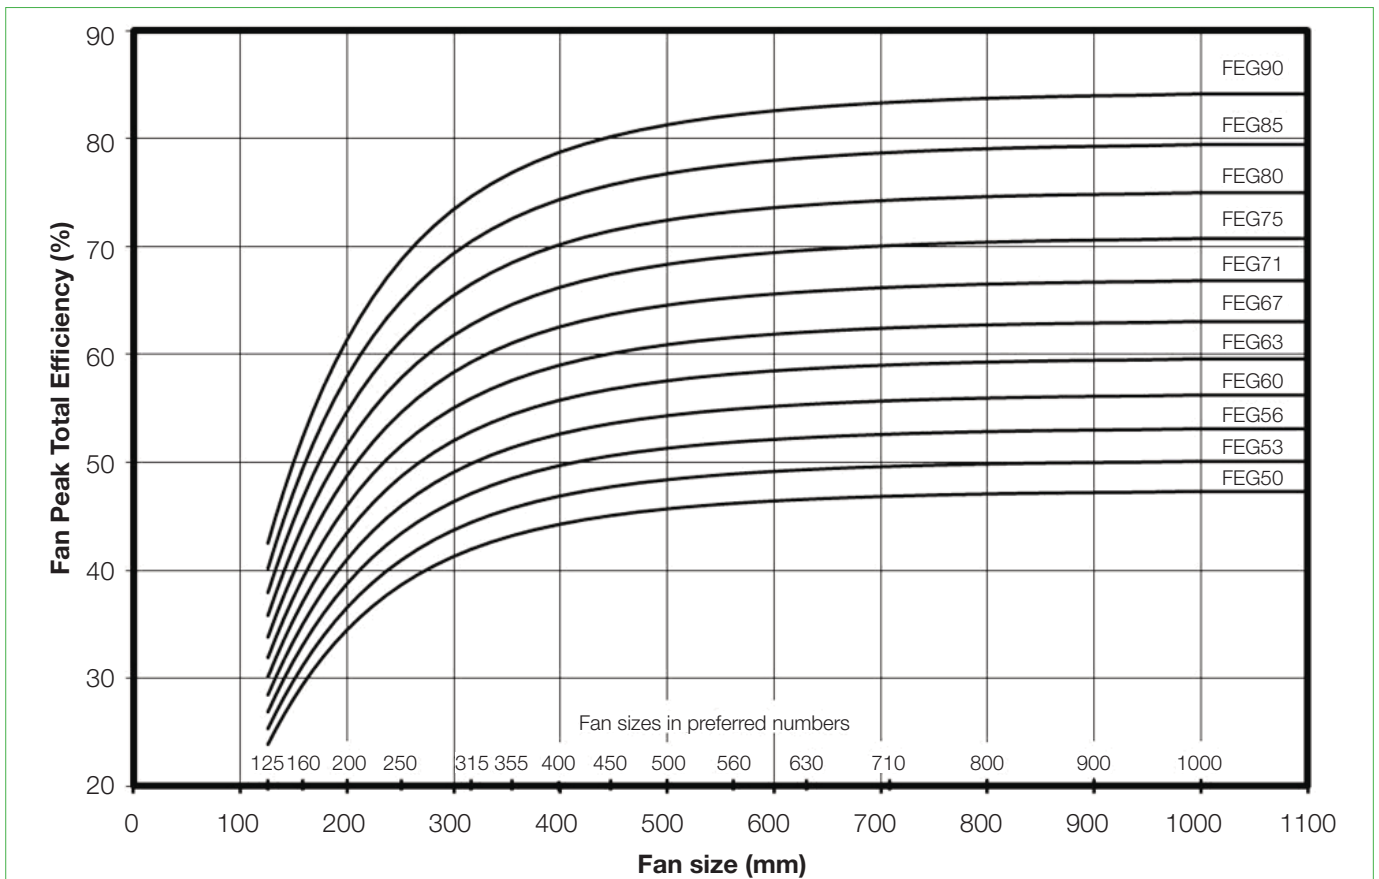



# Performance Curve

## AXV-F 500, 50 Hz

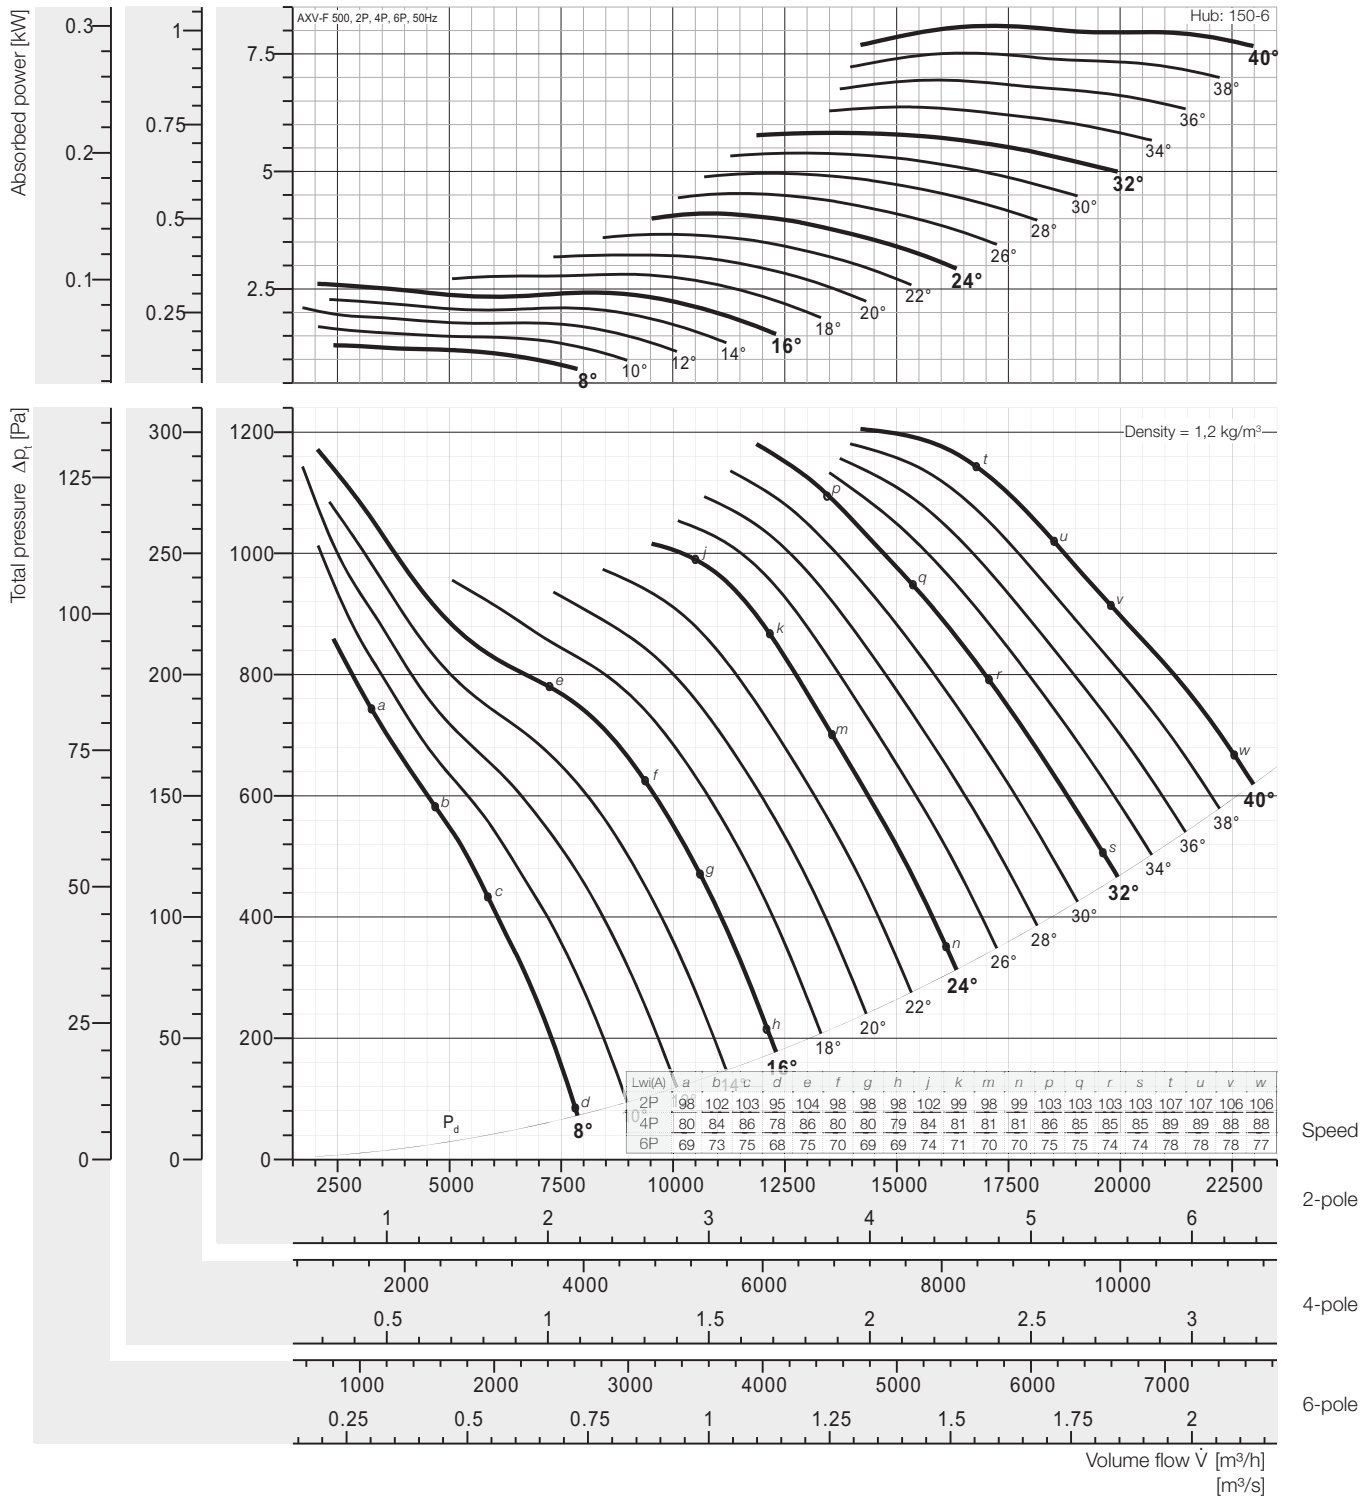

### Peak absorbed power [kW]


2-pole = 3000 rpm; 4-pole = 1500 rpm; 6-pole = 1000 rpm;

N Poles	Pitch angle [°]																
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
2P motor	1,302	1,703	2,103	2,278	2,610	2,812	3,224	3,665	4,108	4,536	4,965	5,395	5,825	6,372	6,946	7,522	8,100
4P motor	0,163	0,213	0,263	0,285	0,326	0,352	0,403	0,458	0,514	0,567	0,621	0,674	0,728	0,797	0,868	0,940	1,012
6P motor	0,048	0,063	0,078	0,084	0,097	0,104	0,119	0,136	0,152	0,168	0,184	0,200	0,216	0,236	0,257	0,279	0,300

Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



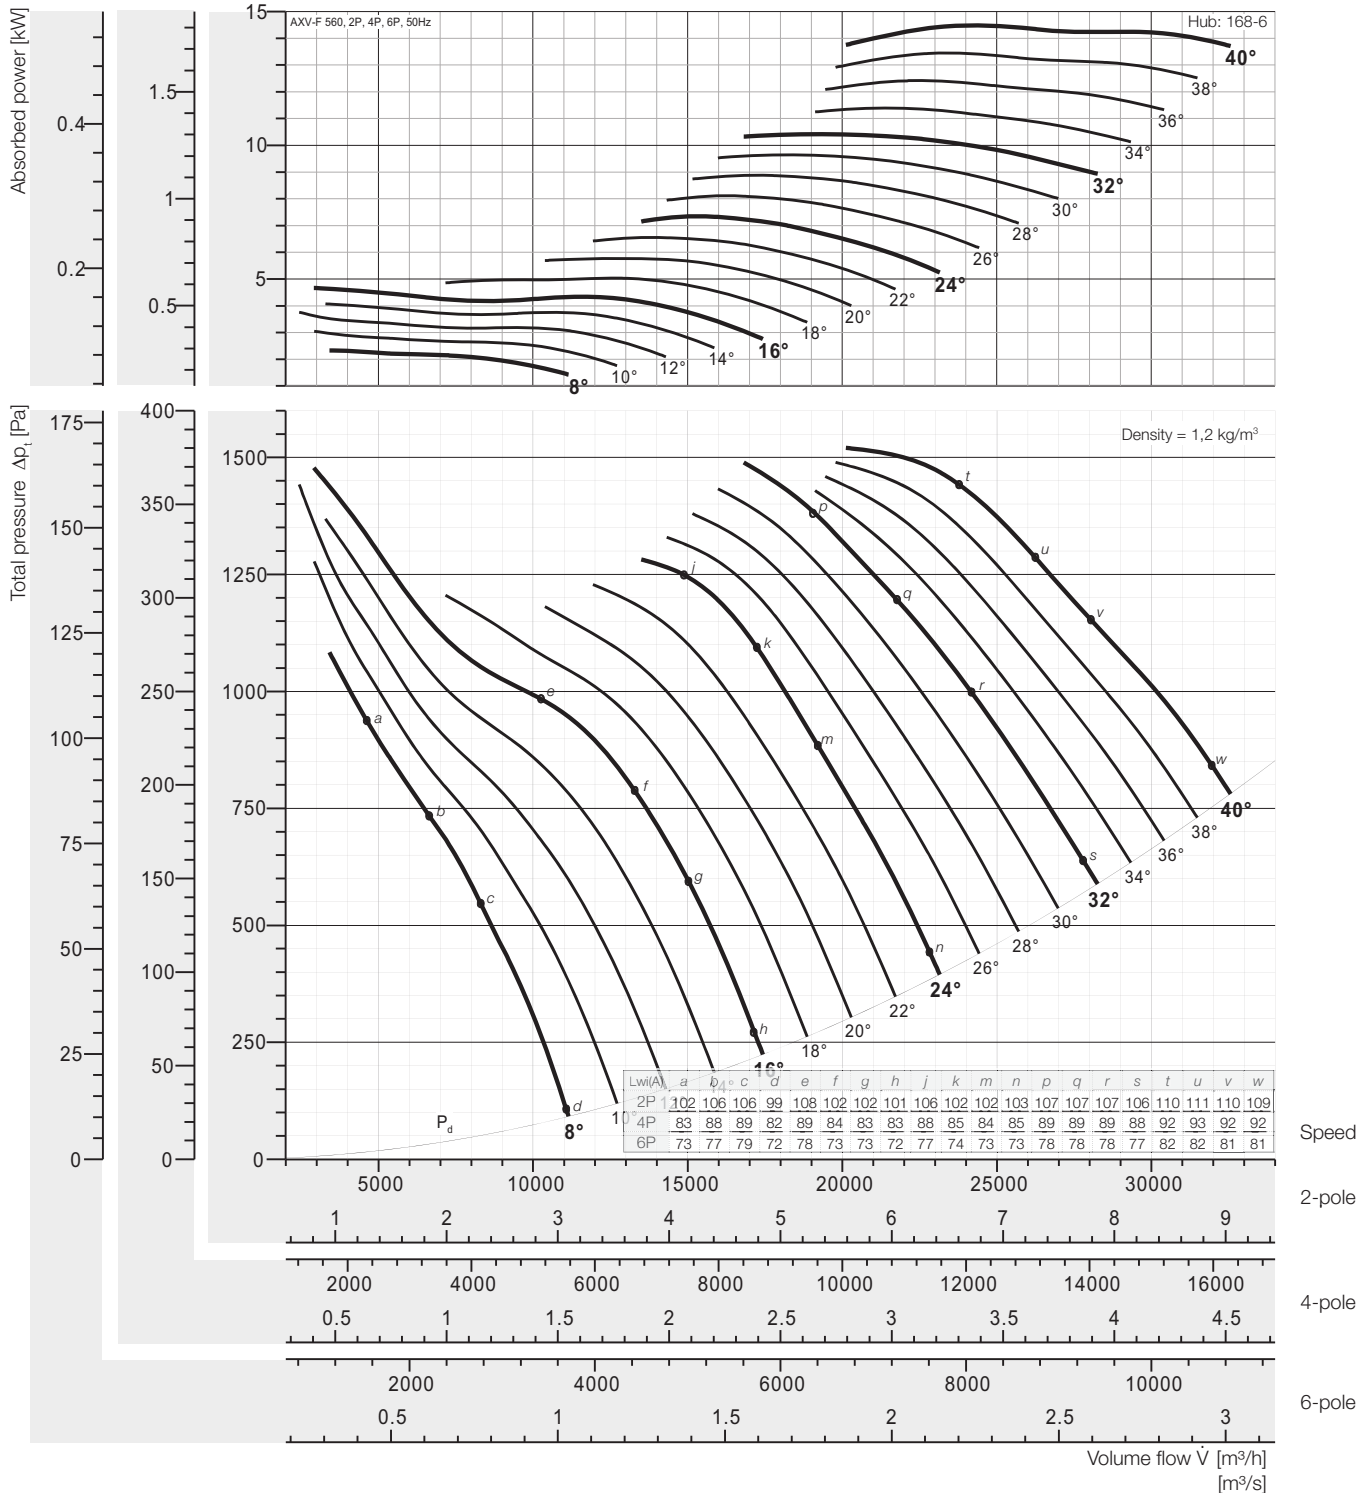

Peak absorbed power [kW]

2-pole = 3000 rpm; 4-pole = 1500 rpm; 6-pole = 1000 rpm;

N Poles	Pitch angle [°]																
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
2P motor	2,329	3,045	3,761	4,073	4,667	5,028	5,765	6,553	7,345	8,111	8,878	9,646	10,42	11,39	12,42	13,45	14,48
	3,0	4,0		5,5		7,5				11				15			
4P motor	0,291	0,381	0,470	0,509	0,583	0,629	0,721	0,819	0,918	1,014	1,110	1,206	1,302	1,424	1,552	1,681	1,810
	0,37	0,55			0,75			1,1			1,5				2,2		
6P motor	0,086	0,113	0,139	0,151	0,173	0,186	0,214	0,243	0,272	0,300	0,329	0,357	0,386	0,422	0,460	0,498	0,536
	0,25								0,37				0,55				

Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.


The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.





# Performance Curve

## AXV-F 630, 50 Hz

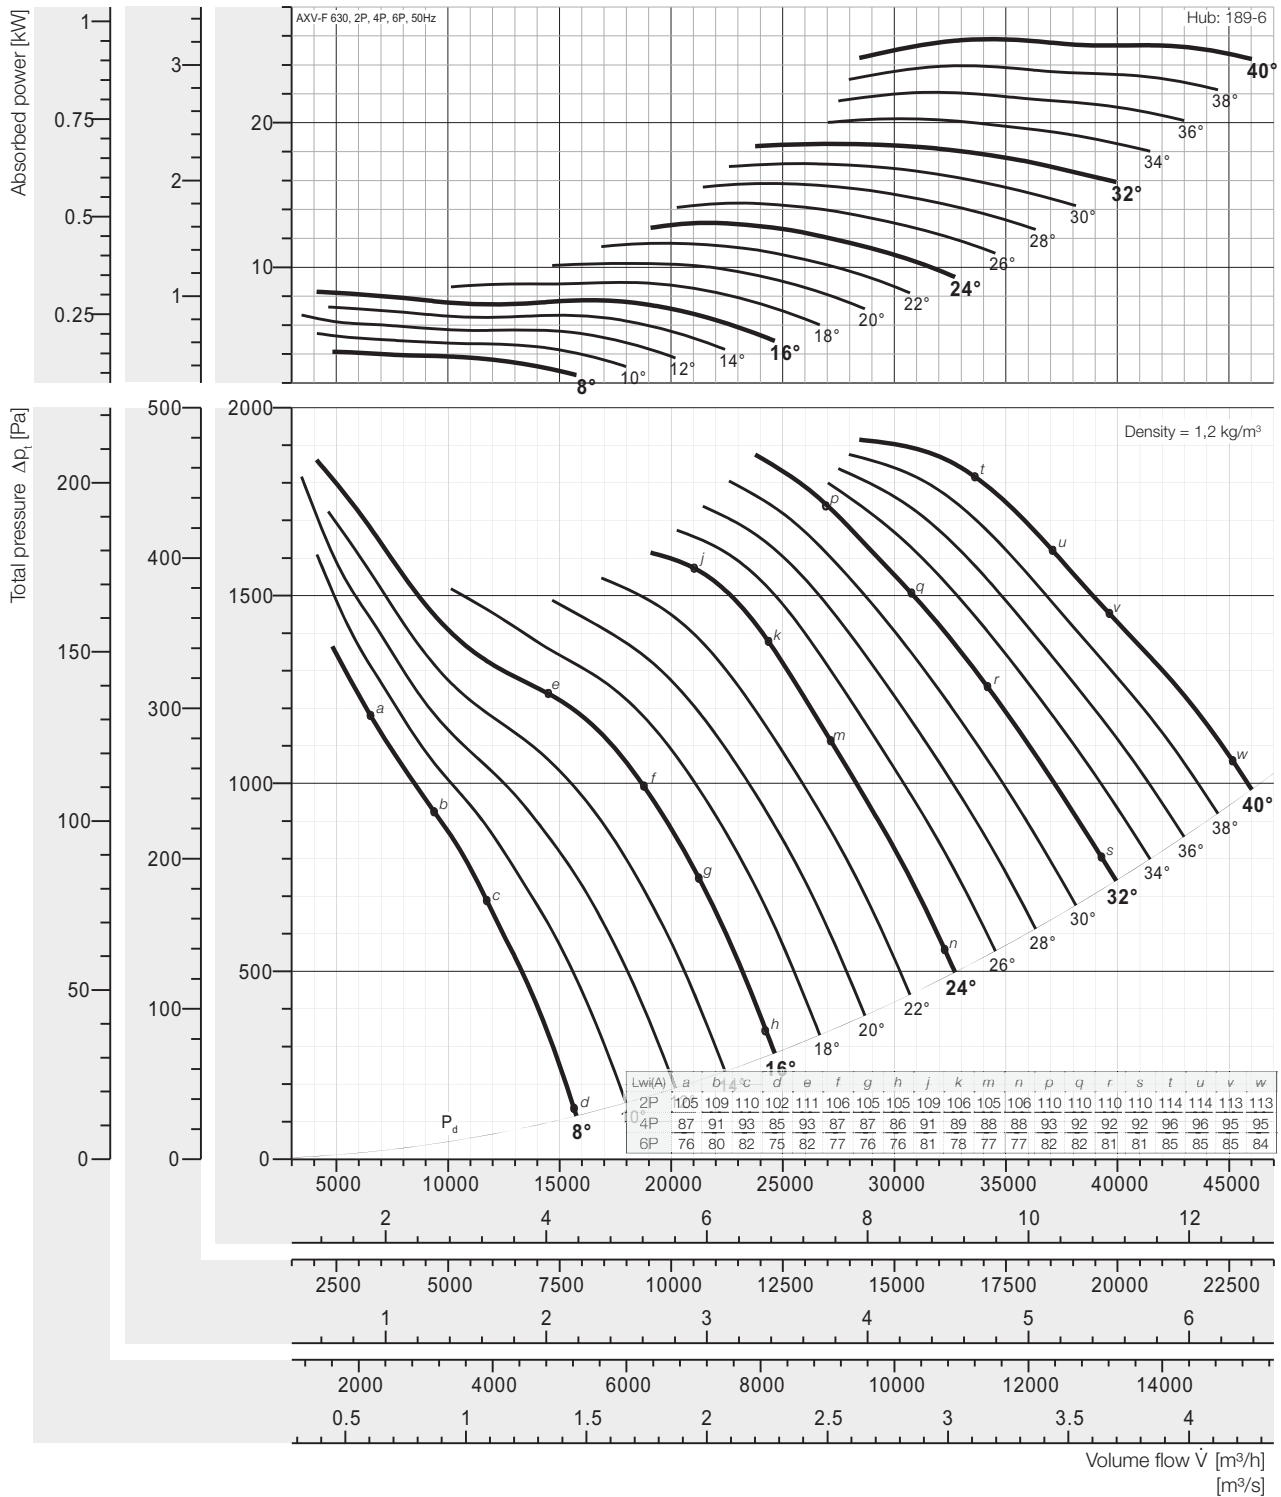

### Peak absorbed power [kW]

2-pole = 3000 rpm; 4-pole = 1500 rpm; 6-pole = 1000 rpm;

N Poles	Pitch angle [°]																
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
2P motor	4,145	5,419	6,693	7,248	8,307	8,949	10,26	11,66	13,07	14,44	15,80	17,17	18,54	20,28	22,10	23,94	25,78
4P motor	0,518	0,677	0,837	0,906	1,038	1,119	1,283	1,458	1,634	1,805	1,975	2,146	2,317	2,535	2,763	2,992	3,222
6P motor	0,154	0,201	0,248	0,268	0,308	0,331	0,380	0,432	0,484	0,535	0,585	0,636	0,687	0,751	0,819	0,887	0,955


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 710, 50 Hz

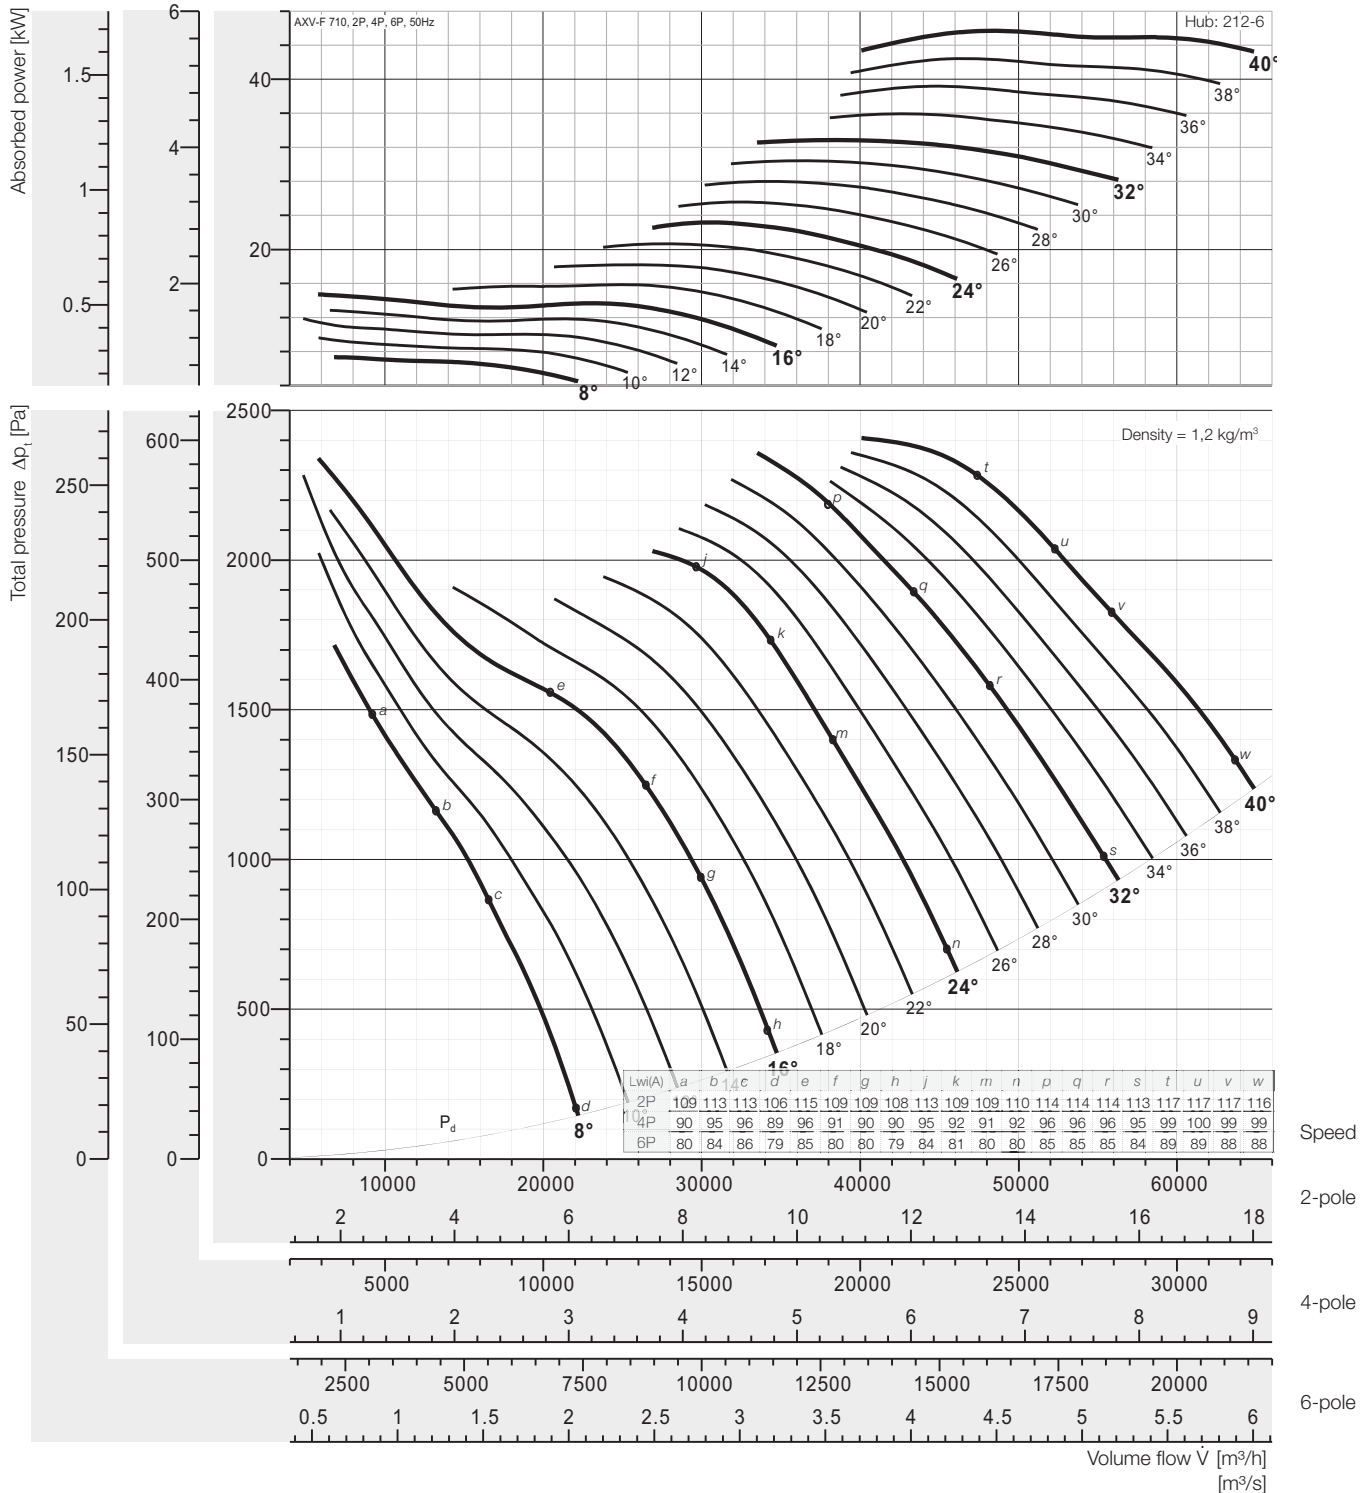

### Peak absorbed power [kW]

2-pole = 3000 rpm; 4-pole = 1500 rpm; 6-pole = 1000 rpm;

N Poles	Pitch angle [°]																
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
2P motor	7,347	9,606	11,86	12,85	14,73	15,86	18,19	20,67	23,17	25,59	28,01	30,43	32,86	35,95	39,18	42,43	45,69
4P motor	0,918	1,201	1,483	1,606	1,841	1,983	2,274	2,584	2,897	3,199	3,501	3,804	4,107	4,494	4,898	5,304	5,711
6P motor	0,272	0,356	0,439	0,476	0,545	0,588	0,674	0,766	0,858	0,948	1,037	1,127	1,217	1,331	1,451	1,572	1,692


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 800, 50 Hz

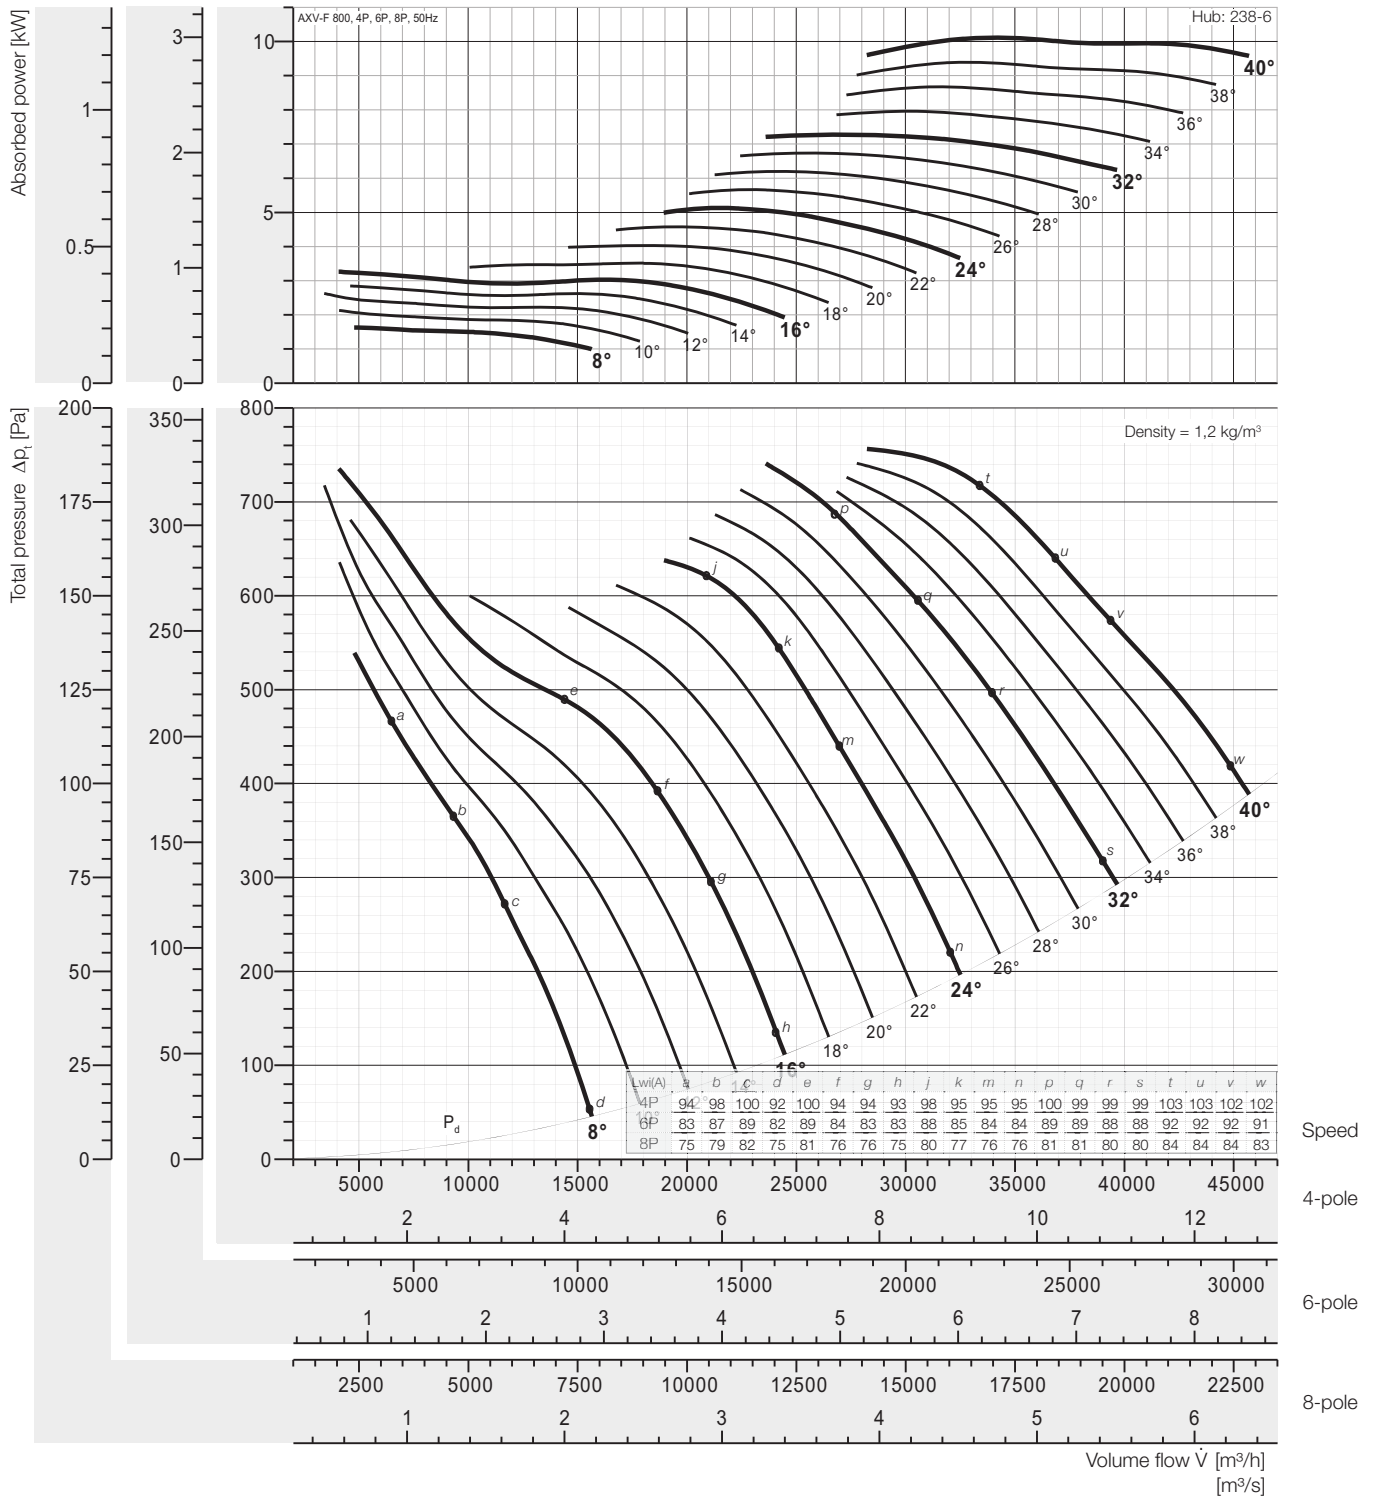

### Peak absorbed power [kW]

4-pole = 1500 rpm; 6-pole = 1000 rpm; 8-pole = 750 rpm;

N Poles	Pitch angle [°]																			
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40			
4P motor	1,626	2,126	2,626	2,844	3,260	3,512	4,026	4,576	5,130	5,665	6,200	6,737	7,274	7,957	8,673	9,393	10,11			
6P motor	0,482	0,630	0,778	0,843	0,966	1,040	1,193	1,356	1,520	1,678	1,837	1,996	2,155	2,358	2,570	2,783	2,997			
8P motor	0,203	0,266	0,328	0,356	0,407	0,439	0,503	0,572	0,641	0,708	0,775	0,842	0,909	0,995	1,084	1,174	1,264			


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 900, 50 Hz

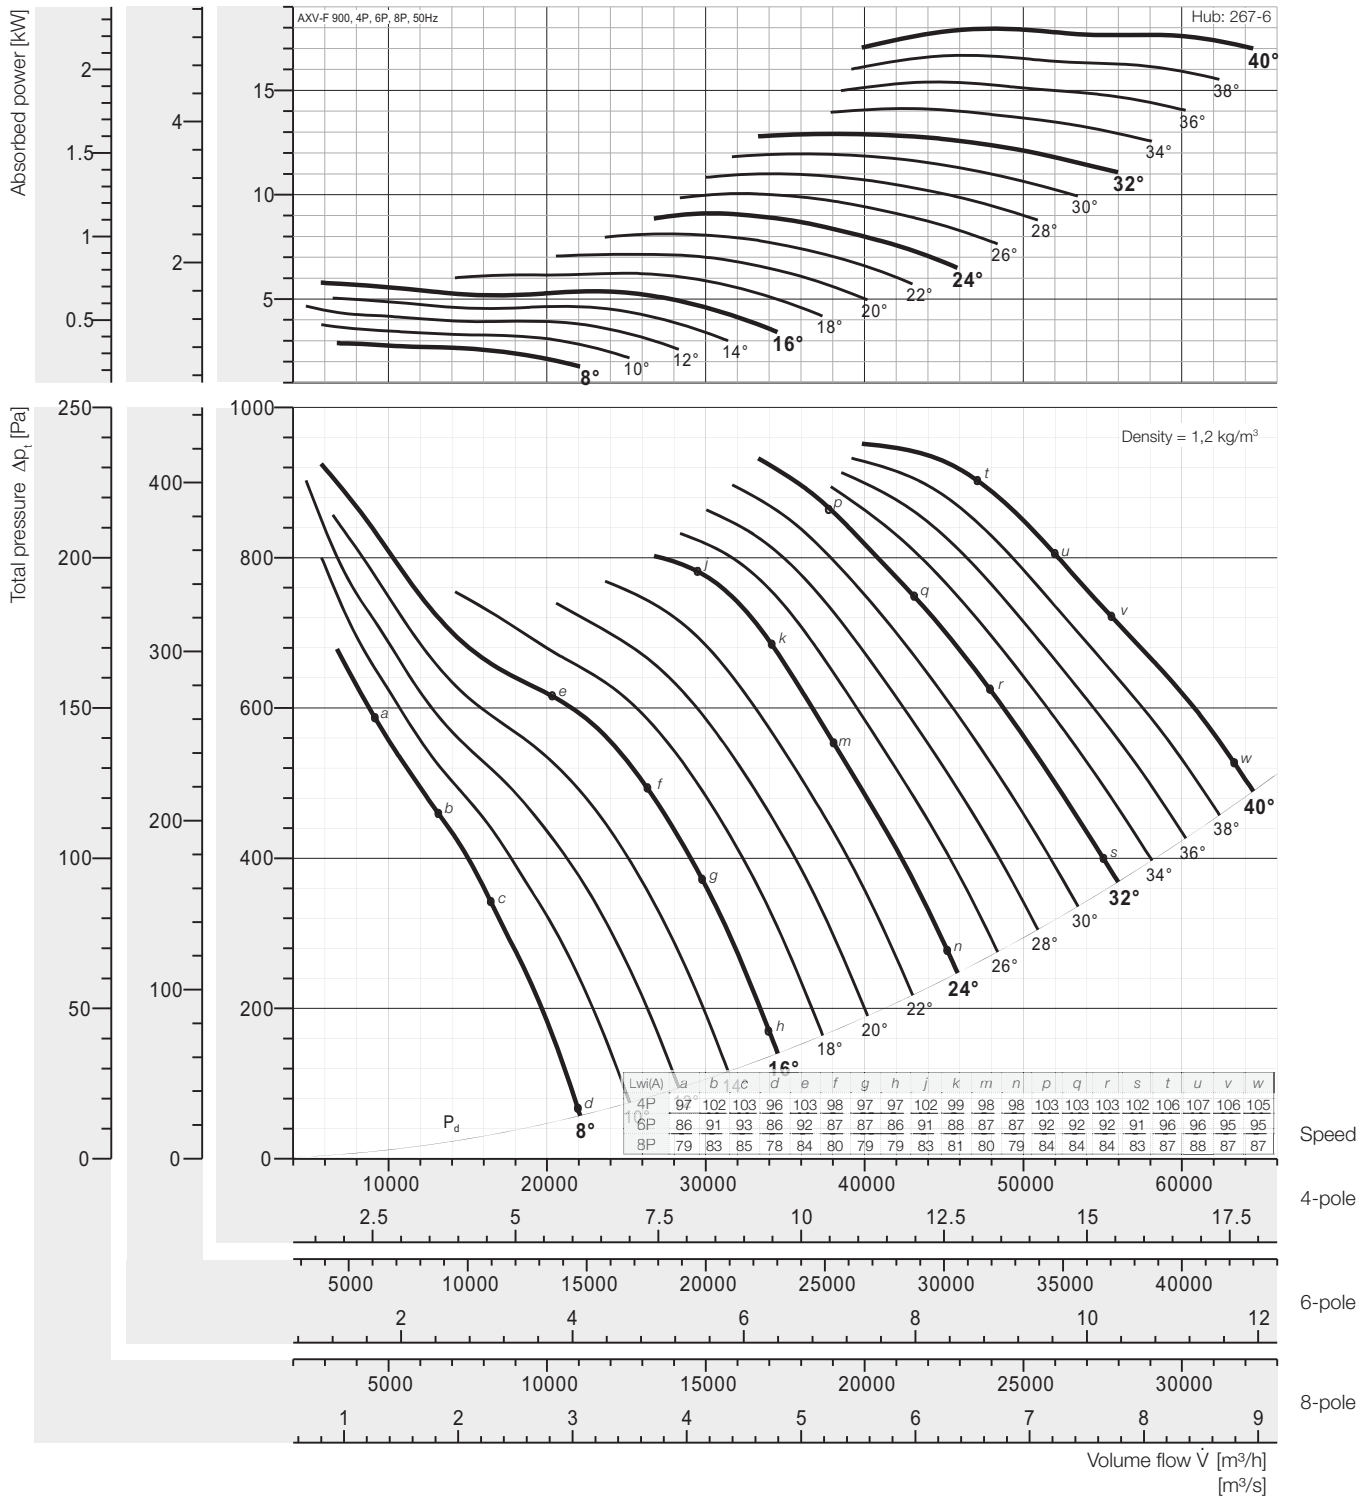

### Peak absorbed power [kW]

4-pole = 1500 rpm; 6-pole = 1000 rpm; 8-pole = 750 rpm;

N Poles	Pitch angle [°]																
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
4P motor	2,888	3,775	4,663	5,050	5,787	6,235	7,149	8,125	9,108	10,06	11,00	11,96	12,91	14,13	15,40	16,68	17,96
6P motor	0,856	1,119	1,382	1,496	1,715	1,847	2,118	2,407	2,699	2,980	3,262	3,544	3,826	4,186	4,563	4,941	5,321
8P motor	0,361	0,472	0,583	0,631	0,723	0,779	0,894	1,016	1,138	1,257	1,376	1,495	1,614	1,766	1,925	2,085	2,245


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 1000, 50 Hz

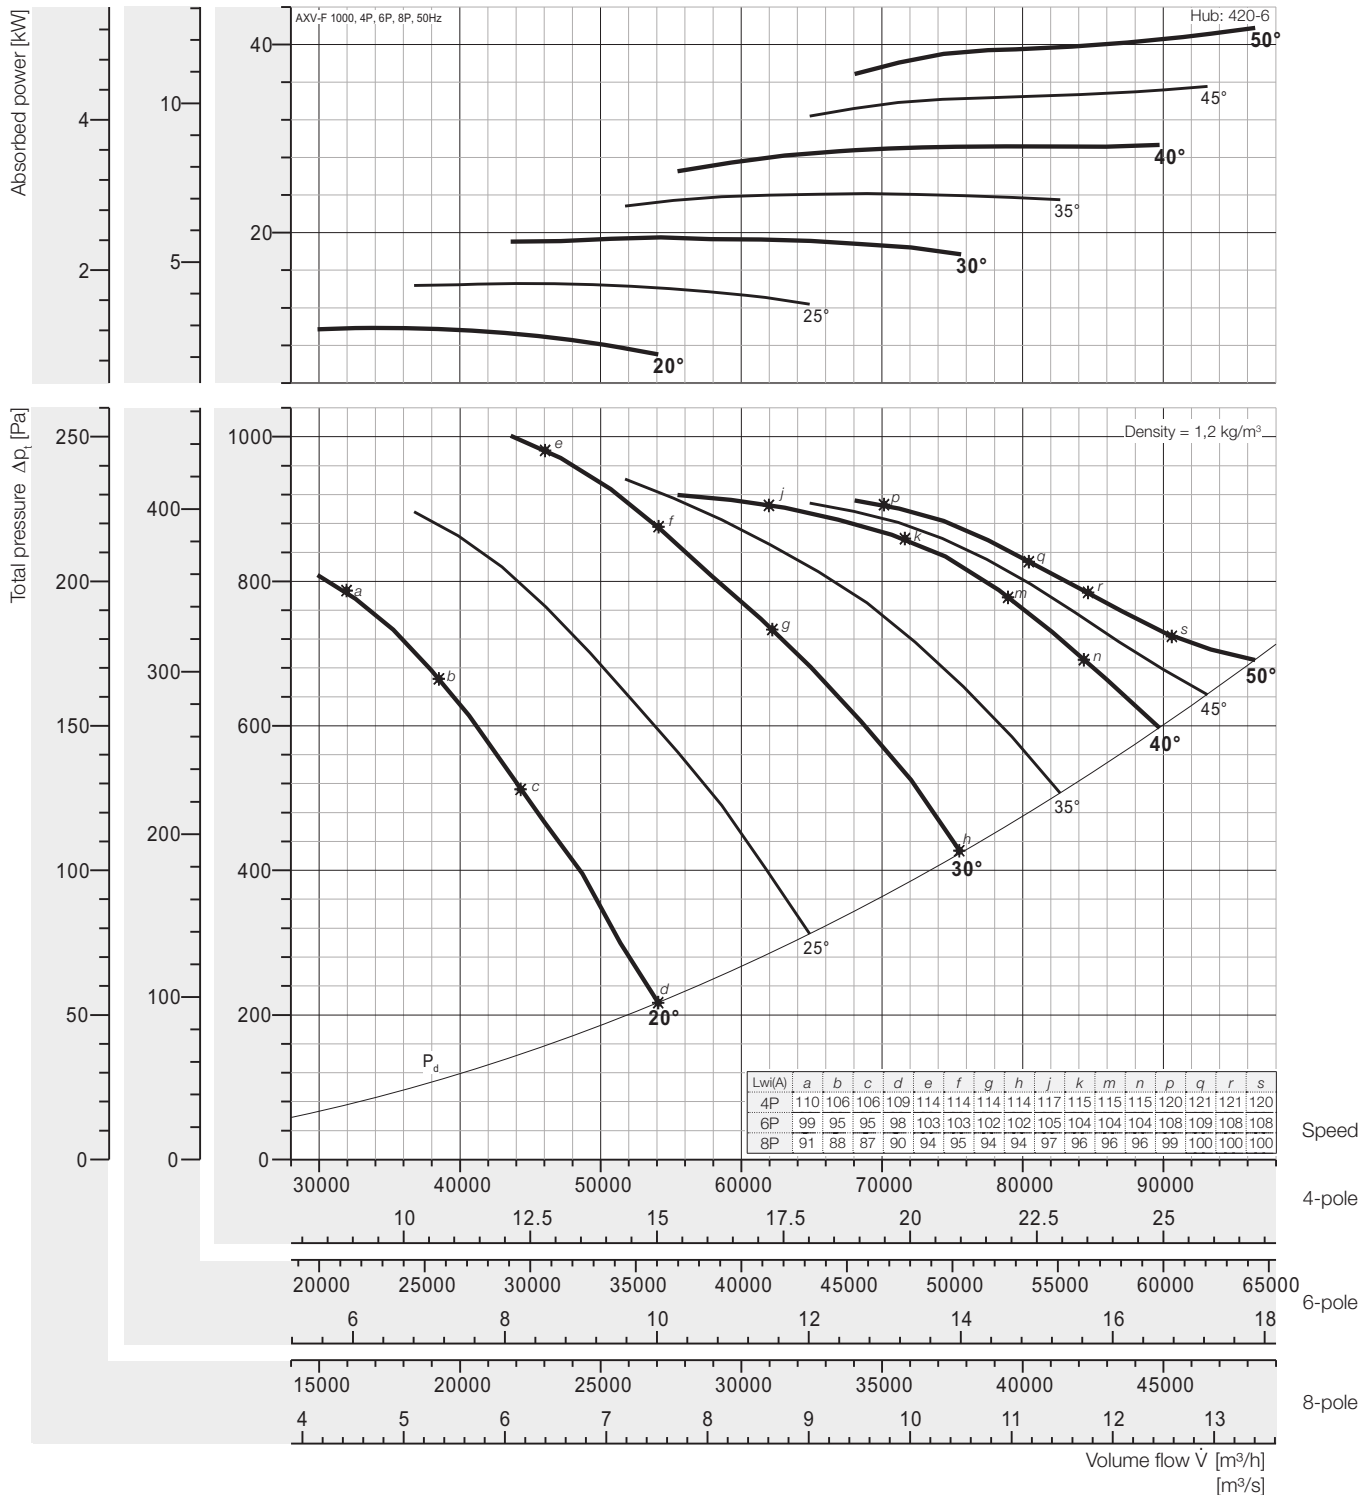

### Peak absorbed power [kW]

4-pole = 1500 rpm; 6-pole = 1000 rpm; 8-pole = 750 rpm;

N Poles	Pitch angle [°]						
	20	25	30	35	40	45	50
4P motor	9,853 11	14,61 15	19,49 22	24,16 30	29,32	35,55 37	41,77 45
6P motor	2,919 3	4,330 5,5	5,776 7,5	7,159	8,688 11	10,53	12,38 15
8P motor	1,232 1,5	1,827 2,2	2,437 3	3,020 4	3,665	4,443 5,5	5,222


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 1120, 50 Hz

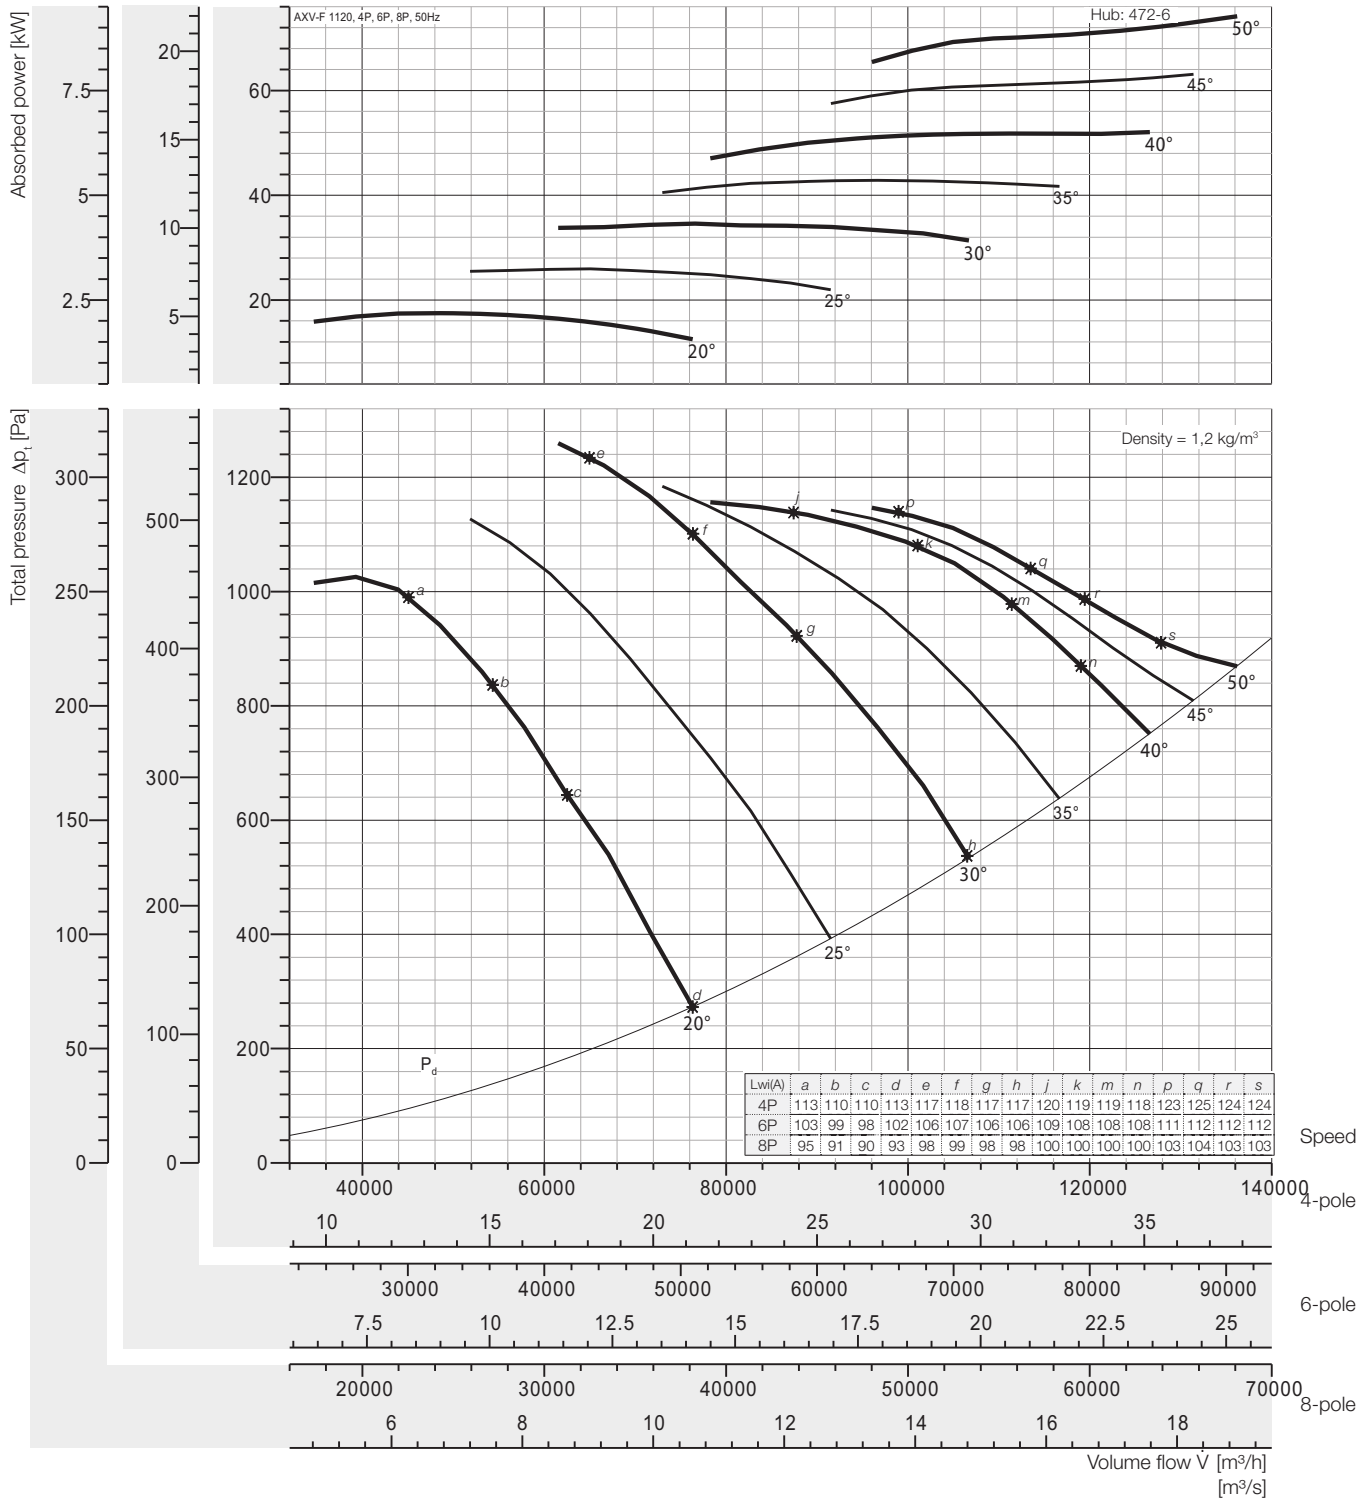

### Peak absorbed power [kW]

4-pole = 1500 rpm; 6-pole = 1000 rpm; 8-pole = 750 rpm;

N Poles	Pitch angle [°]						
	20	25	30	35	40	45	50
4P motor	17,51	25,94	34,60	42,89	52,05	63,11	74,16
	18,5	30	37	45	55	75	
6P motor	5,187	7,686	10,25	12,71	15,42	18,70	21,97
	5,5	11		15	18,5	22	
8P motor	2,188	3,243	4,326	5,361	6,506	7,888	9,270
	2,2	4	5,5		7,5	11	



Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 1250, 50 Hz

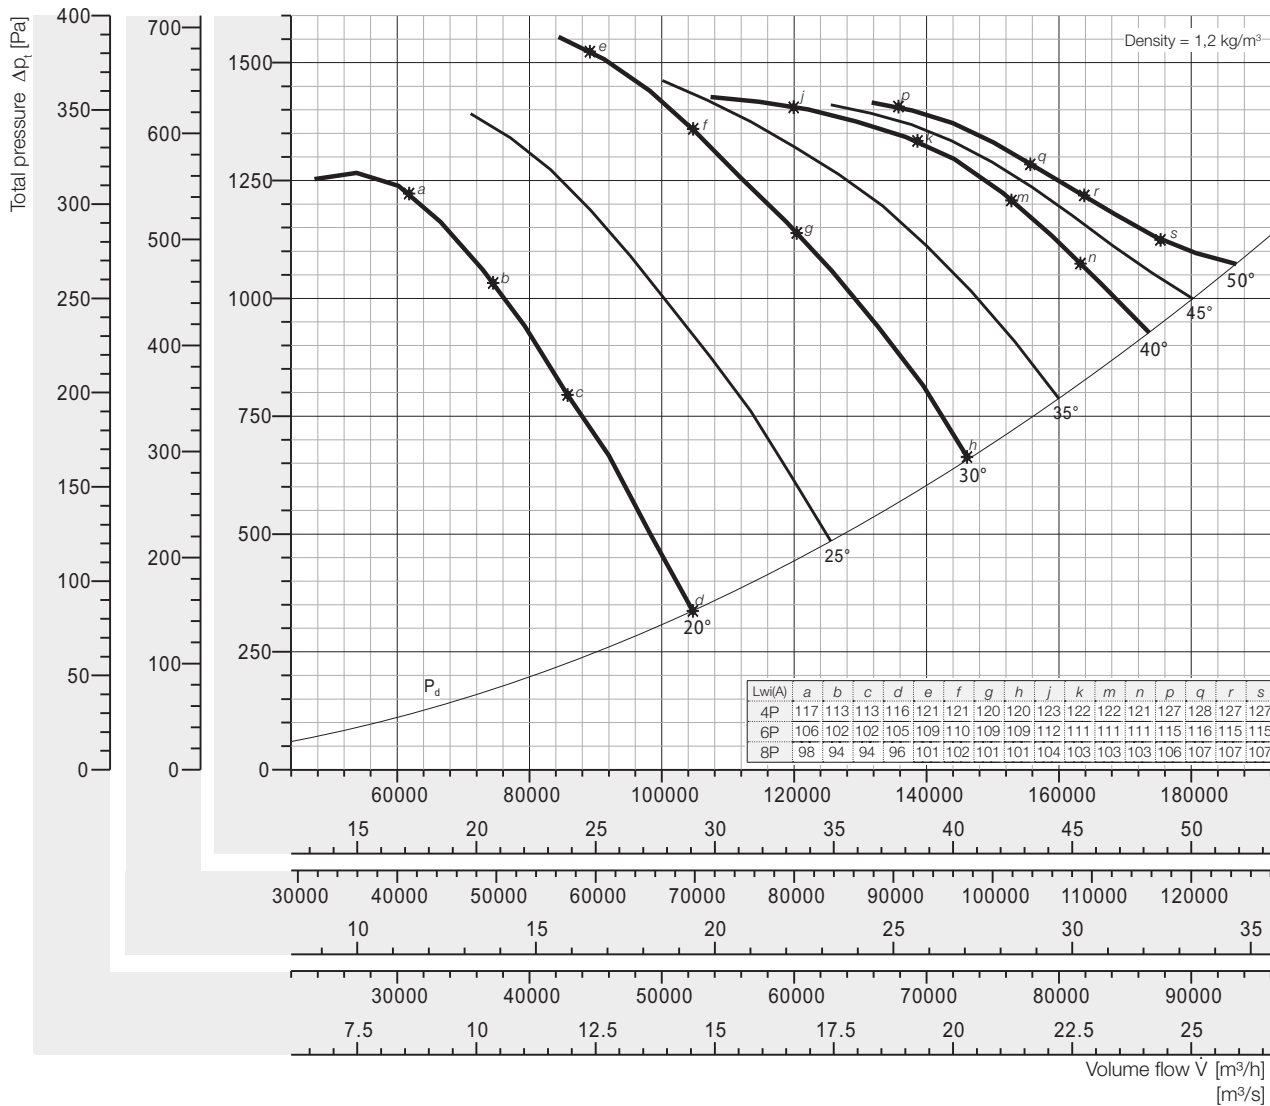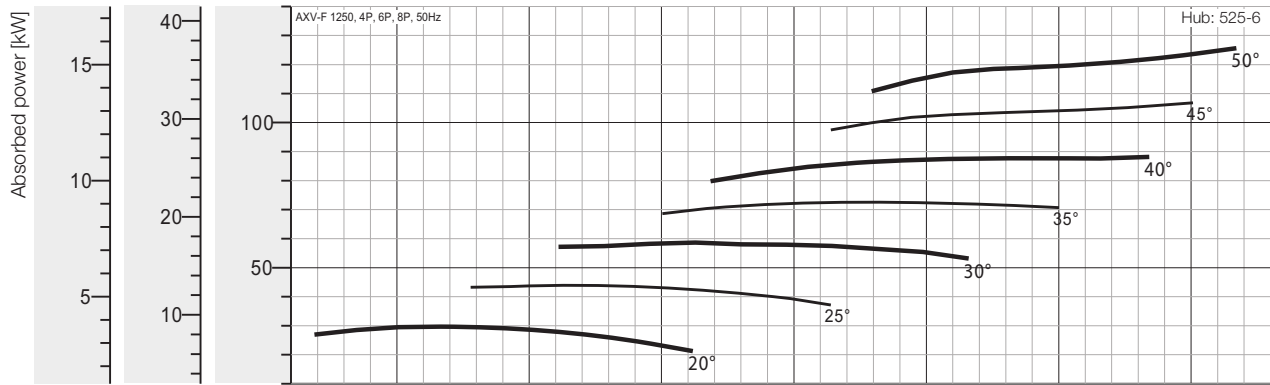

Speed  
4-pole  
6-pole  
8-pole

### Peak absorbed power [kW]


4-pole = 1500 rpm; 6-pole = 1000 rpm; 8-pole = 750 rpm;

N Poles	Pitch angle [°]						
	20	25	30	35	40	45	50
4P motor	29,65	43,93	58,60	72,64	88,15	106,9	125,6
	30	45	75	90	-	-	-
6P motor	8,78	13,02	17,36	21,52	26,12	31,66	37,21
	11	15	18,5	22	30	37	45
8P motor	3,706	5,492	7,325	9,080	11,02	13,36	15,70
	4	5,5	7,5	11	15	-	-

Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



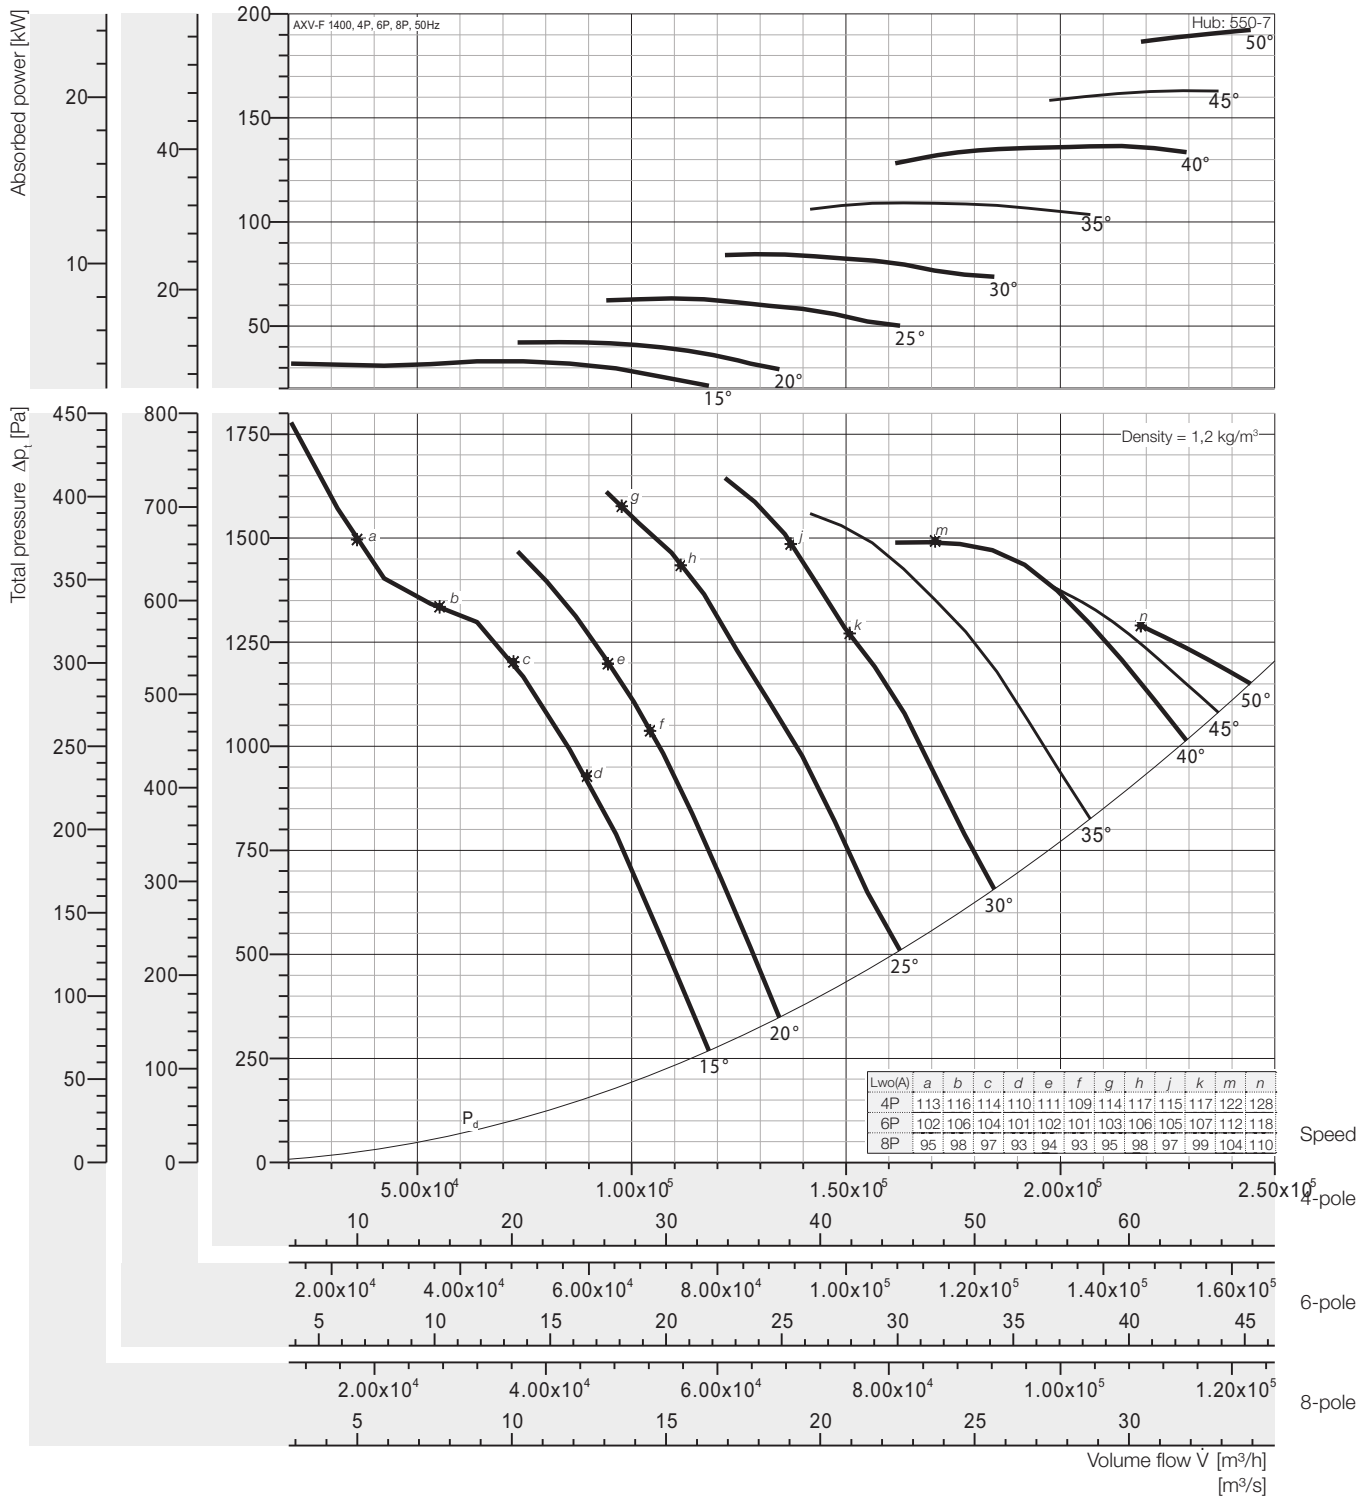

Peak absorbed power [kW]

4-pole = 1500 rpm; 6-pole = 1000 rpm; 8-pole = 750 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
4P motor	33,14 37	42,28 45	63,27 75	84,50 90	109,2 110	136,5 160	163,1 200	192,3
6P motor	9,819 11	12,53 15	18,75 22	25,04 30	32,36 37	40,45 45	48,32 55	56,98 75
8P motor	4,142 5,5	5,285	7,908 11	10,56	13,65 15	17,06 18,5	20,38 22	24,04 30



Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet LwoA sound power levels for installation Type A: free inlet, free outlet.



# Performance Curve

## AXV-F 1600, 50 Hz

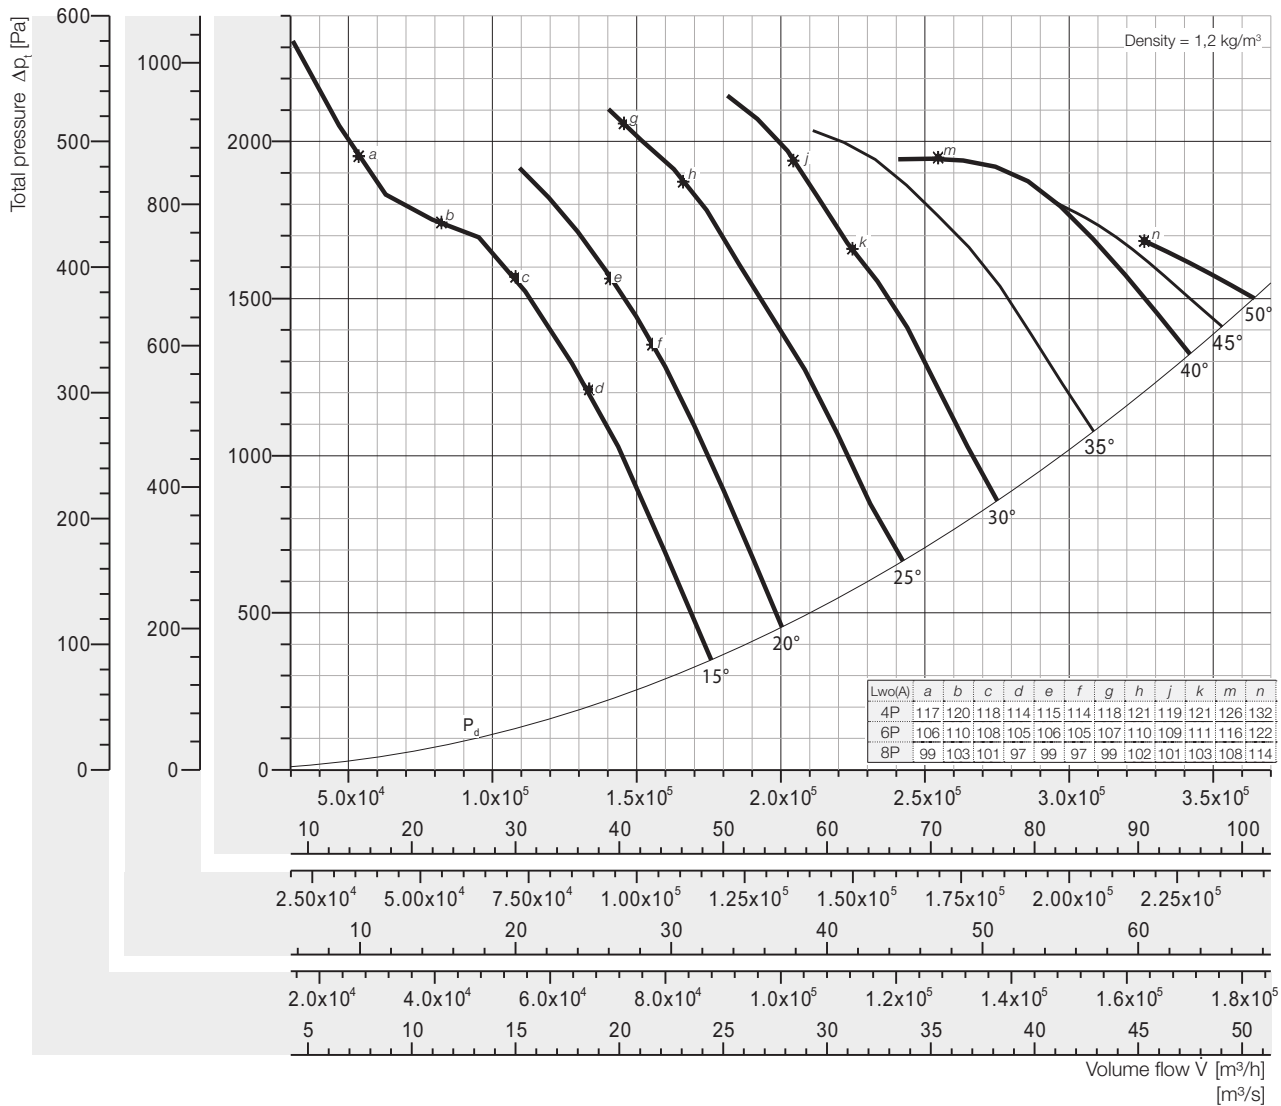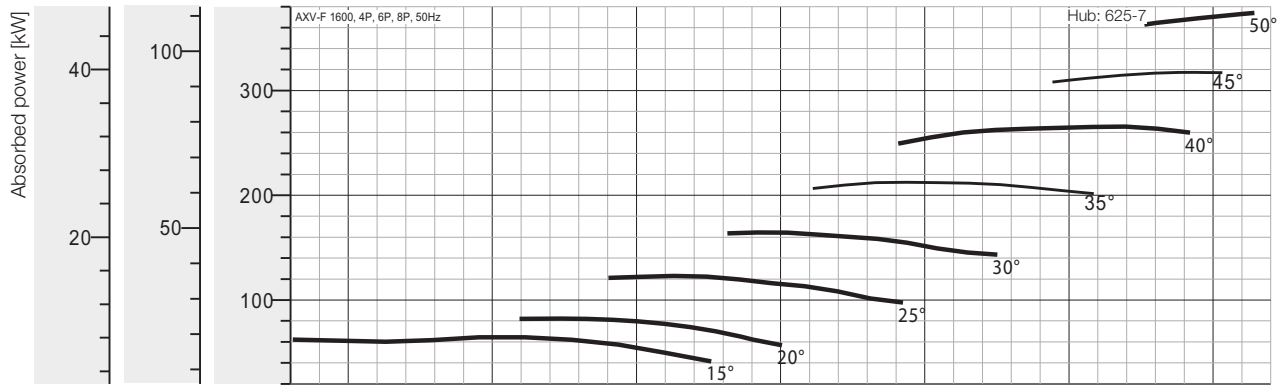

Speed  
4-pole  
6-pole  
8-pole


### Peak absorbed power [kW]

4-pole = 1500 rpm; 6-pole = 1000 rpm; 8-pole = 750 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
4P motor	64,46	82,25	123,1	164,4	212,4	265,6	317,2	374,1
6P motor	19,10	24,37	36,47	48,71	62,94	78,68	93,99	110,8
8P motor	8,058	10,28	15,38	20,55	26,55	33,19	39,65	46,76

Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet LwoA sound power levels for installation Type A: free inlet, free outlet.

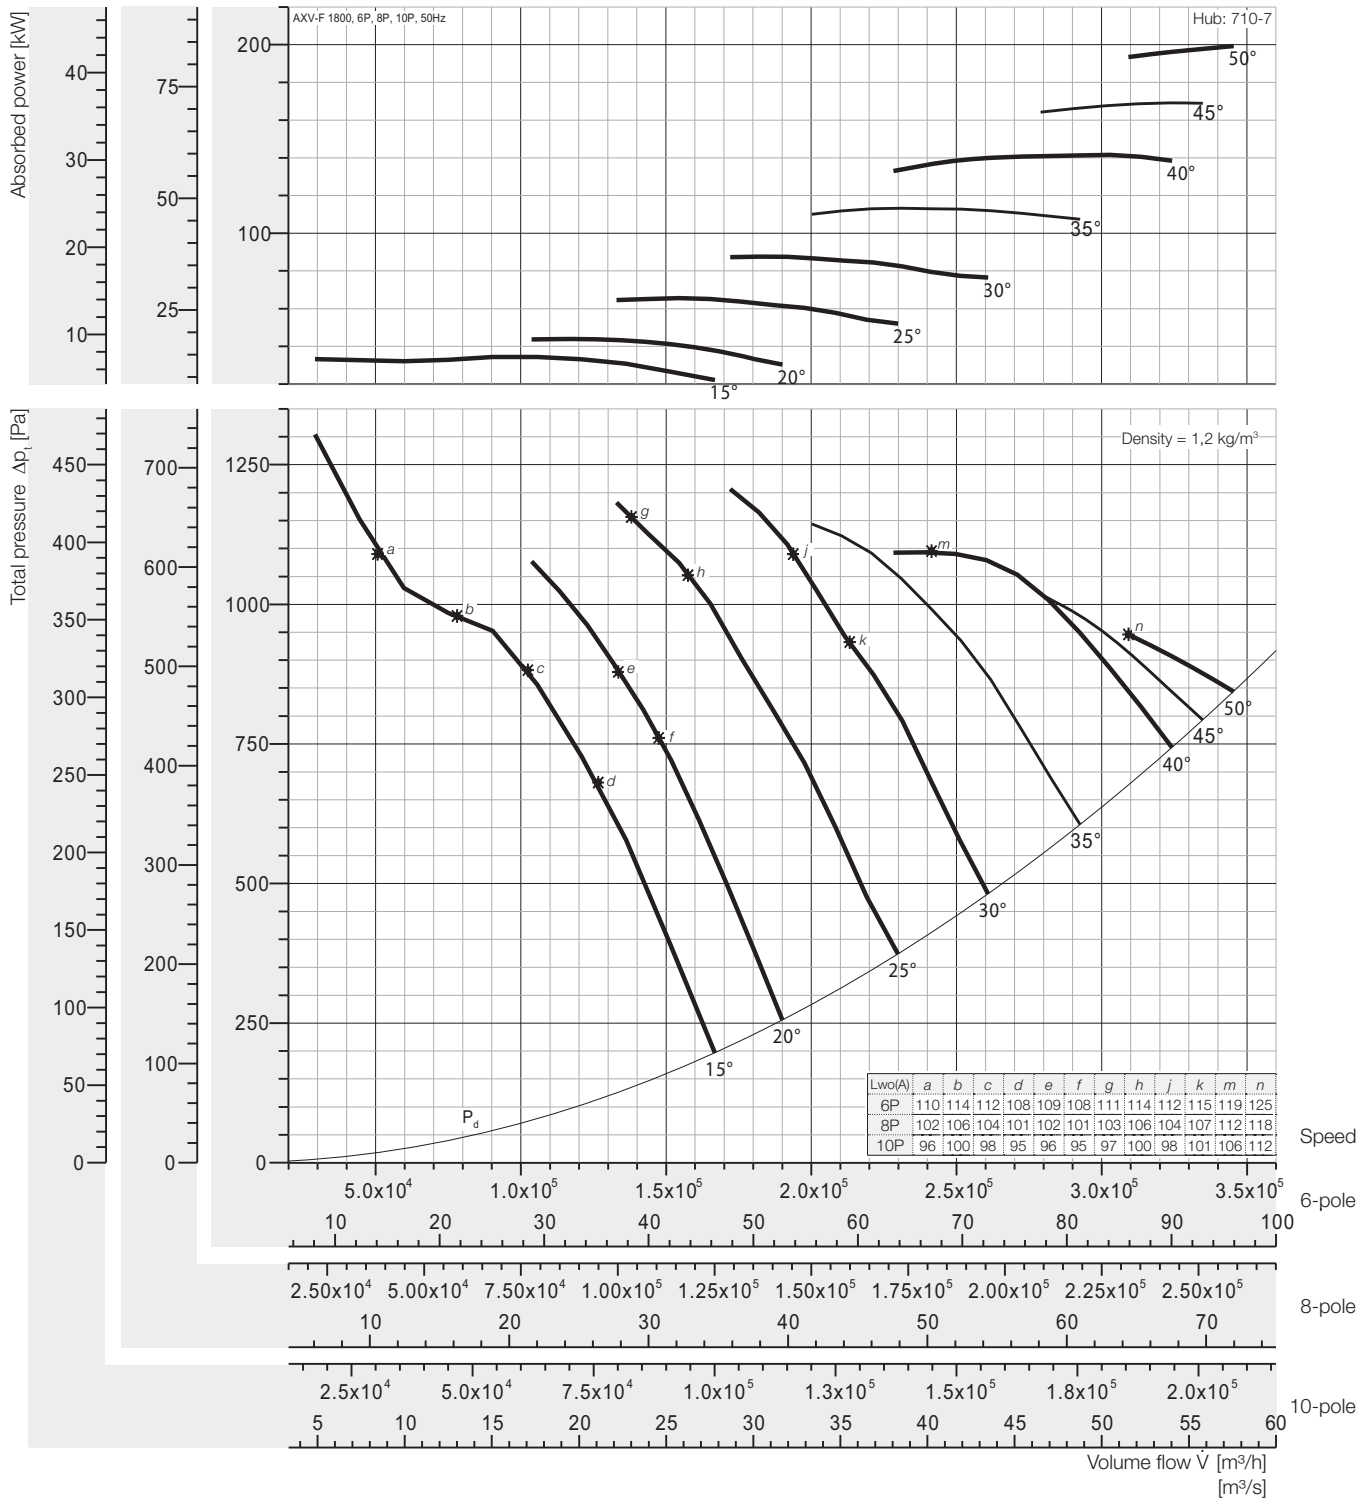

Peak absorbed power [kW]

6-pole = 1000 rpm; 8-pole = 750 rpm; 10-pole = 600 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
6P motor	34,36	43,84	65,60	87,62	113,2	141,5	169,1	199,4
	37	45	75	90	132	160	200	
8P motor	14,50	18,49	27,68	36,96	47,77	59,71	71,33	84,12
	15	18,5	30	37	55	75	90	
10P motor	7,422	9,470	14,17	18,93	24,46	30,57	36,52	43,07
	7,5	11	15	22	30	37	45	


Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet LwoA sound power levels for installation Type A: free inlet, free outlet.



# Performance Curve

## AXV-F 2000, 50 Hz

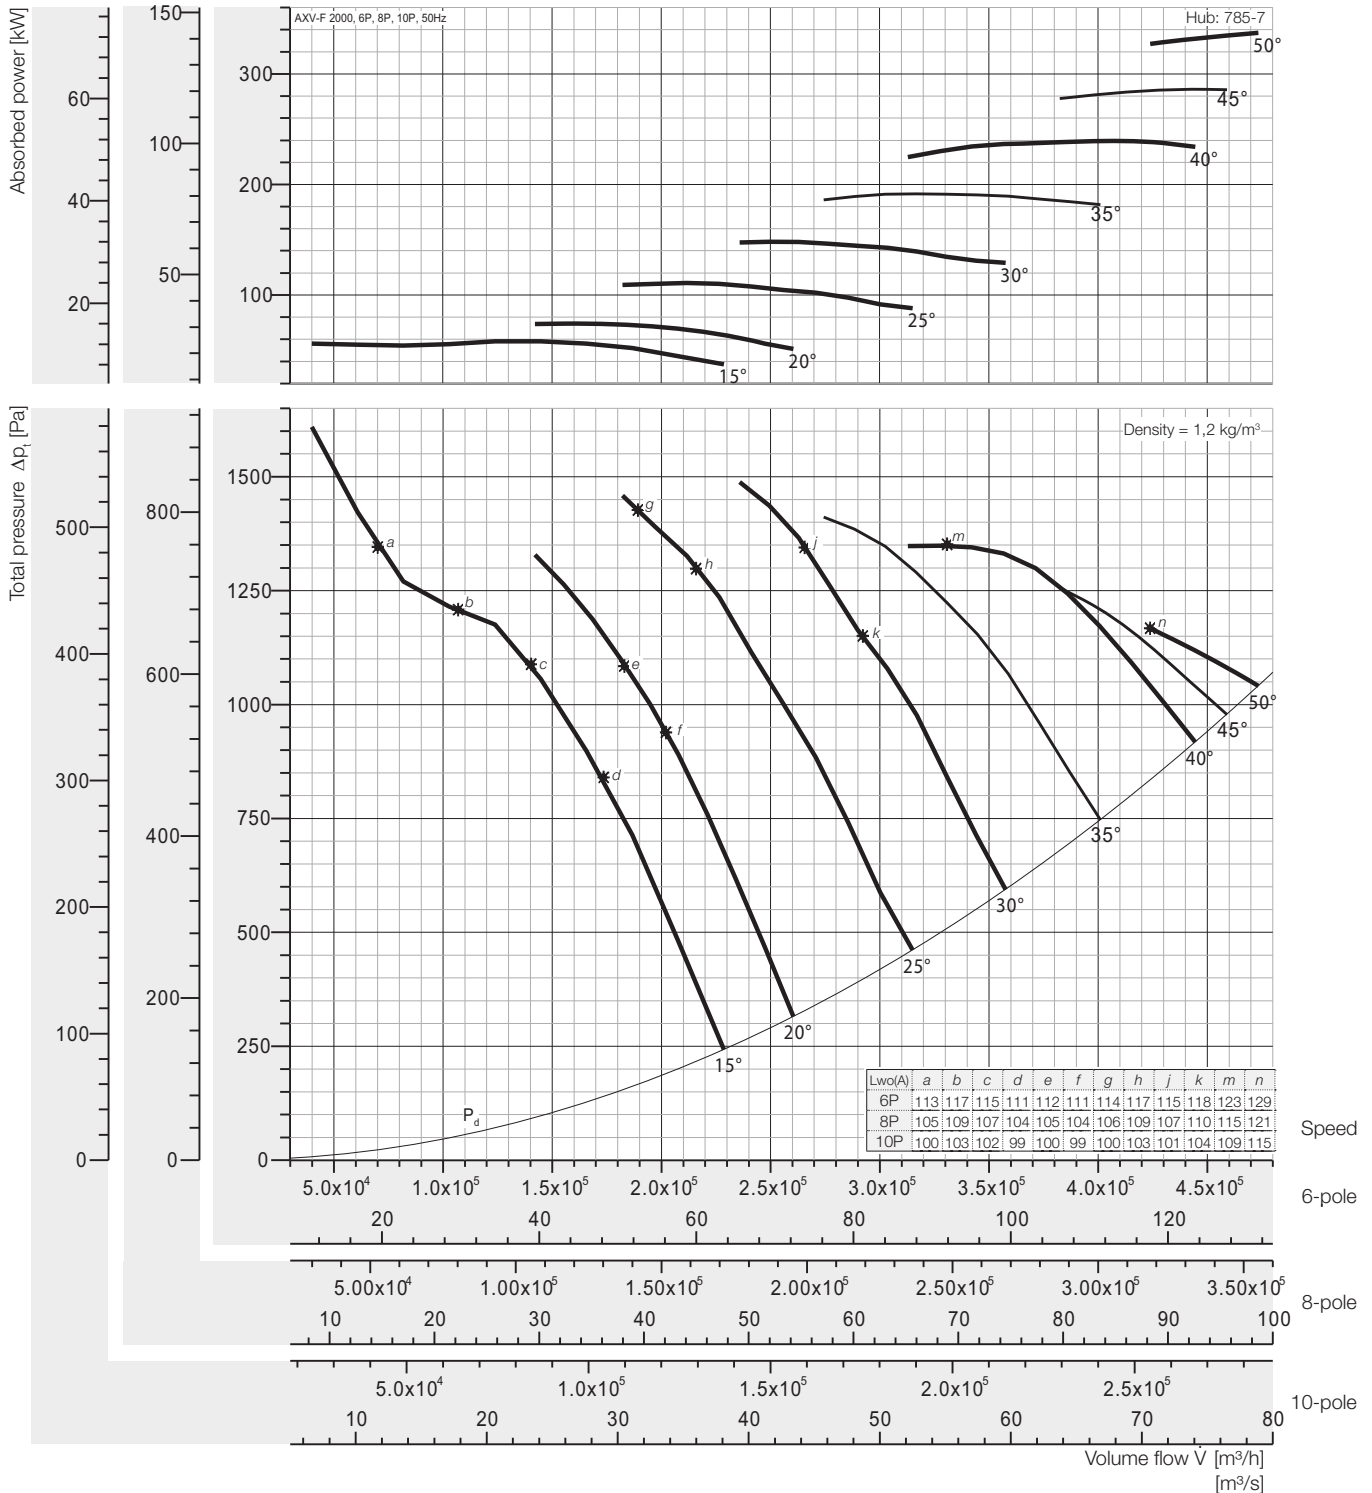

### Peak absorbed power [kW]

6-pole = 1000 rpm; 8-pole = 750 rpm; 10-pole = 600 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
6P motor	58,11	74,14	110,9	148,2	191,5	239,4	285,9	337,2
8P motor	24,51	31,28	46,80	62,51	80,79	101,0	120,6	142,2
10P motor	12,55	16,01	23,96	32,01	41,36	51,71	61,76	72,84


Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet L<sub>w</sub>(A) sound power levels for installation Type A: free inlet, free outlet.



# Performance Curve

## AXV-F 2200, 50 Hz

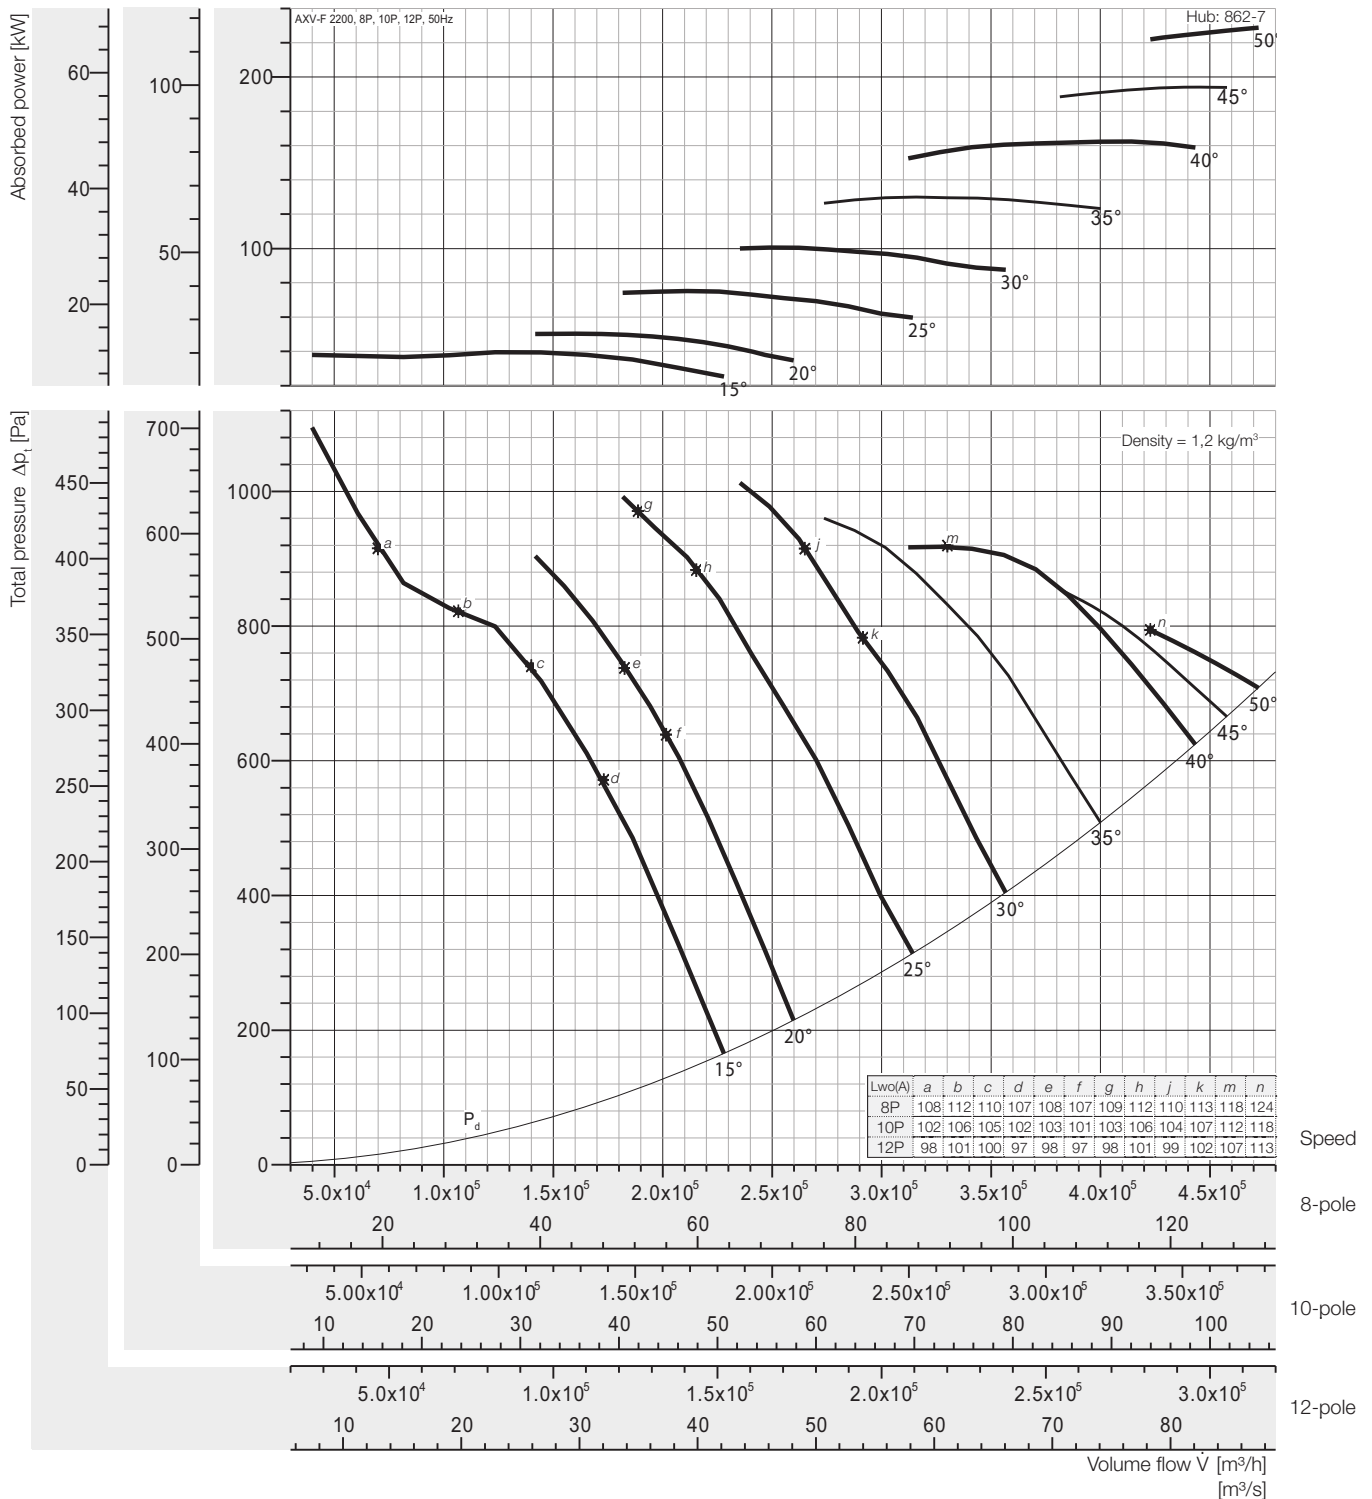

### Peak absorbed power [kW]

8-pole = 750 rpm; 10-pole = 600 rpm; 12-pole = 500 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
8P motor	39,44	50,32	75,29	100,6	130,0	162,4	194,1	228,8
	45	55	90	110	132	200		250
10P motor	20,19	25,76	38,55	51,49	66,54	83,18	99,36	117,2
	22	30	45	55	75	90	110	132
12P motor	11,68	14,91	22,31	29,80	38,51	48,14	57,5	67,81
	15		30		45	55	75	


Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet LwoA sound power levels for installation Type A: free inlet, free outlet.



# Performance Curve

## AXV-F 2400, 50 Hz

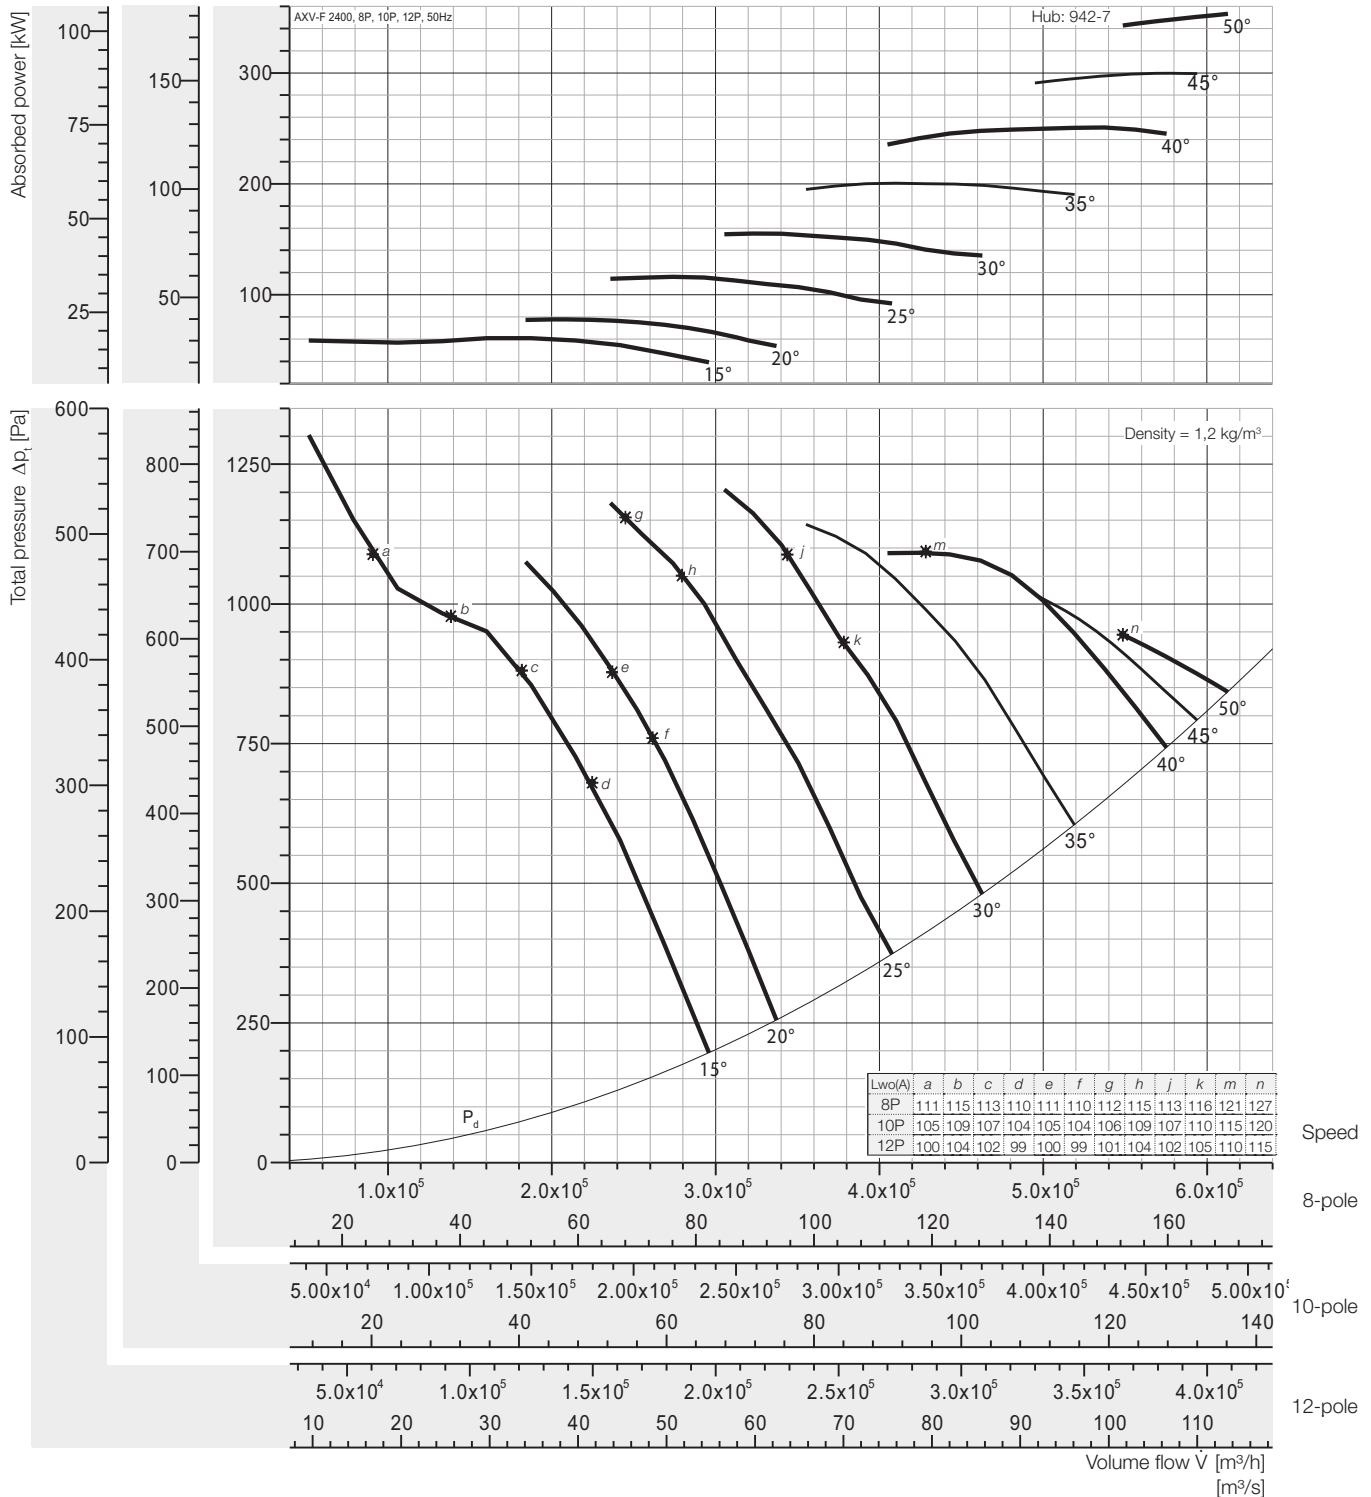


### Peak absorbed power [kW]

8-pole = 750 rpm; 10-pole = 600 rpm; 12-pole = 500 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
8P motor	60,87 75	77,67 90	116,2 132	155,2 160	200,6 250	250,8 315	299,5 160	353,2 355
10P motor	31,17 37	39,77 45	59,50 75	79,48 90	102,7 110	128,4 132	153,4 160	180,9 200
12P motor	18,04 18,5	23,01 30	34,44 37	45,99 55	59,44 75	74,30	88,76 90	104,7 110

Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet Lw(A) sound power levels for installation Type A: free inlet, free outlet.

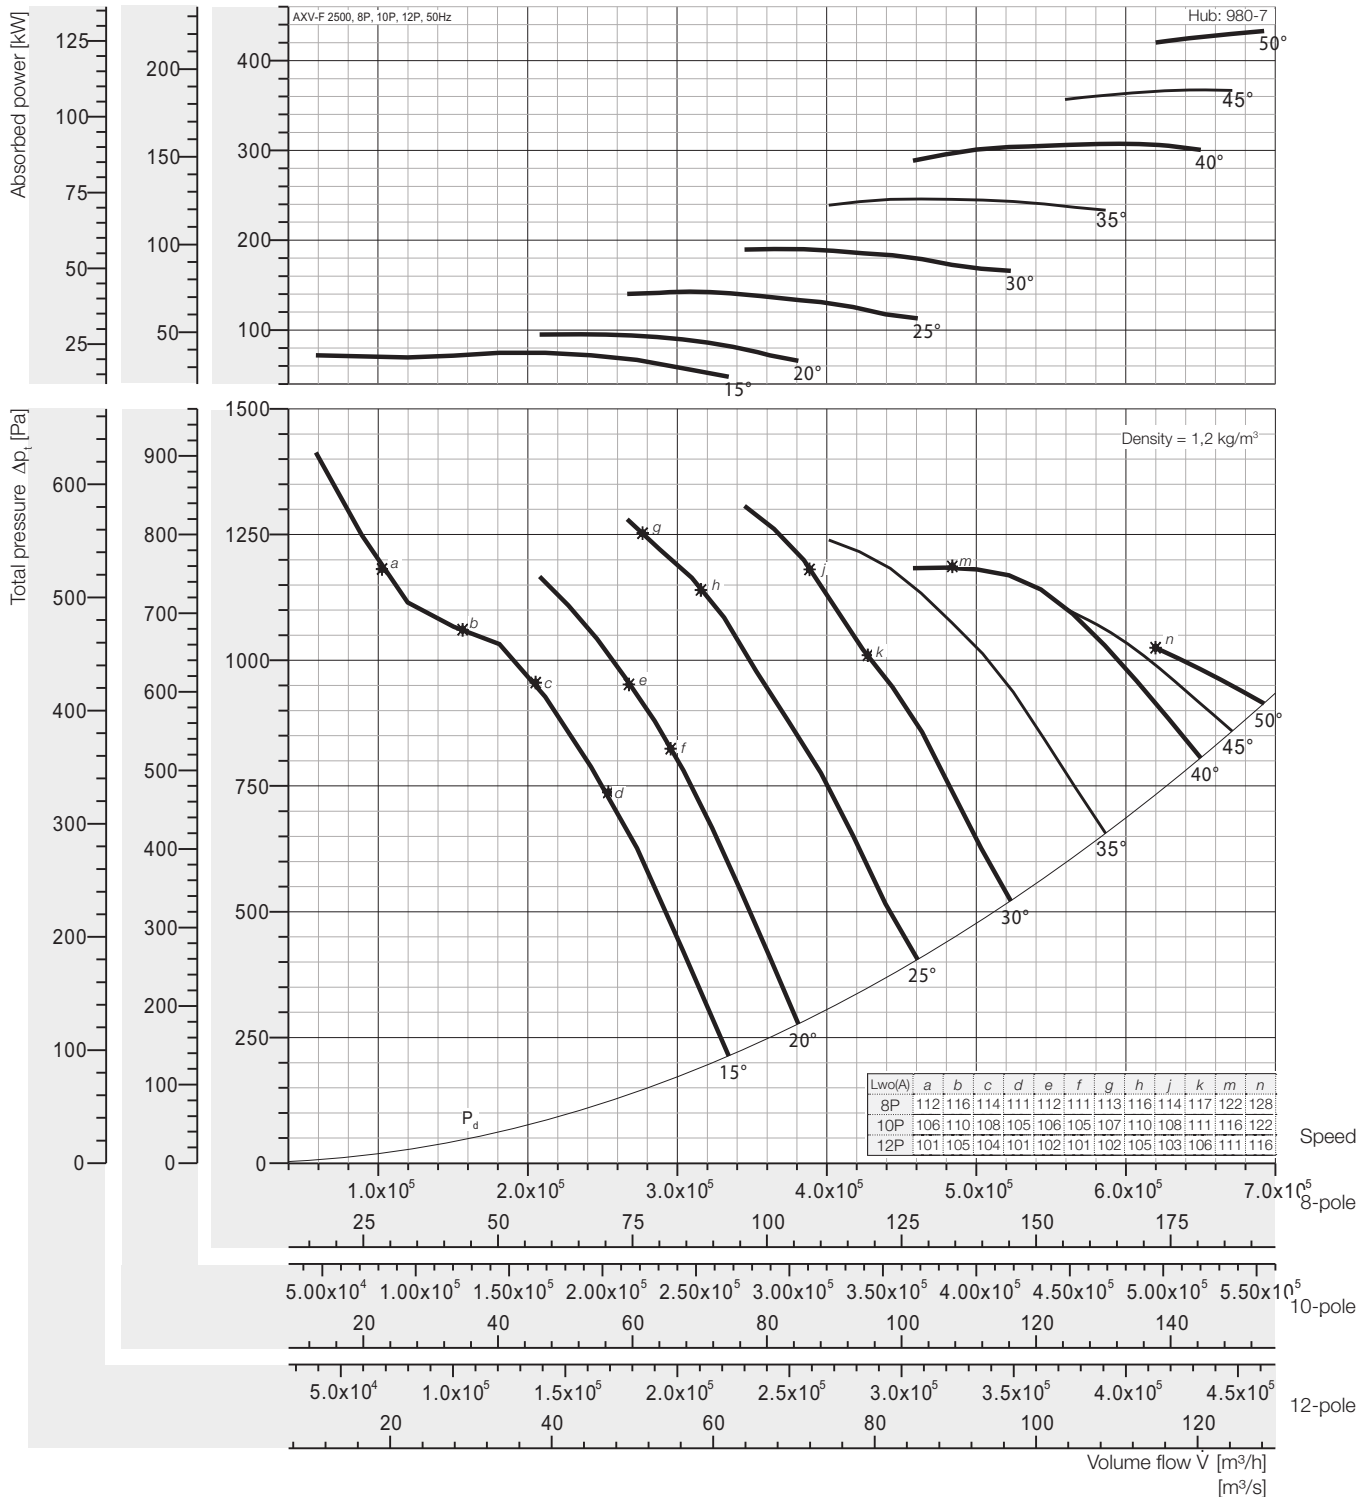

Peak absorbed power [kW]

8-pole = 750 rpm; 10-pole = 600 rpm; 12-pole = 500 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
8P motor	74,63	95,22	142,5	190,3	245,9	307,4	367,2	433,1
	75	110	160	200	250	315	400	450
10P motor	38,22	48,75	72,95	97,43	125,9	157,4	188,0	221,7
	45	55	75	110	132	160	200	250
12P motor	22,11	28,21	42,22	56,39	72,87	91,09	108,8	128,3
	30	45	75	110	132	160	200	250

Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.


The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet LwoA sound power levels for installation Type A: free inlet, free outlet.





# Performance Curve

## AXV-F 2600, 50 Hz

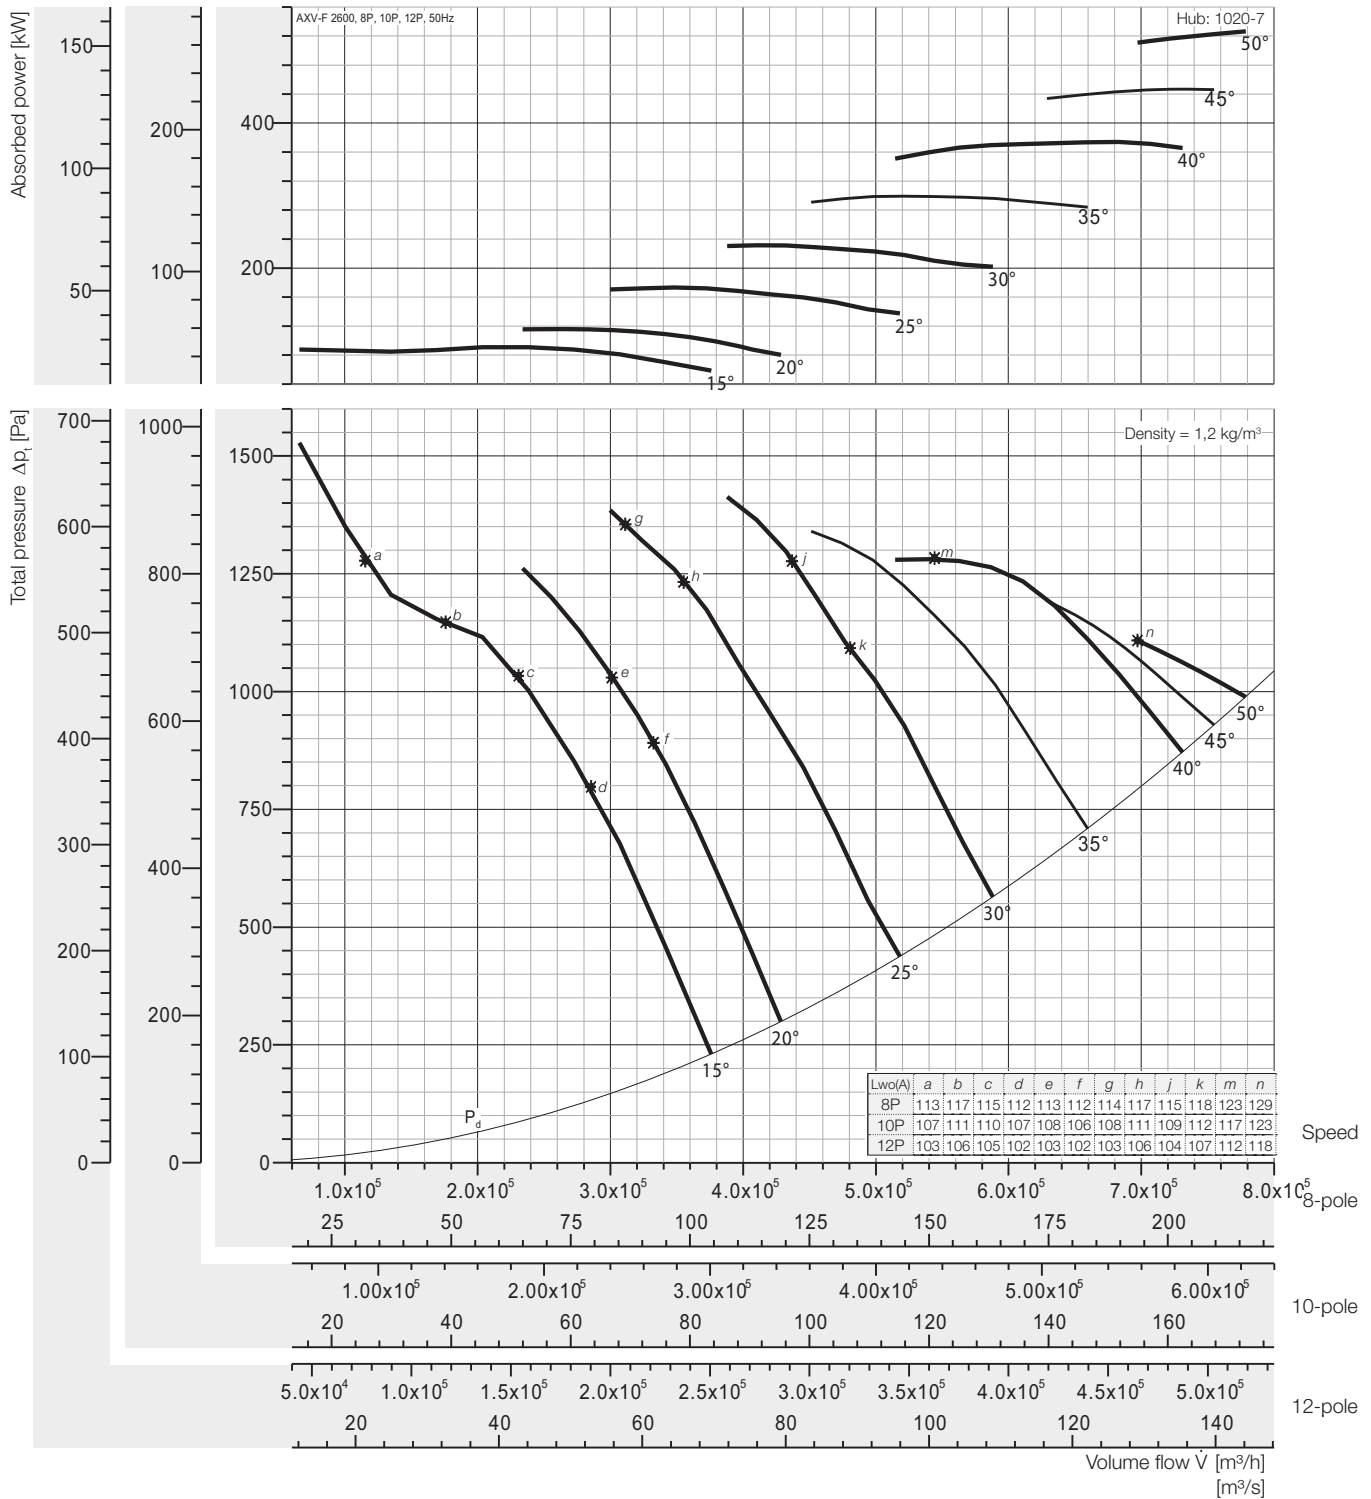


### Peak absorbed power [kW]

8-pole = 750 rpm; 10-pole = 600 rpm; 12-pole = 500 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
8P motor	90,76 110	115,8 132	173,3 200	231,4 250	299,1 315	373,9 400	446,6 450	526,7 560
10P motor	46,47 55	59,29 75	88,72 90	118,50 132	153,13 160	191,4 200	228,7 250	269,6 315
12P motor	26,89 30	34,31 37	51,34 55	68,58 75	88,62 90	110,8 132	132,3 160	156,0

Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet Lw(A) sound power levels for installation Type A: free inlet, free outlet.

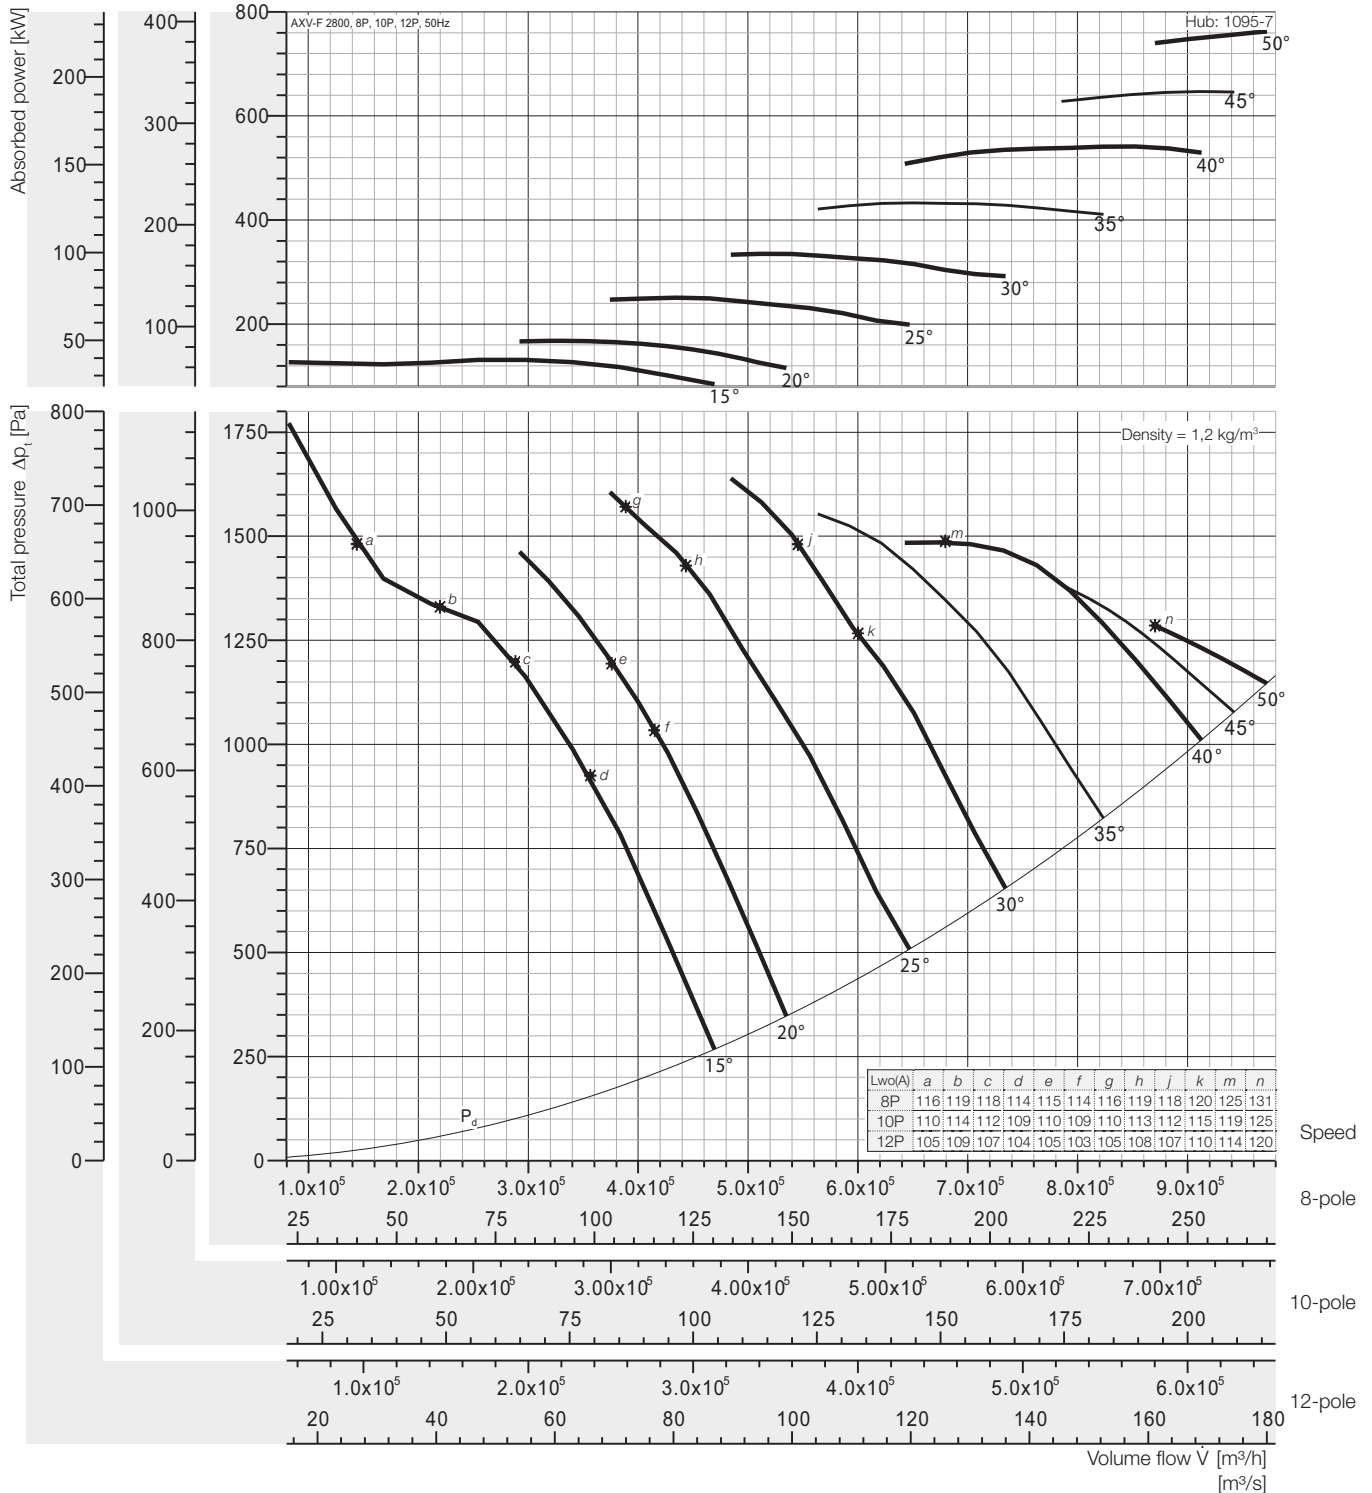

**Peak absorbed power [kW]**

8-pole = 750 rpm; 10-pole = 600 rpm; 12-pole = 500 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
8P motor	131,4 132	167,6 200	250,8 315	335,0 355	432,9 450	541,2 560	646,5 710	762,4 -
10P motor	67,26 75	85,82 90	128,4 132	171,5 200	221,7 250	277,1 315	331,0 355	390,3 400
12P motor	38,93 45	49,67 55	74,32 75	99,26 110	128,3 132	160,3 200	191,5 -	225,9 250

Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet LwoA sound power levels for installation Type A: free inlet, free outlet.

# AMCA - FEG rating


## Fan Efficiency Grade: AXV-F



Certified FEGs are determined in accordance with AMCA 205-12 Energy Efficiency Classification for fans. In conjunction with AMCA 211-13 (Rev. 2015) Certified Ratings Program, Product Rating Manual for Fan Air Performance. This classification is based on fan peak (optimum) total efficiency for a given fan speed, fan size and application category. For the purpose of energy classification, the peak efficiency can be determined at a speed not higher than the maximum design speed of the fan.

The AMCA Certified Ratings Seal applies to the Fan Efficiency Grade (FEG) for AXV-F series Axial Fan model AXV-F 500 to AXV-F 2800 as shown in the table below.


Fan Model No.	Fan Speed (rpm)	Fan Outlet Area (m <sup>2</sup> )	Fan Efficiency Grades	Fan Model No.	Fan Speed (rpm)	Fan Outlet Area (m <sup>2</sup> )	Fan Efficiency Grade
AXV-F 500	3600/1800/1200	0,1987	FEG 80	AXV-F 1400	1800/1200/900	1,5504	FEG 80
AXV-F 560	3600/1800/1200	0,2507	FEG 75	AXV-F 1600	1800/1200/900	2,0232	FEG 80
AXV-F 630	3600/1800/1200	0,3157	FEG 75	AXV-F 1800	1200/900/720	2,5588	FEG 80
AXV-F 710	3600/1800/1200	0,3970	FEG 75	AXV-F 2000	1200/900/720	3,1573	FEG 80
AXV-F 800	1800/1200/900	0,4989	FEG 75	AXV-F 2200	900/720/600	3,8186	FEG 80
AXV-F 900	1800/1200/900	0,6277	FEG 75	AXV-F 2400	900/720/600	4,5428	FEG 80
AXV-F 1000	1800/1200/900	0,7901	FEG 75	AXV-F 2500	900/720/600	4,9284	FEG 80
AXV-F 1120	1800/1200/900	0,9940	FEG 75	AXV-F 2600	900/720/600	5,3297	FEG 80
AXV-F 1250	1800/1200/900	1,2272	FEG 75	AXV-F 2800	900/720/600	6,1795	FEG 80

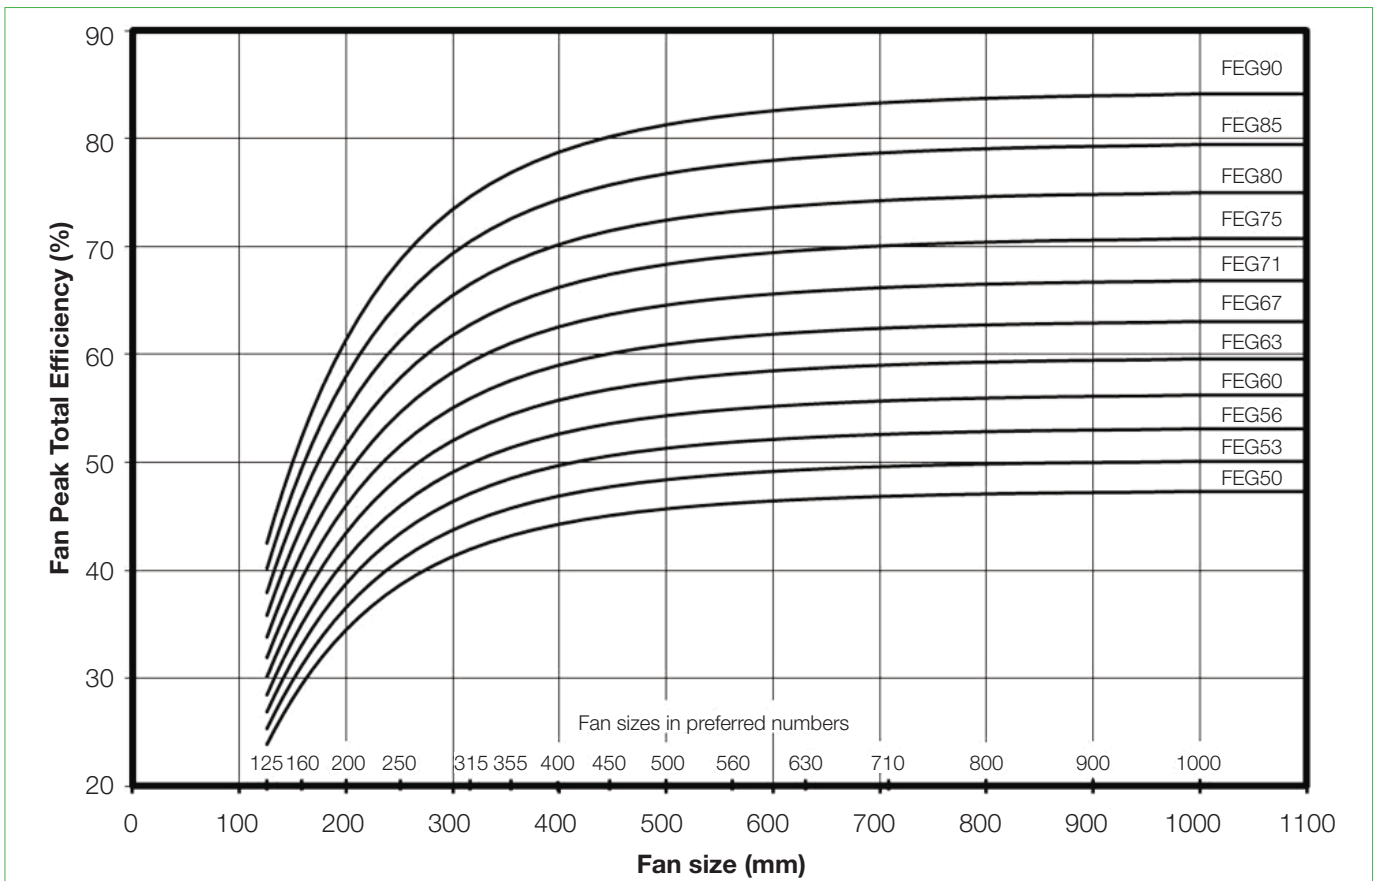



# Performance Curve

## AXV-F 500, 60 Hz

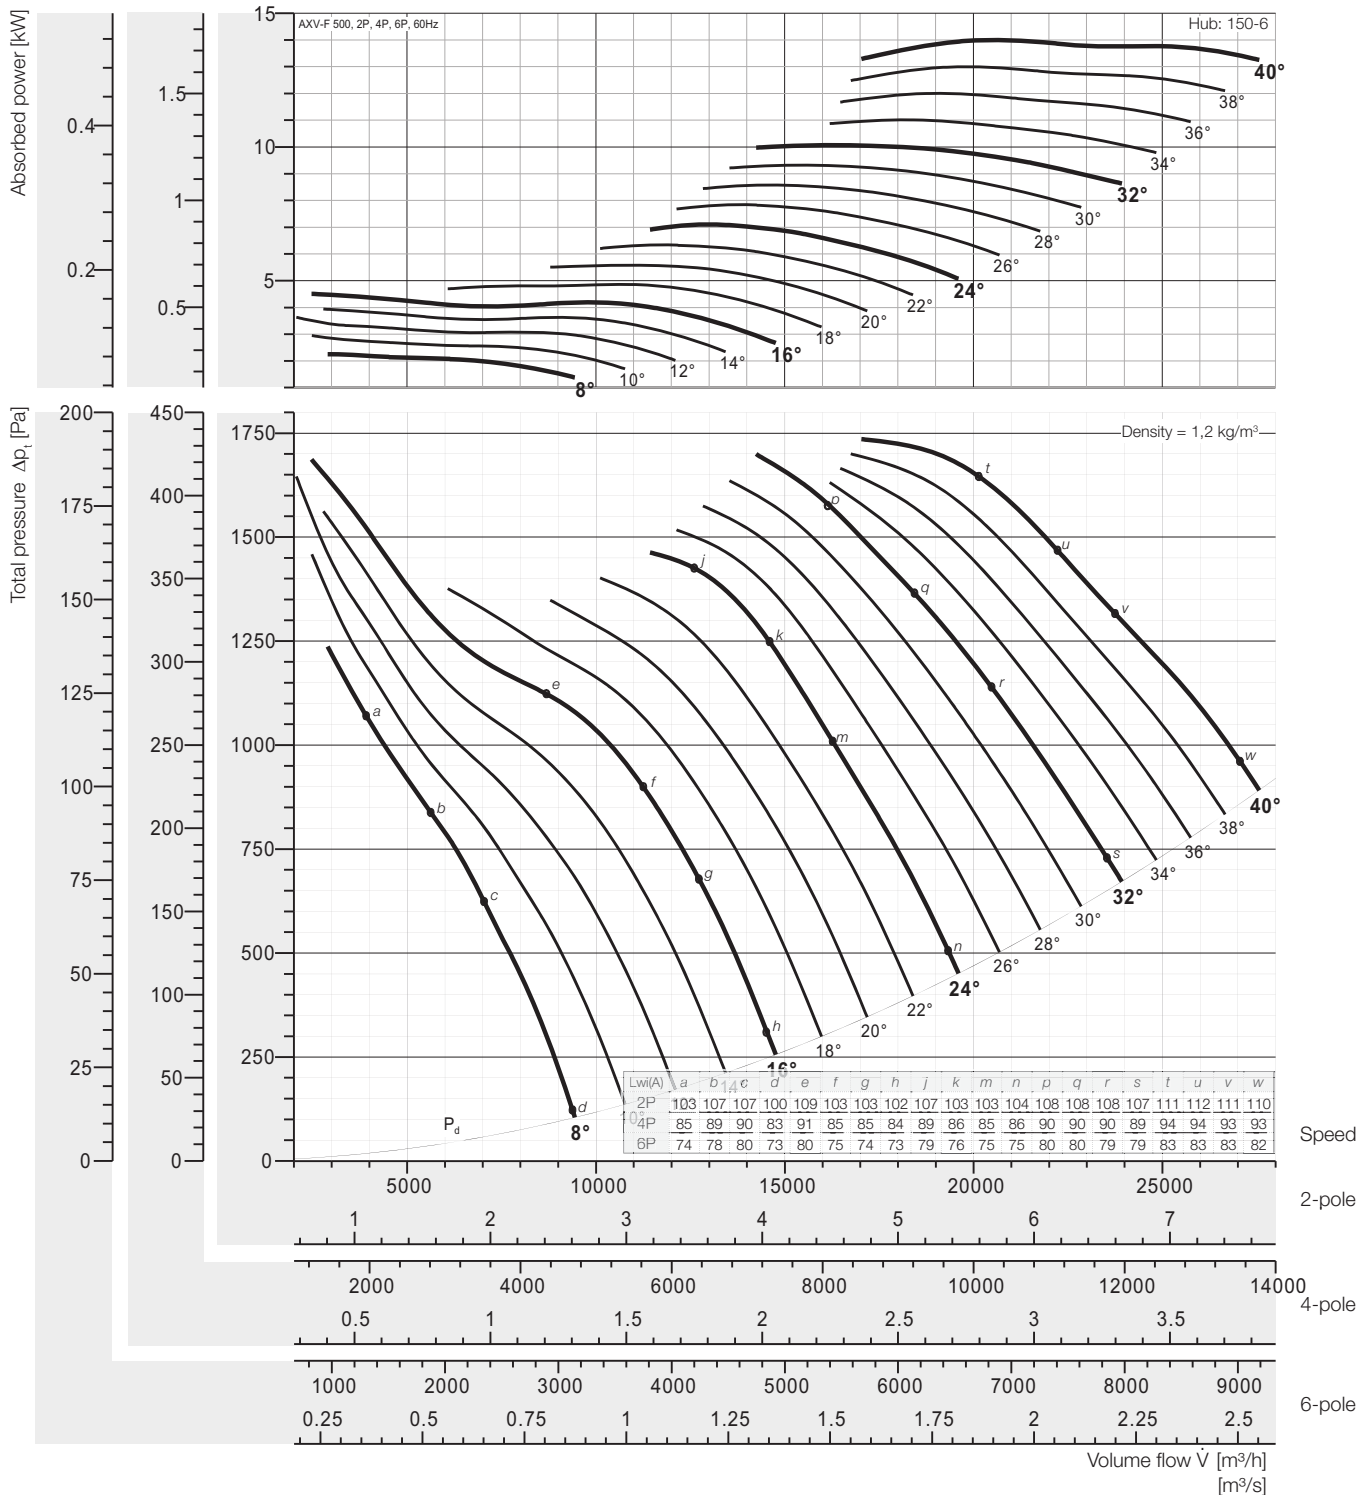

### Peak absorbed power [kW]

2-pole = 3600 rpm; 4-pole = 1800 rpm; 6-pole = 1200 rpm;

N Poles	Pitch angle [°]																
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
2P motor	2,251	2,943	3,634	3,936	4,511	4,859	5,572	6,333	7,099	7,839	8,580	9,322	10,06	11,01	12,00	13,00	14,00
	3,0		4,0		-*												
4P motor	0,281	0,368	0,454	0,492	0,564	0,607	0,696	0,792	0,887	0,980	1,072	1,165	1,258	1,376	1,500	1,625	1,749
	0,37		0,55		0,75			1,1				1,5				2,2	
6P motor	0,083	0,109	0,135	0,146	0,167	0,180	0,206	0,235	0,263	0,290	0,318	0,345	0,373	0,408	0,445	0,481	0,518
	0,25								0,37				0,55				


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 560, 60 Hz

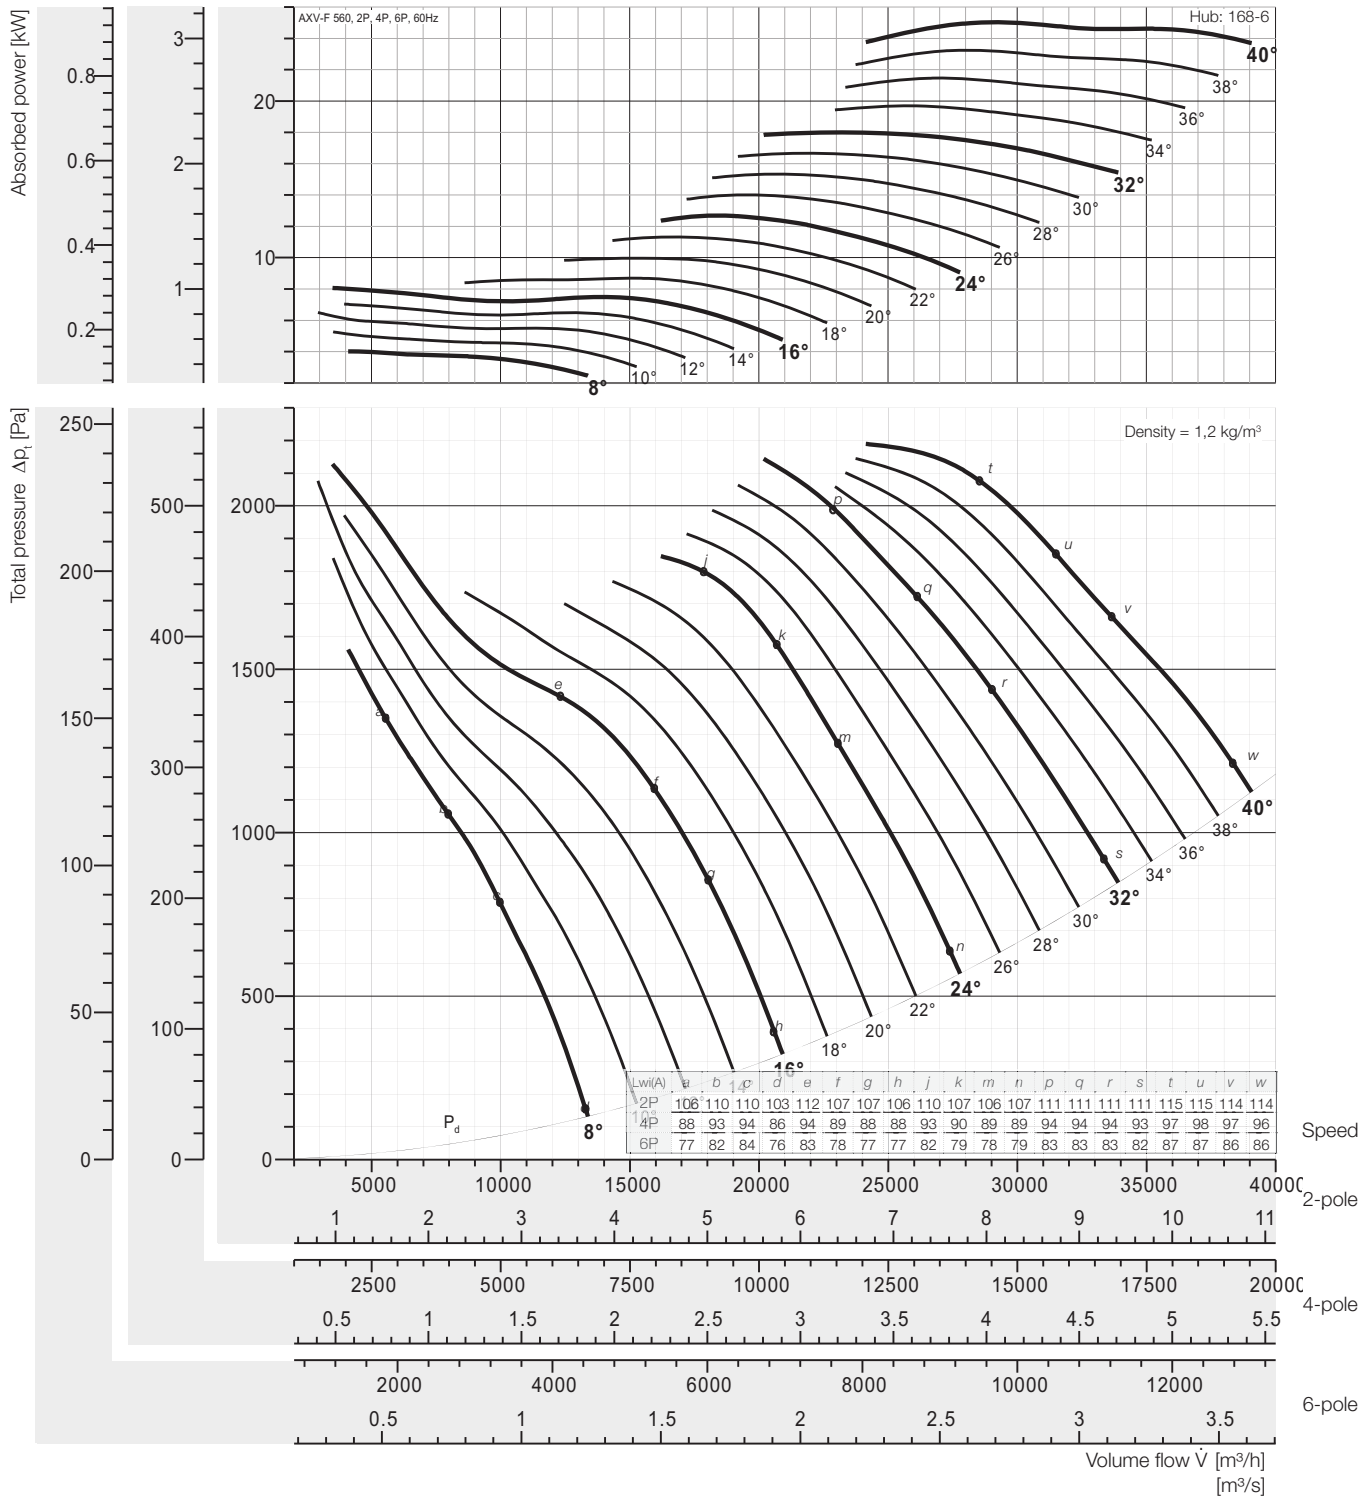

### Peak absorbed power [kW]

2-pole = 3600 rpm; 4-pole = 1800 rpm; 6-pole = 1200 rpm;

N Poles	Pitch angle [°]																
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
2P motor	4,024	5,261	6,499	7,037	8,065	8,689	9,962	11,32	12,69	14,02	15,34	16,67	18,00	19,69	2,146	23,24	25,03
4P motor	0,503	0,658	0,812	0,880	1,008	1,086	1,245	1,415	1,587	1,752	1,918	2,084	2,250	2,461	2,682	2,905	3,128
6P motor	0,149	0,195	0,241	0,261	0,299	0,322	0,369	0,419	0,470	0,519	0,568	0,617	0,667	0,729	0,795	0,861	0,927


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 630, 60 Hz

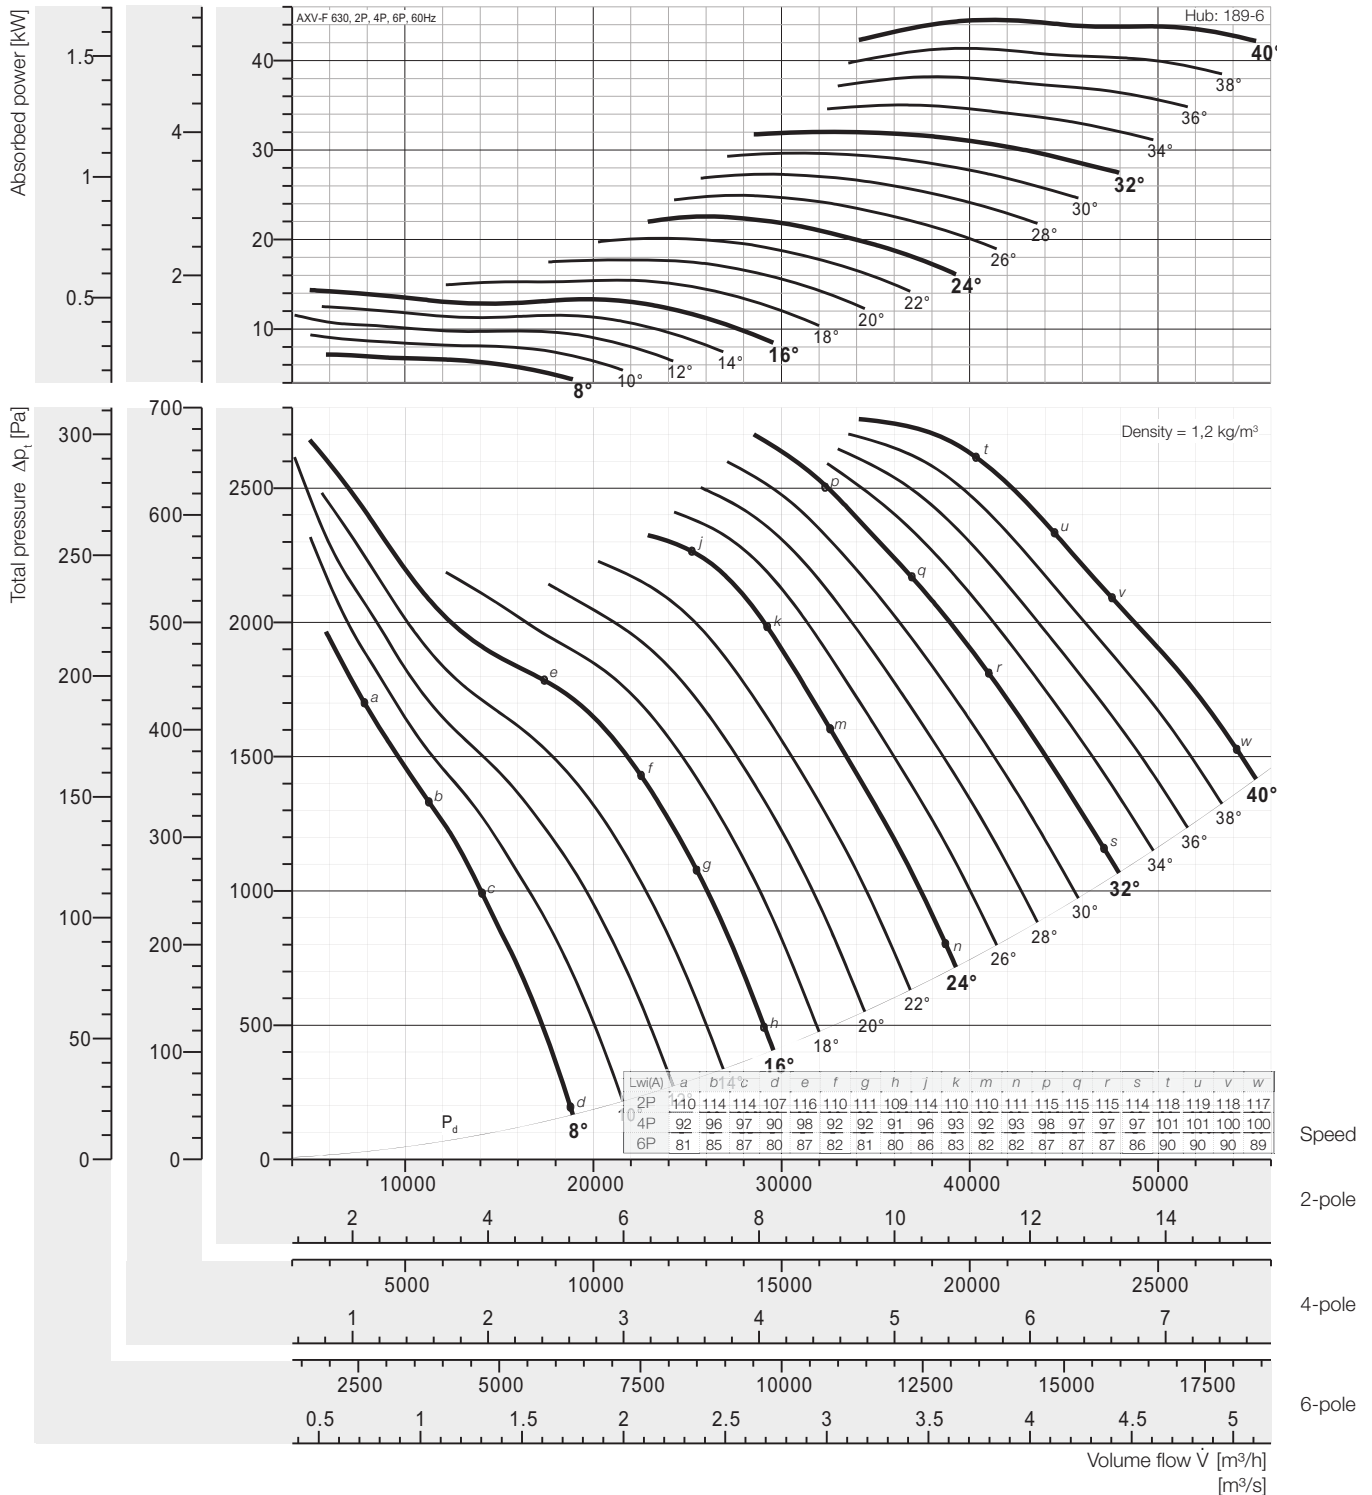

### Peak absorbed power [kW]

2-pole = 3600 rpm; 4-pole = 1800 rpm; 6-pole = 1200 rpm;

N Poles	Pitch angle [°]																
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
2P motor	7,163	9,364	11,57	12,53	14,36	15,46	17,73	20,15	22,59	24,95	27,31	29,67	32,03	35,04	38,19	41,36	44,54
4P motor	0,895	1,171	1,446	1,566	1,794	1,933	2,216	2,519	2,824	3,118	3,413	3,708	4,004	4,038	4,774	5,170	5,568
6P motor	0,265	0,347	0,428	0,464	0,532	0,573	0,657	0,746	0,837	0,924	1,011	1,099	1,186	1,298	1,415	1,532	1,650

Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.


The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.





# Performance Curve

## AXV-F 710, 60 Hz

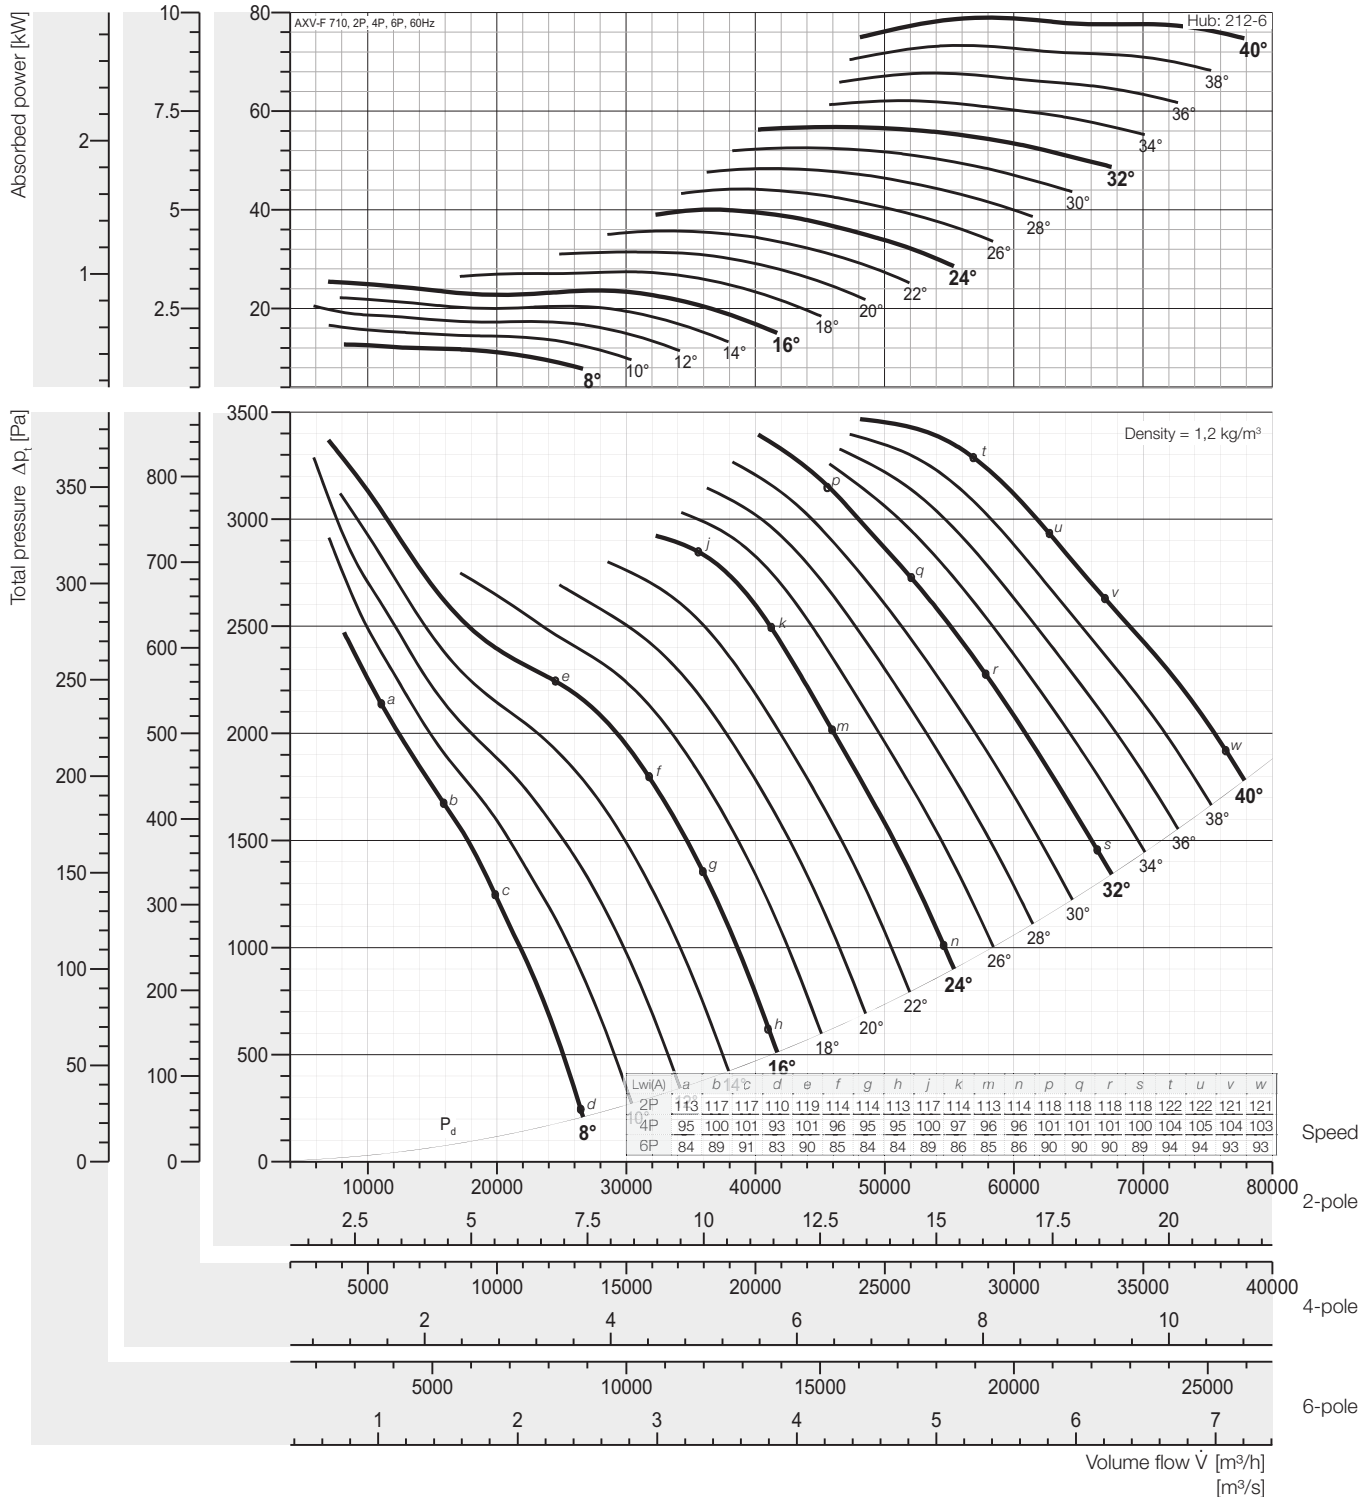

### Peak absorbed power [kW]

2-pole = 3600 rpm; 4-pole = 1800 rpm; 6-pole = 1200 rpm;

N Poles	Pitch angle [°]																
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
2P motor	12,70	16,60	20,50	22,20	25,45	27,41	31,43	35,72	40,05	44,,22	48,40	52,59	56,78	62,12	67,71	73,32	78,95
	15	18,5	22	-*													
4P motor	1,587	2,075	2,563	2,775	3,181	3,427	3,929	4,465	5,006	5,527	6,050	6,574	7,098	7,765	8,463	9,165	9,87
	2,2		3,0		4,0			5,5		7,5				11			
6P motor	0,470	0,615	0,759	0,822	0,942	1,015	1,164	1,323	1,483	1,638	1,793	1,948	2,103	2,301	2,508	2,716	2,92
	0,55	0,75	1,1				1,5			2,2				3,0			

Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.


The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.





# Performance Curve

## AXV-F 800, 60 Hz

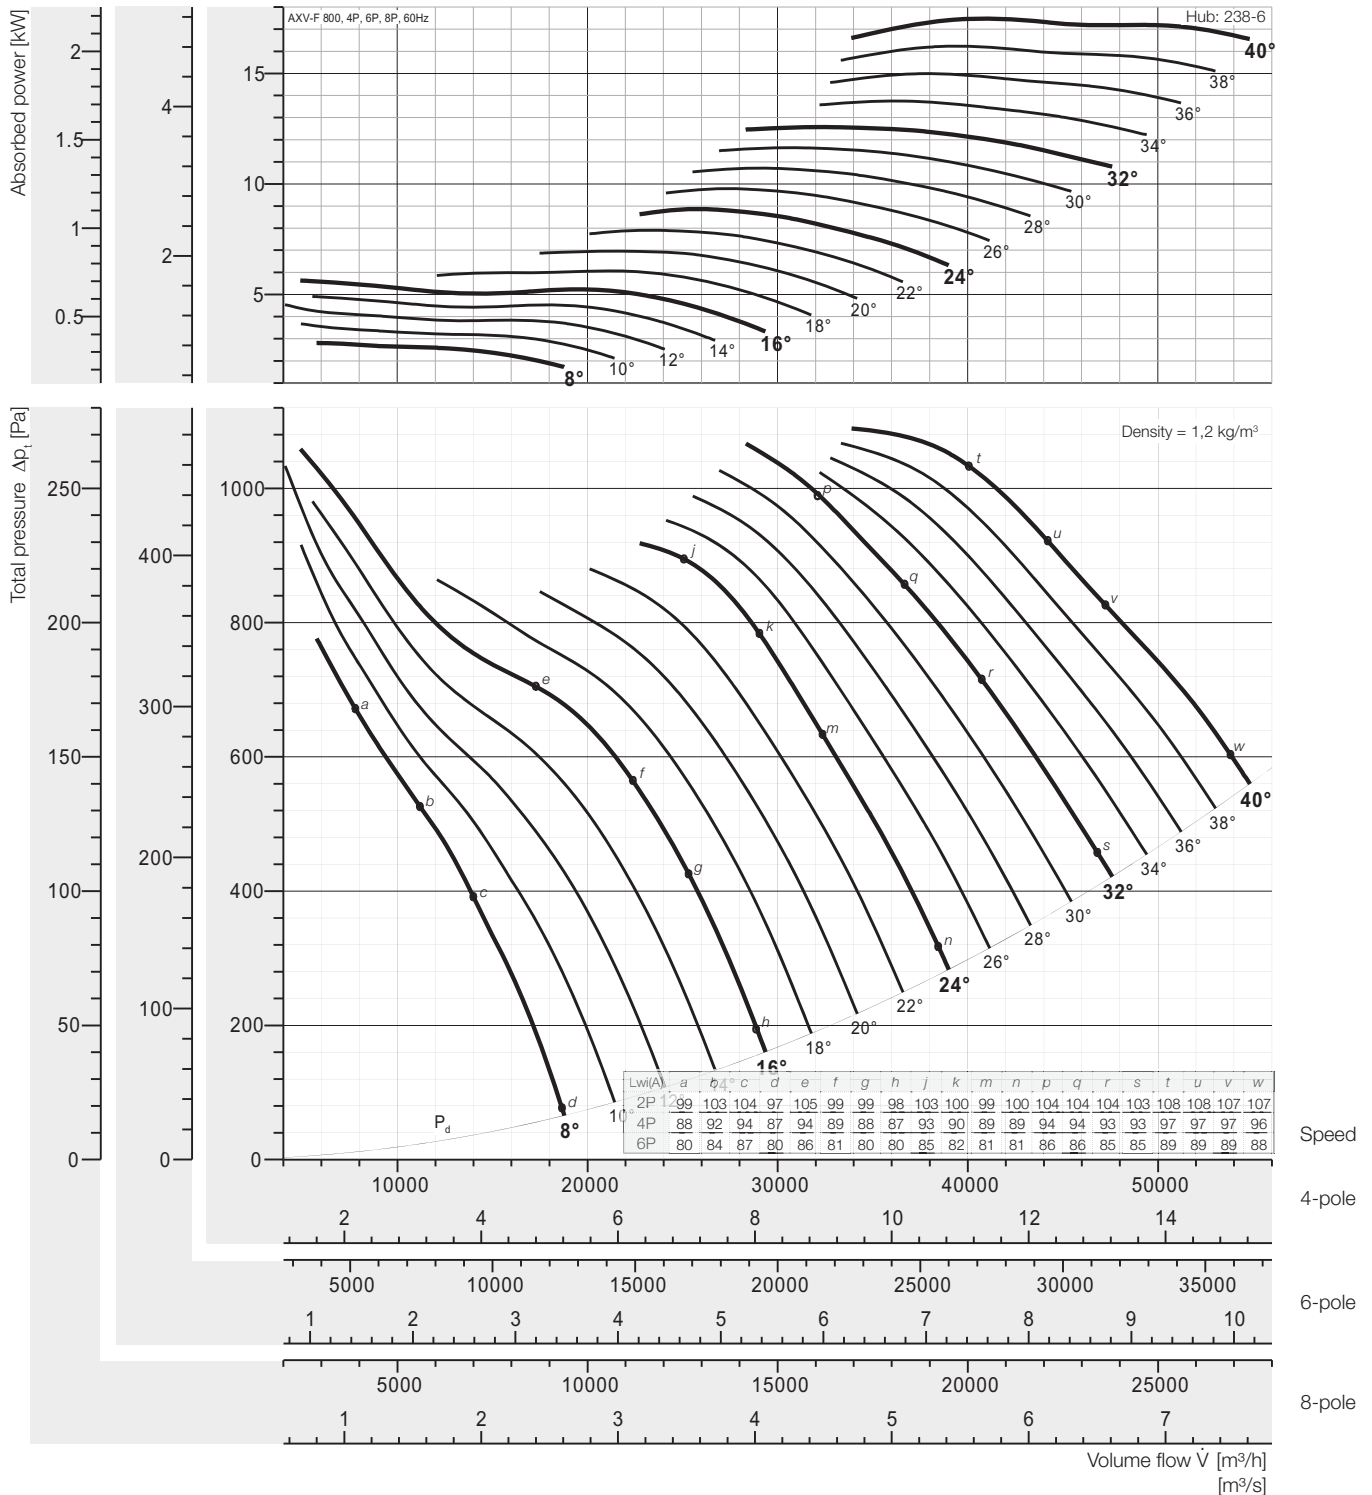

### Peak absorbed power [kW]

4-pole = 1800 rpm; 6-pole = 1200 rpm; 8-pole = 900 rpm;

N Poles	Pitch angle [°]																
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
4P motor	2,810	3,674	4,538	4,915	5,633	6,068	6,957	7,908	8,864	9,788	10,71	11,64	12,57	13,75	14,99	16,23	17,48
6P motor	0,833	1,089	1,345	1,456	1,669	1,798	2,061	2,343	2,626	2,900	3,175	3,449	3,724	4,074	4,441	4,809	5,178
8P motor	0,351	0,459	0,567	0,614	0,704	0,759	0,870	0,988	1,108	1,224	1,339	1,455	1,571	1,719	1,873	2,029	2,185


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 900, 60 Hz

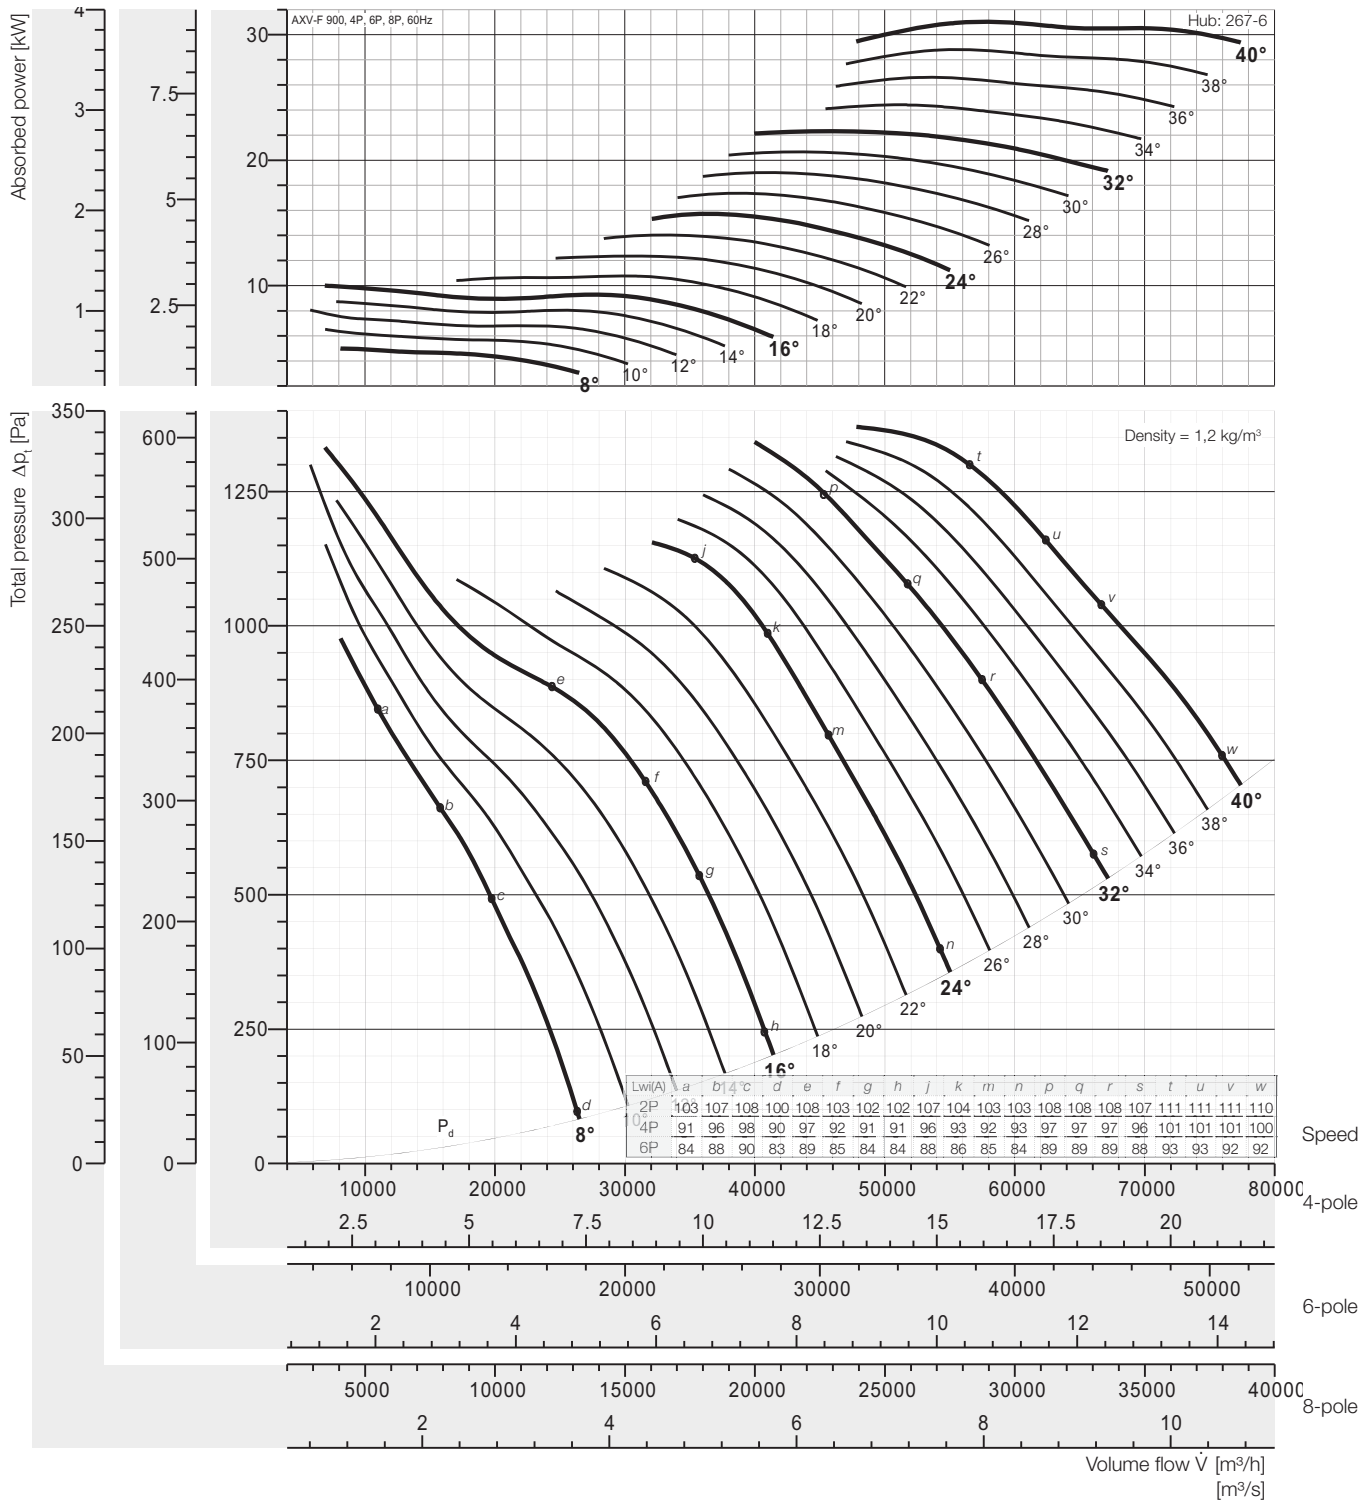

### Peak absorbed power [kW]

4-pole = 1800 rpm; 6-pole = 1200 rpm; 8-pole = 900 rpm;

N Poles	Pitch angle [°]																				
	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40				
4P motor	4,990	6,524	8,058	8,726	10,00	10,77	12,35	14,04	15,74	17,38	19,02	20,67	22,32	24,41	26,61	28,82	31,03				
6P motor	1,478	1,933	2,388	2,585	2,963	3,192	3,660	4,160	4,663	5,149	5,636	6,124	6,612	7,234	7,884	8,538	9,194				
8P motor	0,624	0,815	1,007	1,091	1,250	1,347	1,544	1,755	1,967	2,172	2,378	2,584	2,789	3,052	3,326	3,602	3,879				


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 1000, 50 Hz

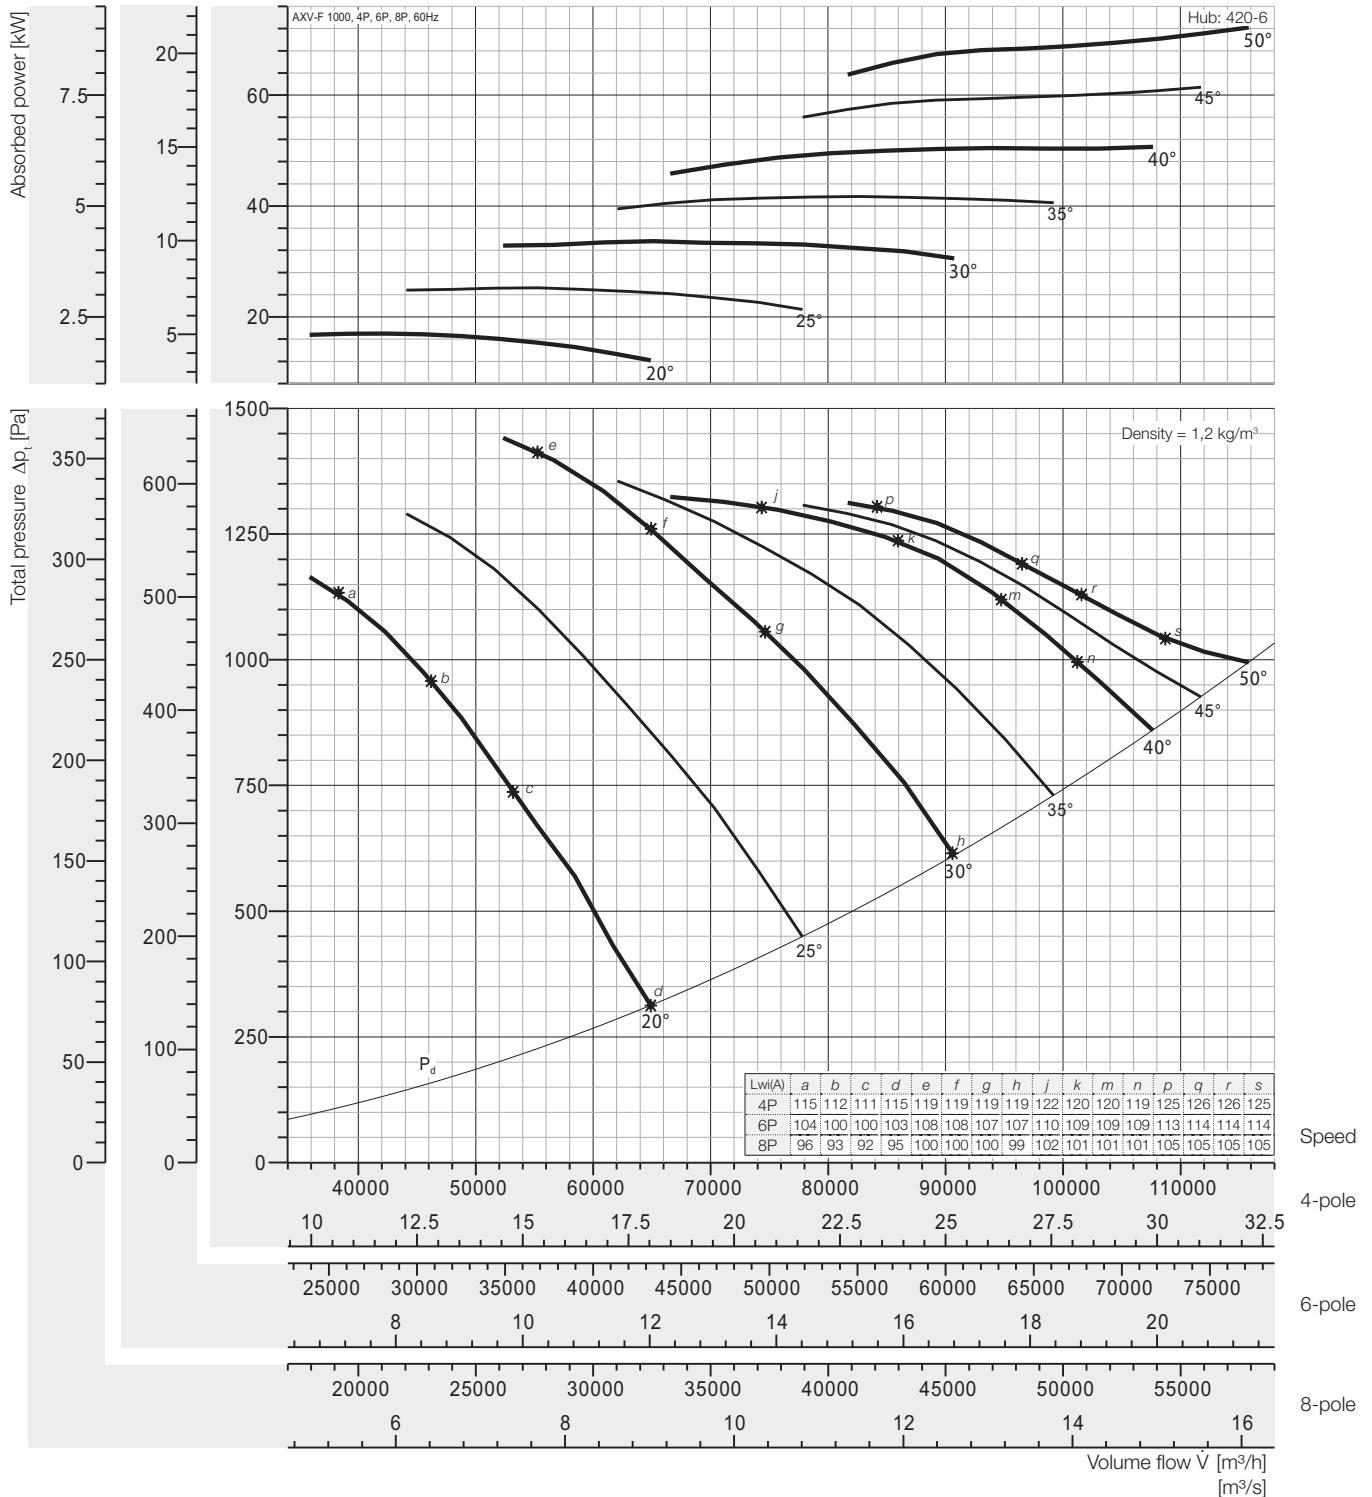

### Peak absorbed power [kW]

4-pole = 1800 rpm; 6-pole = 1200 rpm; 8-pole = 900 rpm;

N Poles	Pitch angle [°]						
	20	25	30	35	40	45	50
4P motor	17,03	25,25	33,68	41,75	50,67	61,43	72,19
	18,5	30	37	45	55	75	
6P motor	5,045	7,482	9,980	12,37	15,01	18,20	21,39
	5,5	7,5	11	15	18,5		22
8P motor	2,128	3,156	4,210	5,219	6,333	7,678	9,023
	2,2	4	5,5		7,5	11	


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 1120, 60 Hz

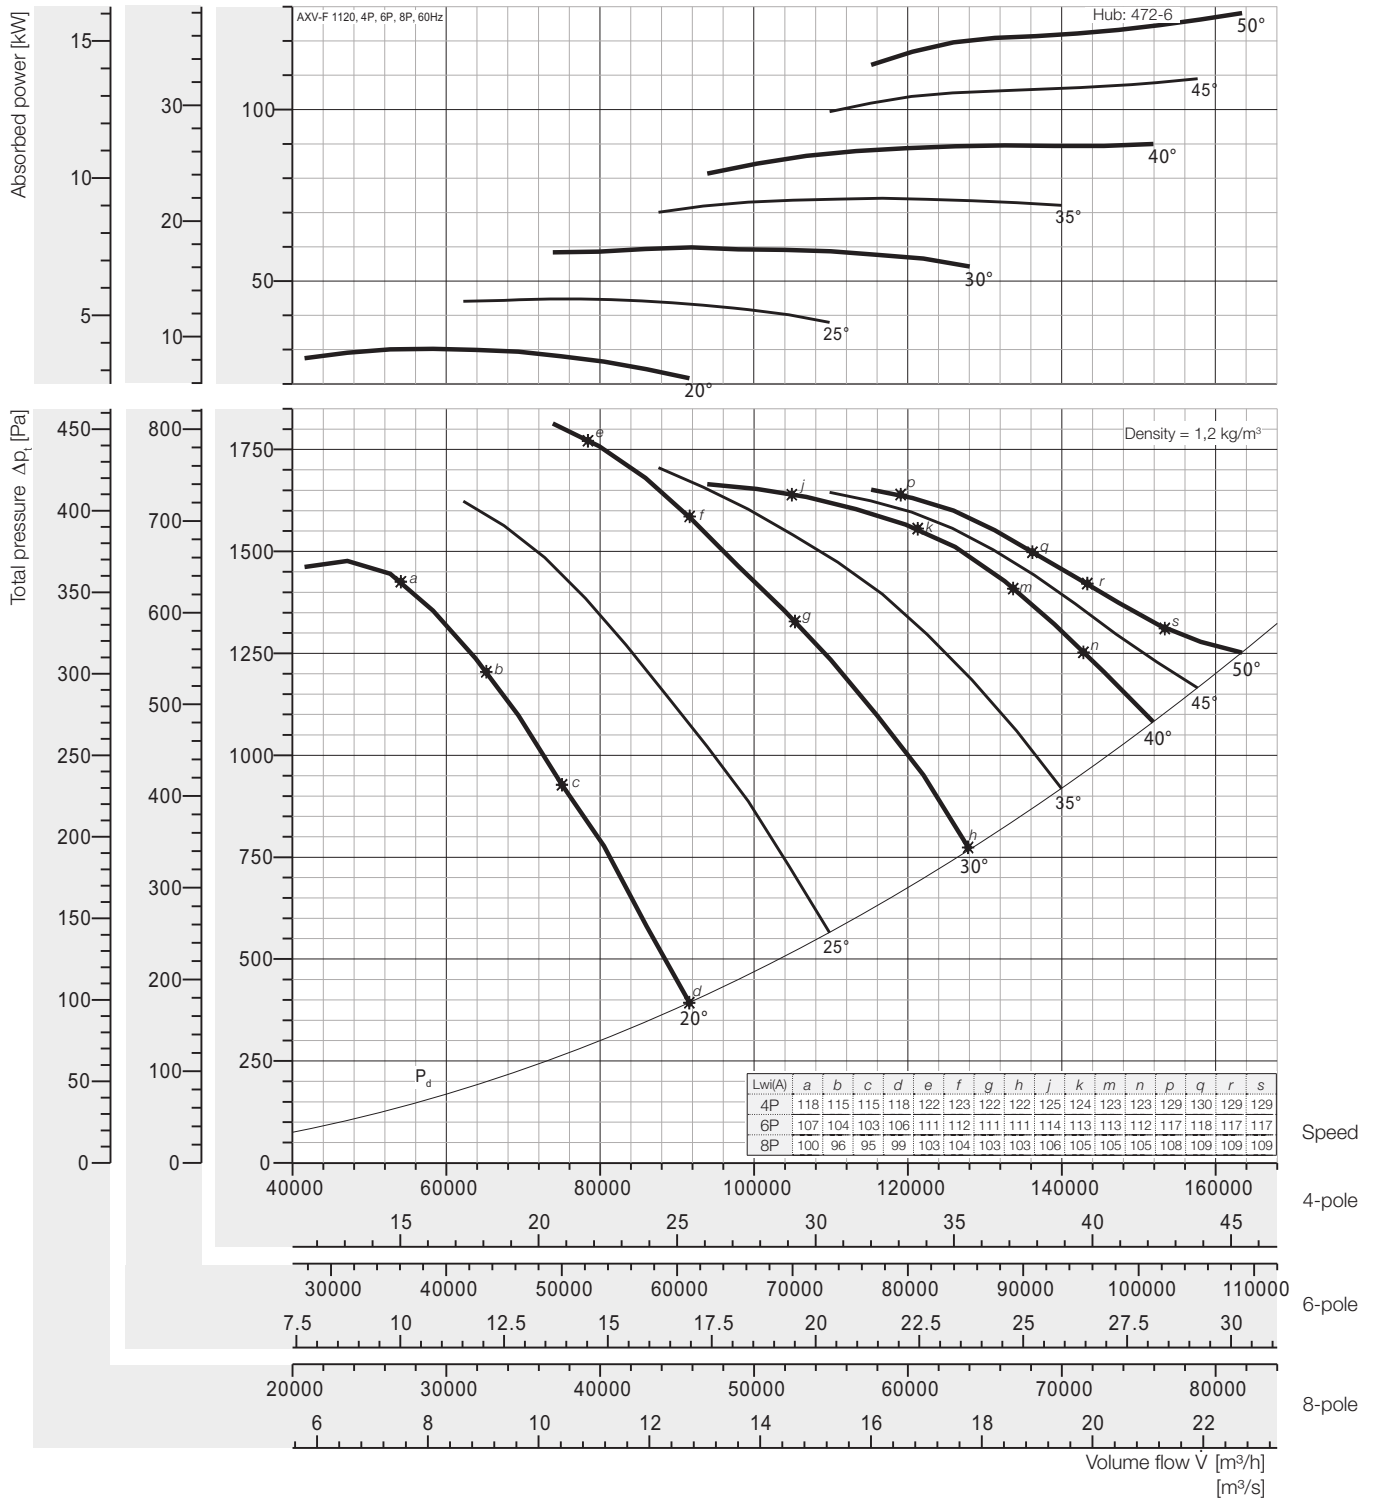

### Peak absorbed power [kW]

4-pole = 1800 rpm; 6-pole = 1200 rpm; 8-pole = 900 rpm;

N Poles	Pitch angle [°]						
	20	25	30	35	40	45	50
4P motor	30,25	44,83	59,80	74,12	89,94	109,0	128,1
	37	45	75		90	110	132
6P motor	8,964	13,28	17,72	21,96	26,65	32,31	37,97
	11	15	18,5	22	30	37	45
8P motor	3,782	5,603	7,475	9,265	11,24	13,63	16,02
	4	7,5		11	15		18,5


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 1250, 60 Hz

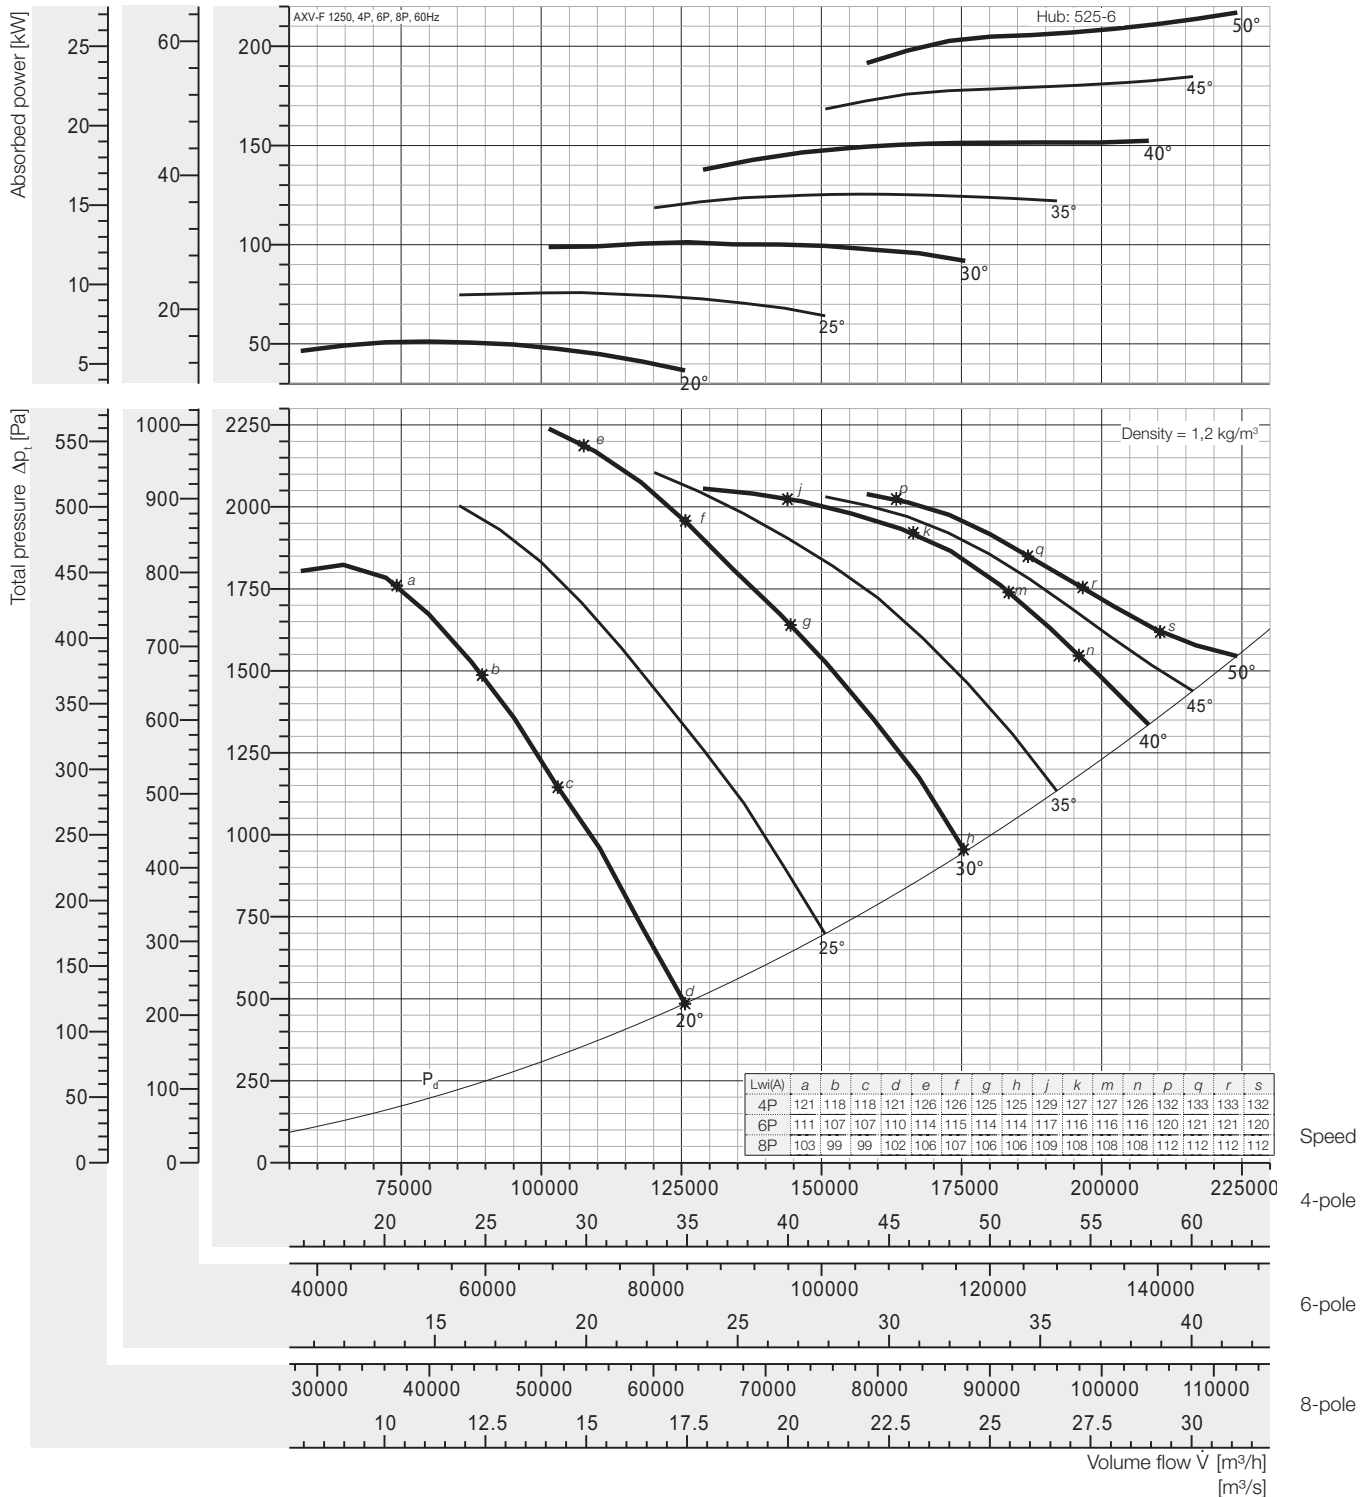

### Peak absorbed power [kW]

4-pole = 1800 rpm; 6-pole = 1200 rpm; 8-pole = 900 rpm;

N Poles	Pitch angle [°]						
	20	25	30	35	40	45	50
4P motor	51,23 55	75,91 90	101,3 -	125,5 -	152,3 -	184,7 -	217,0 -
6P motor	15,18 18,5	22,49 30	30,00	37,19 45	45,13 55	54,72	64,30 75
8P motor	6,404 7,5	9,489 11	12,66 15	15,69 18,5	19,04 22	23,08 30	27,13


Fan test laboratory AMCA 210/99 Fig.12, Test Chamber. Performance certified is for installation type D - Ducted inlet, Ducted outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for inlet Lw(A) sound power levels for installation Type D: ducted inlet, ducted outlet. Ratings include the effects of duct end correction.



# Performance Curve

## AXV-F 1400, 60 Hz

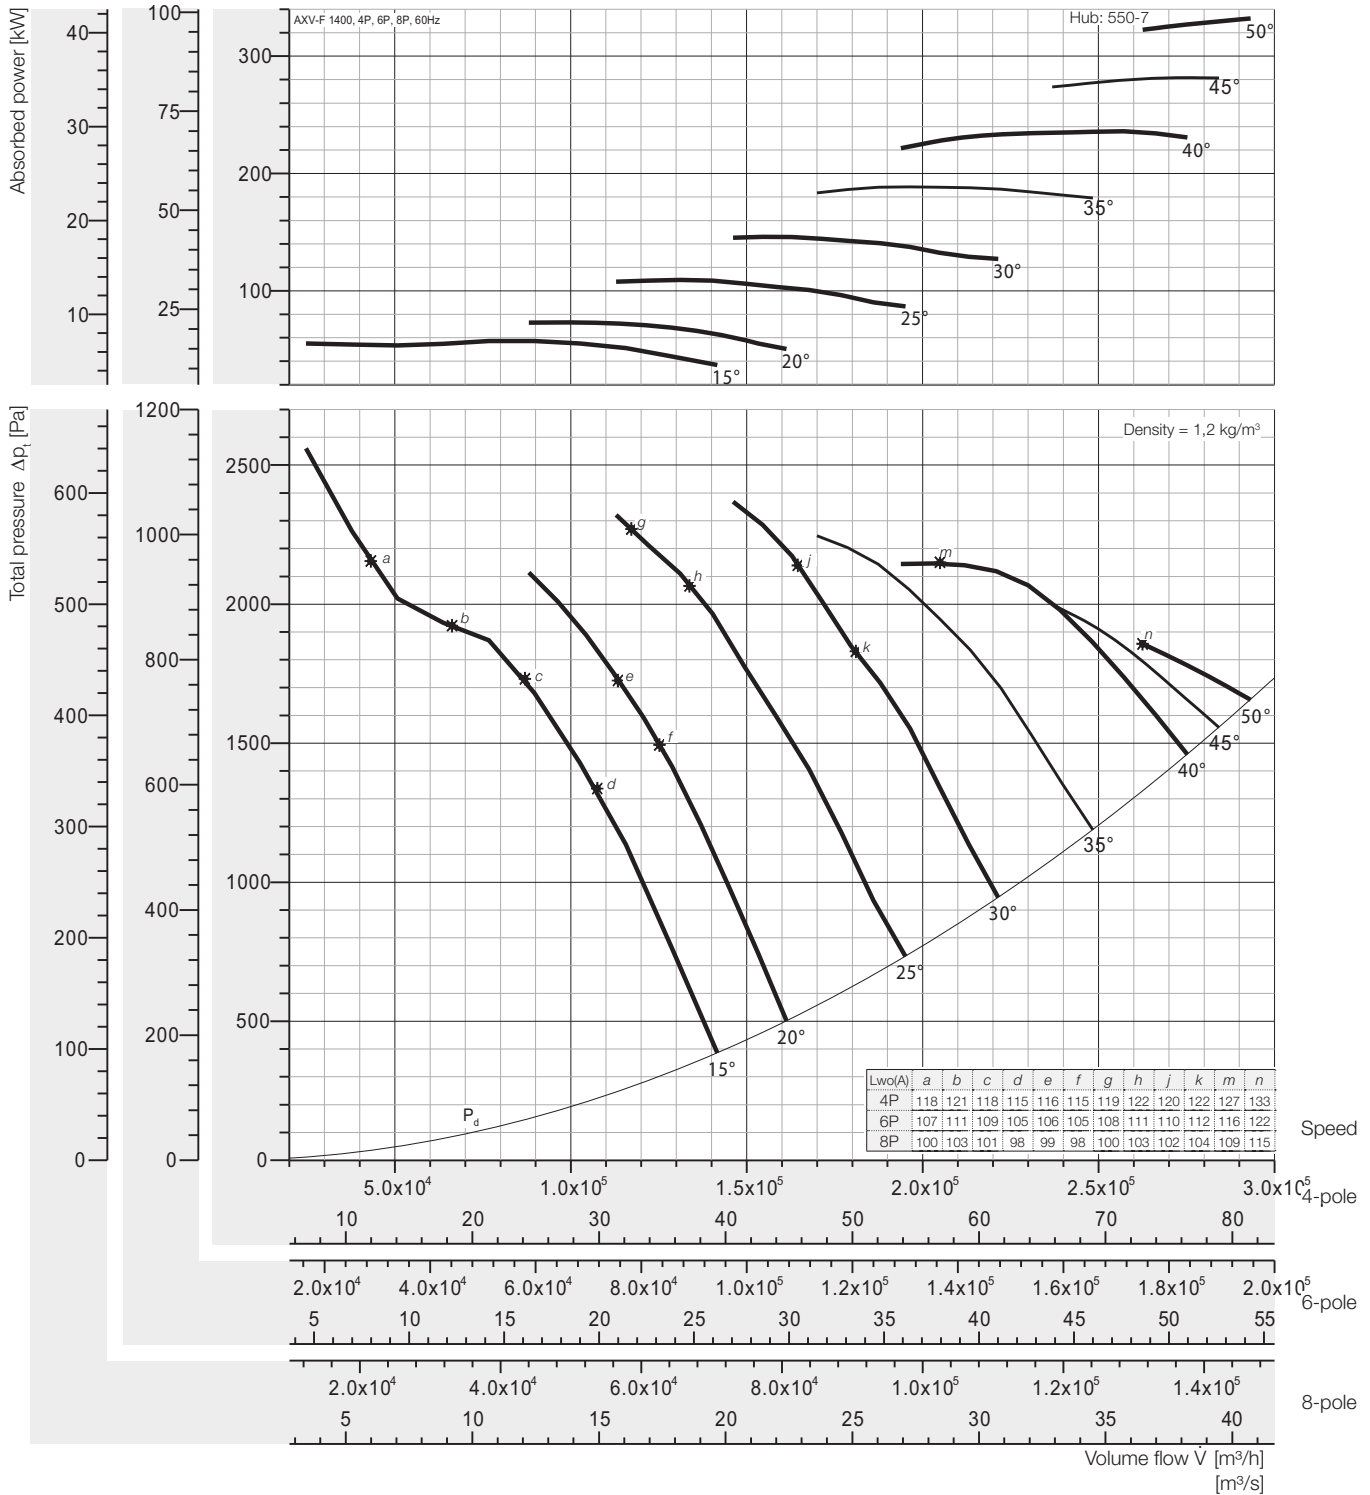


### Peak absorbed power [kW]

4-pole = 1800 rpm; 6-pole = 1200 rpm; 8-pole = 900 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
4P motor	57,26	73,06	109,3	146,0	188,7	235,9	281,8	332,3
	75		110	160	200	250	315	355
6P motor	16,97	21,65	32,39	43,27	55,91	69,89	83,49	98,46
	18,5	22	37	45	75		90	110
8P motor	7,158	9,133	13,67	18,25	23,59	29,49	35,22	41,54
	7,5	11	15	18,5	30		37	45

Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet LwoA sound power levels for installation Type A: free inlet, free outlet.

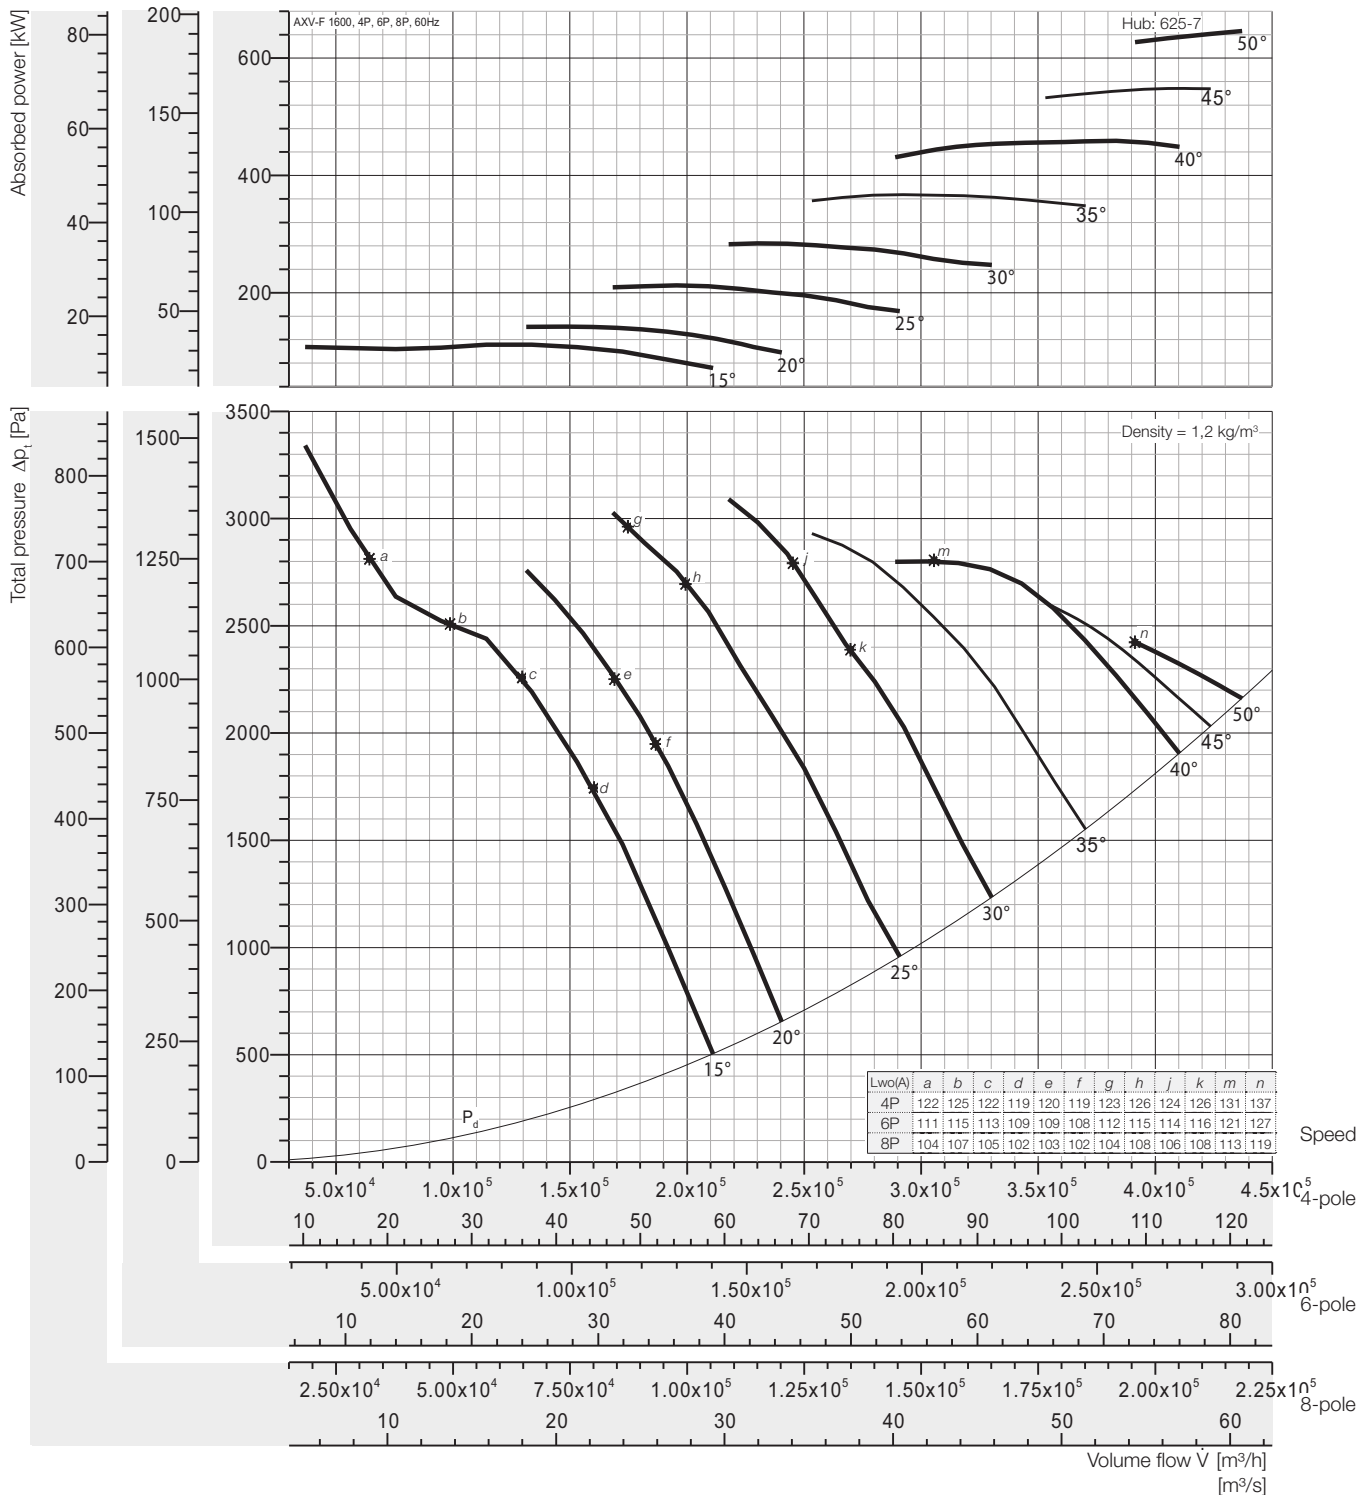

Peak absorbed power [kW]

4-pole = 1800 rpm; 6-pole = 1200 rpm; 8-pole = 900 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
4P	111,4	142,1	212,7	284,1	367,1	458,9	548,2	646,4
motor	132	160	250	315	400	-	-	-
6P	33,01	42,11	63,01	84,17	108,8	136,0	162,4	191,5
motor	37	45	75	90	110	160	200	
8P	13,92	17,77	26,58	35,51	45,89	57,36	68,52	80,80
motor	15	18,5	30	37	55	75		90

Fan test laboratory AMCA 210/99 Fig. 15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.


The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet LwoA sound power levels for installation Type A: free inlet, free outlet.





# Performance Curve

## AXV-F 1800, 60 Hz

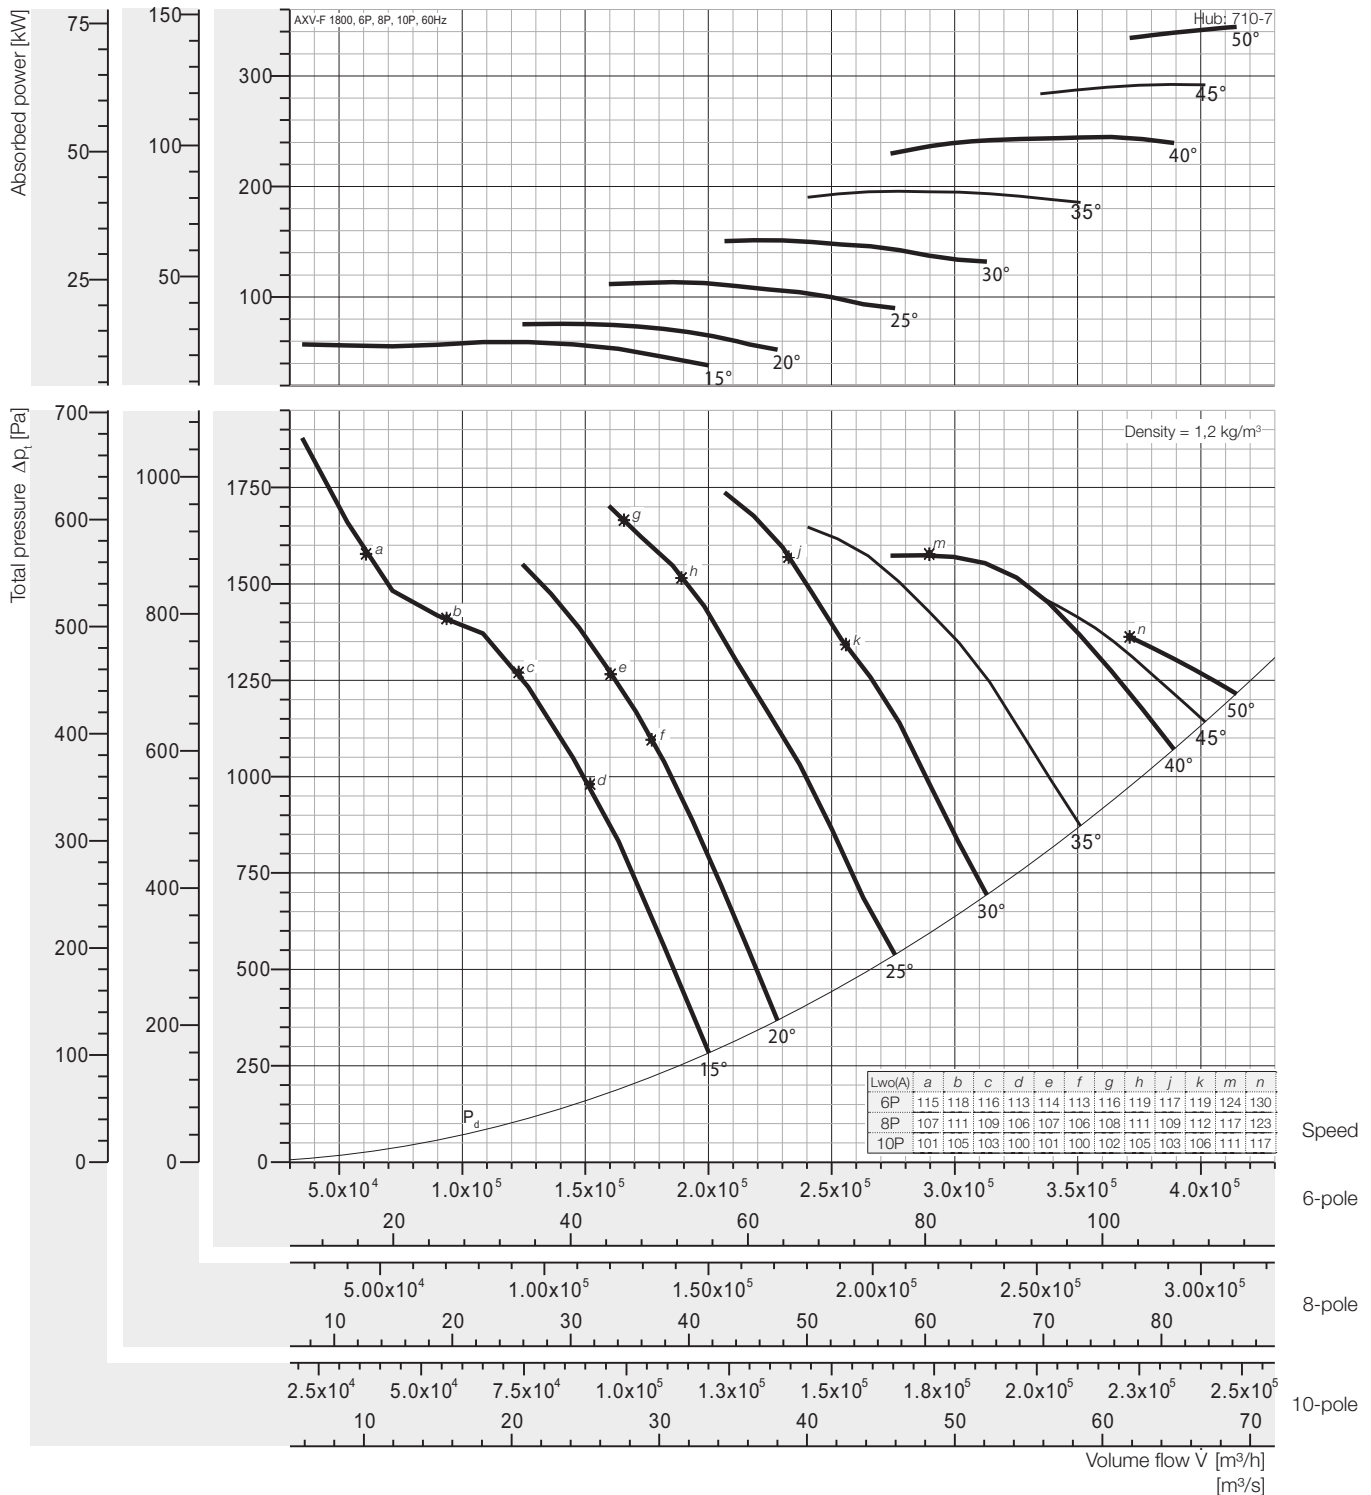


### Peak absorbed power [kW]

6-pole = 1200 rpm; 8-pole = 900 rpm; 10-pole = 720 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
6P motor	59,37 75	75,76 90	113,3 132	151,4 160	195,7 200	244,6 250	292,2 315	344,5 -
8P motor	25,05 30	31,96 37	47,82 55	63,88 75	82,55 90	103,2 110	123,3 132	145,3 160
10P motor	12,82 15	16,36 18,5	24,49 30	32,70 37	42,26 45	52,83 55	63,11 75	74,42

Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet Lw0A sound power levels for installation Type A: free inlet, free outlet.

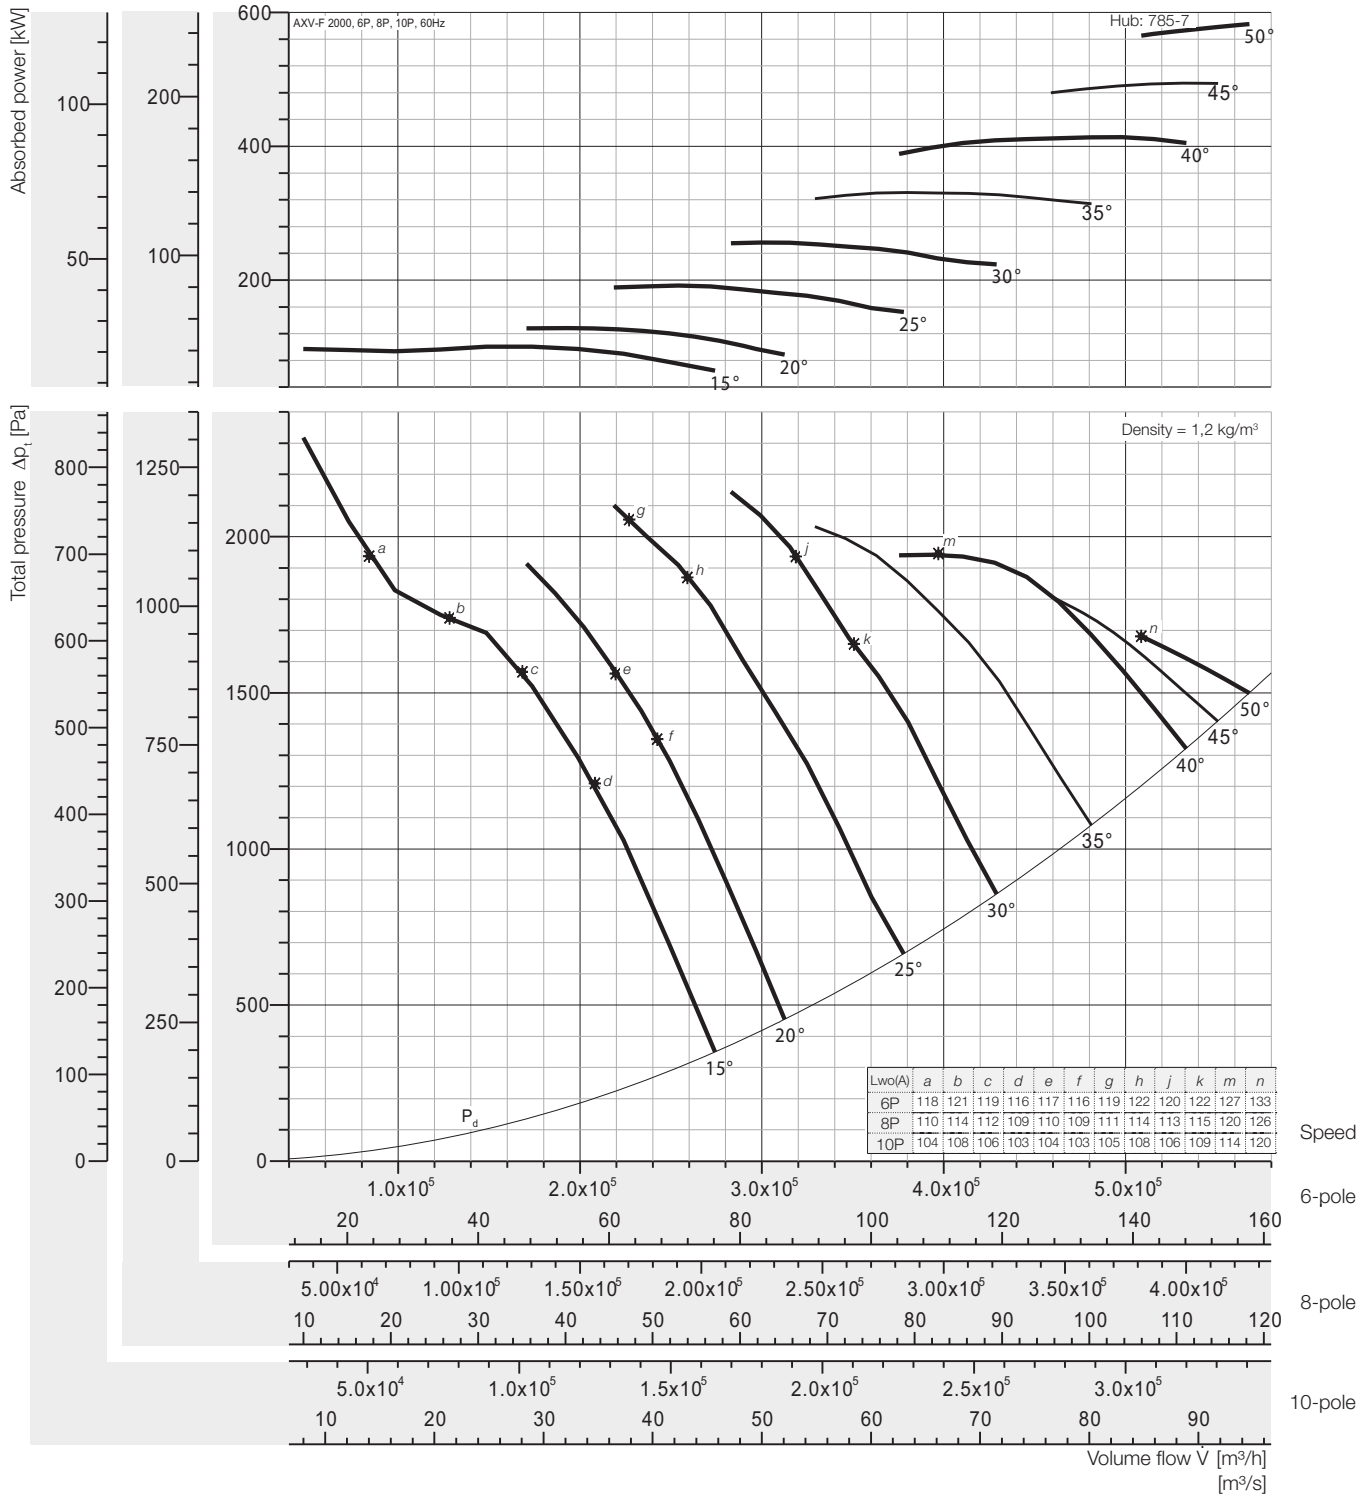

Peak absorbed power [kW]

6-pole = 1200 rpm; 8-pole = 900 rpm; 10-pole = 720 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
6P motor	100,4	128,1	191,7	256,1	330,9	413,6	494,1	582,7
8P motor	42,36	54,05	80,88	108,0	139,6	174,5	208,4	245,8
10P motor	21,69	27,67	41,41	55,31	71,47	89,35	106,7	125,9



Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet LwoA sound power levels for installation Type A: free inlet, free outlet.



# Performance Curve

## AXV-F 2200, 60 Hz

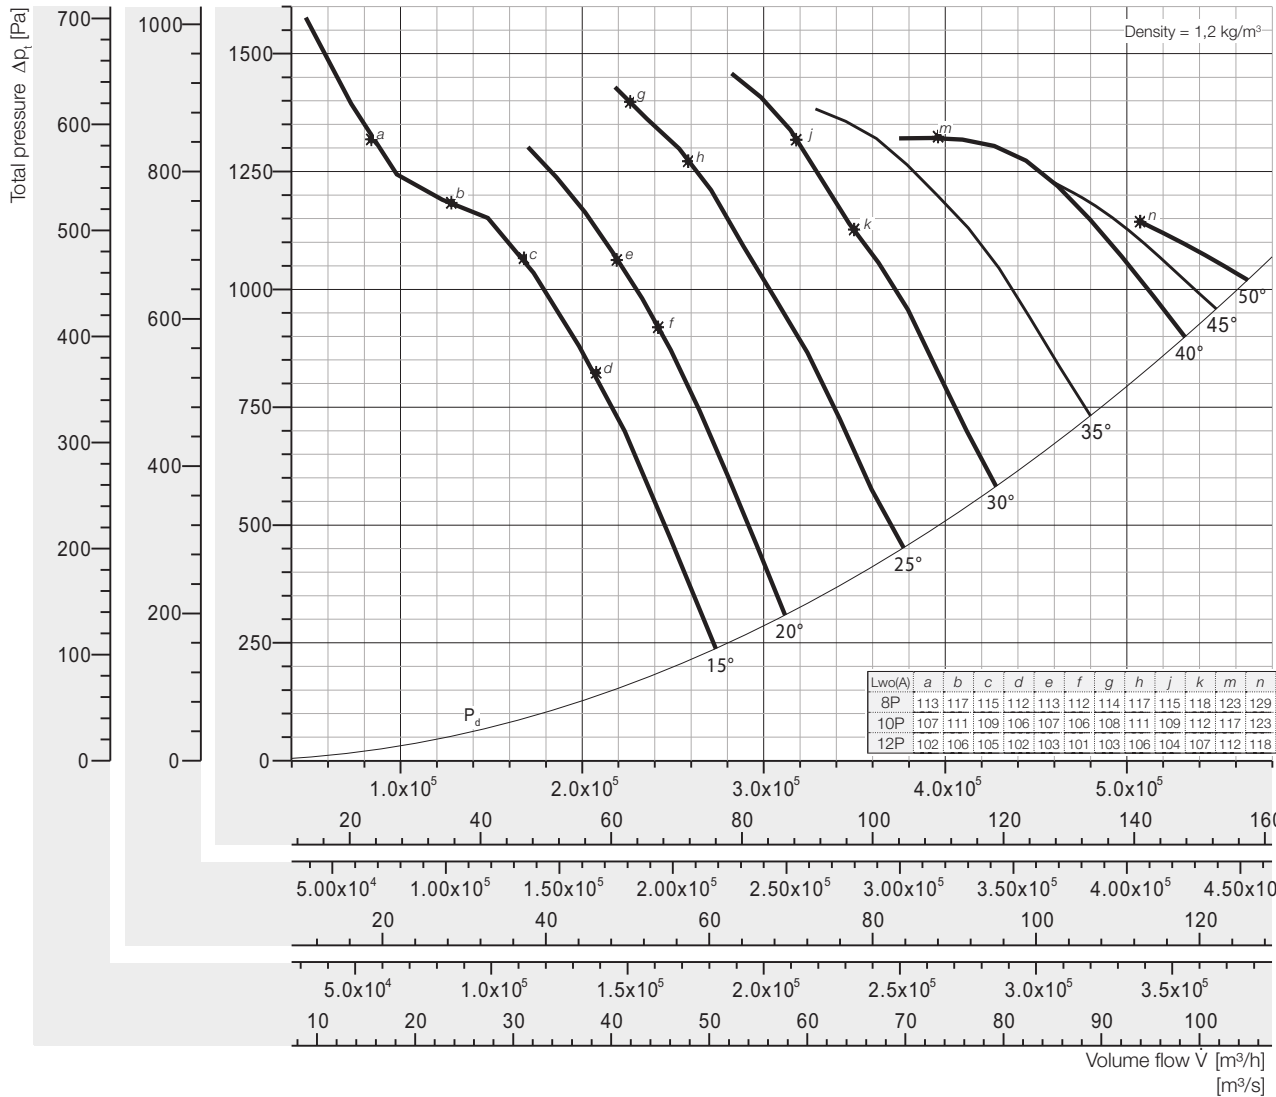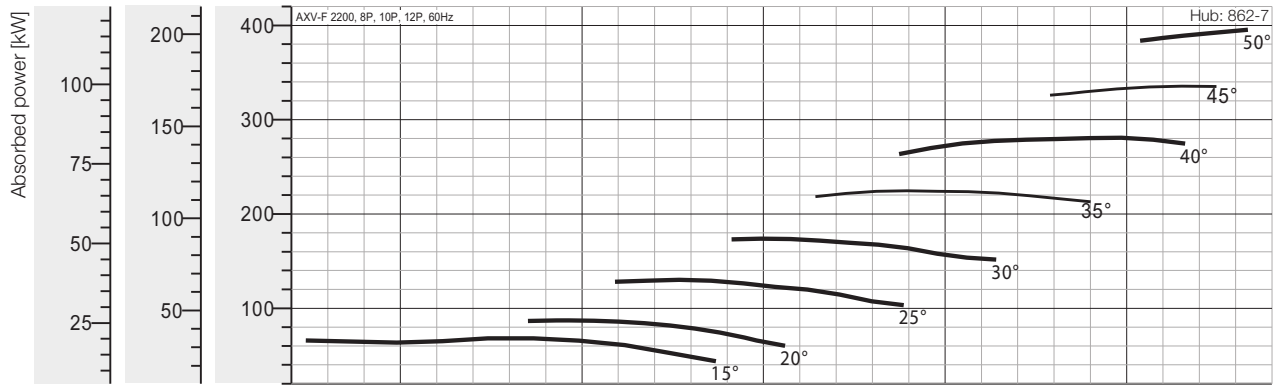


### Peak absorbed power [kW]

8-pole = 900 rpm; 10-pole = 720 rpm; 12-pole = 600 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
8P motor	68,45 75	86,95 90	130,1 132	173,8 200	224,6 250	280,7 315	335,3 355	395,4 400
10P motor	34,89 37	44,52 45	66,61 75	88,97 90	115,0 132	143,7 160	171,7 200	202,5 250
12P motor	20,19 22	25,76 30	38,55 45	51,49 55	66,54 75	83,18 90	99,36 110	117,2 132

Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet Lw0A sound power levels for installation Type A: free inlet, free outlet.

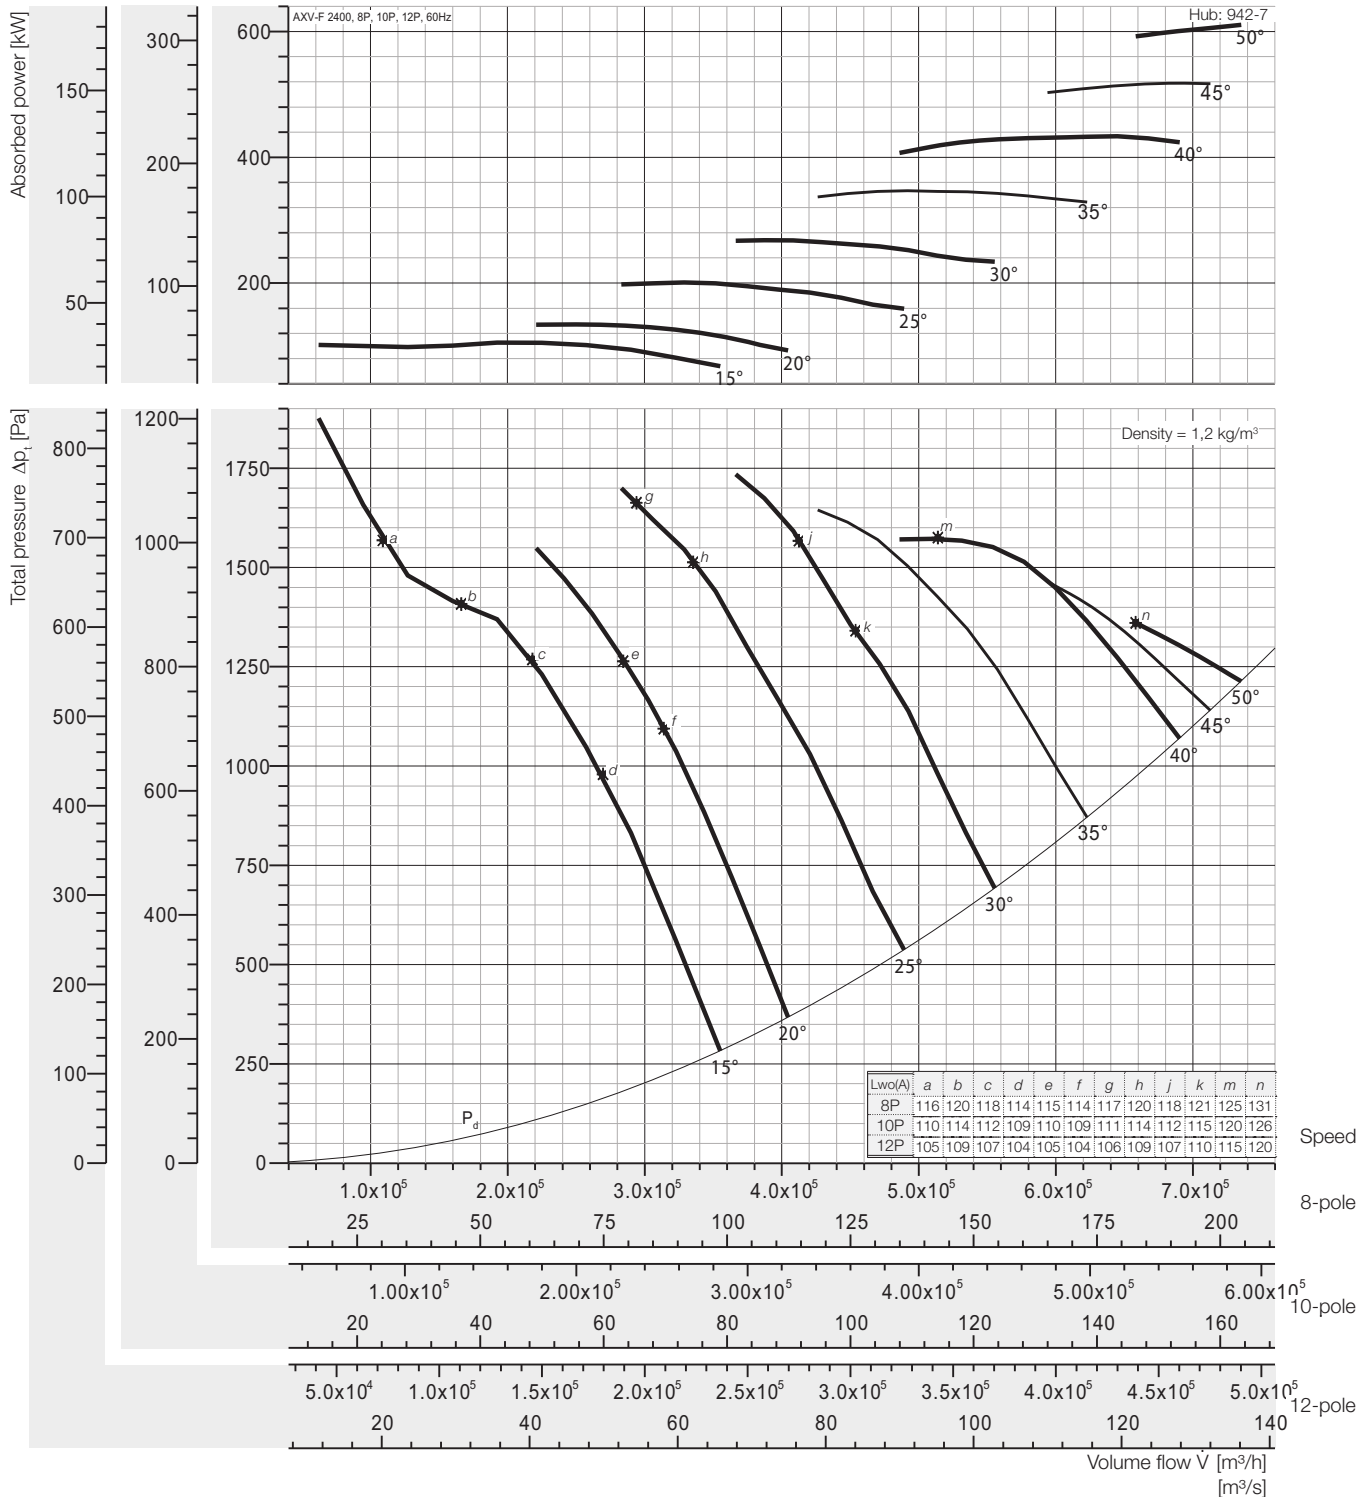

Peak absorbed power [kW]

8-pole = 900 rpm; 10-pole = 720 rpm; 12-pole = 600 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
8P motor	105,2	134,2	200,8	268,2	346,6	433,3	517,6	610,4
	110	160	250	315	355	450	560	630
10P motor	53,86	68,72	102,8	137,3	177,5	221,9	265,0	312,5
	55	75	110	160	200	250	315	
12P motor	31,17	39,77	59,50	79,48	102,7	128,4	153,4	180,9
	37	45	75	90	110	132	160	200



Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet LwoA sound power levels for installation Type A: free inlet, free outlet.



# Performance Curve

## AXV-F 2500, 60 Hz

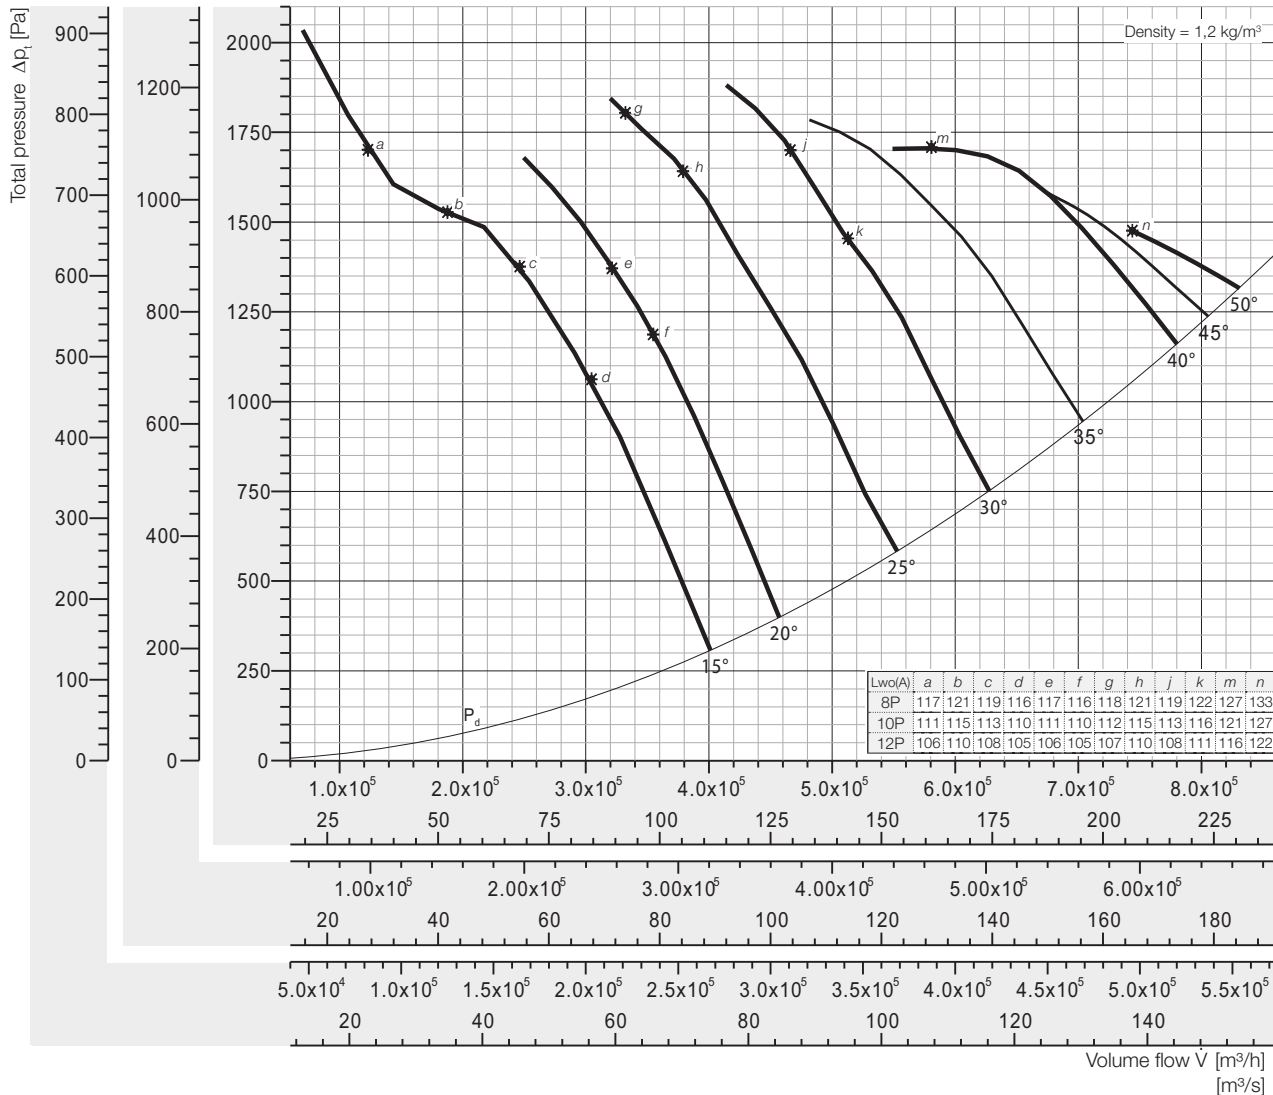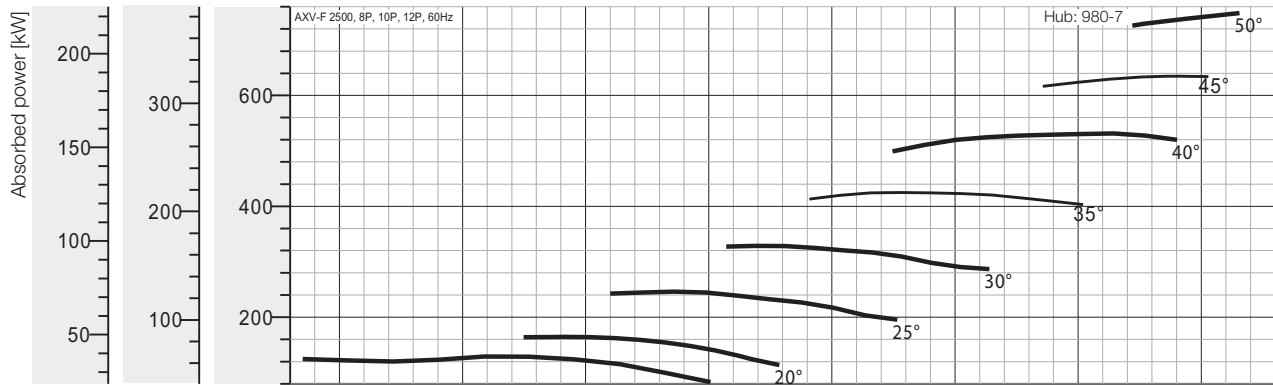

### Peak absorbed power [kW]

8-pole = 900 rpm; 10-pole = 720 rpm; 12-pole = 600 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
8P motor	128,9 132	164,5 200	246,2 250	328,8 355	425,0 450	531,2 560	634,6 710	748,3 -
10P motor	66,02 75	84,24 90	126,0 132	168,4 200	217,6 250	272,0 315	324,9 355	383,1 400
12P motor	38,21 45	48,75 55	72,95 75	97,43 110	125,9 132	157,4 160	188,0 200	221,7 250


Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet Lw0A sound power levels for installation Type A: free inlet, free outlet.



# Performance Curve

## AXV-F 2600, 60 Hz

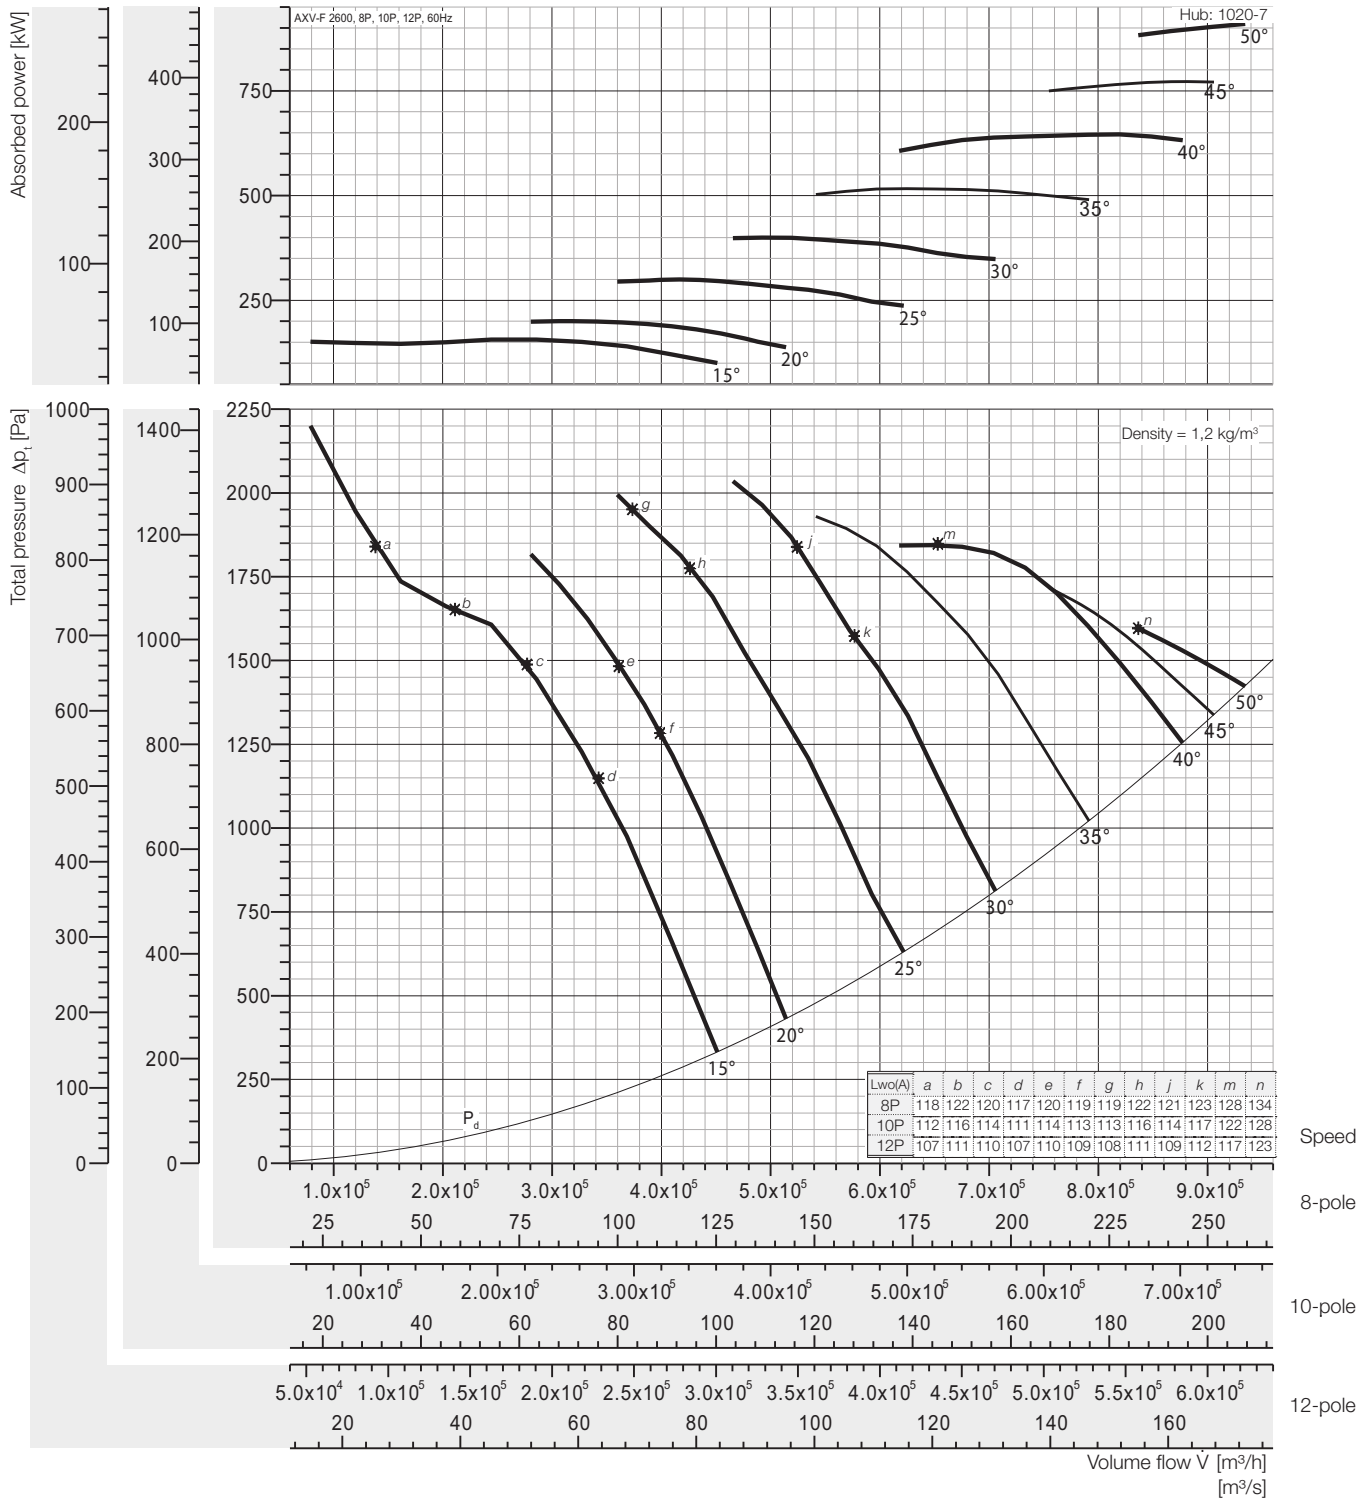

### Peak absorbed power [kW]

8-pole = 900 rpm; 10-pole = 720 rpm; 12-pole = 600 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
8P motor	156,8	200,1	299,4	399,9	516,8	646,1	771,8	910,1
	160	250	315	400	560	710	-	-
10P motor	80,30	102,4	153,3	204,8	264,6	330,8	395,1	466,0
	90	110	160	250	315	355	400	500
12P motor	46,47	59,29	88,72	118,5	153,1	191,4	228,7	269,6
	55	75	90	132	160	200	250	315


Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified is for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet Lwo(A) sound power levels for installation Type A: free inlet, free outlet.



# Performance Curve

## AXV-F 2800, 60 Hz

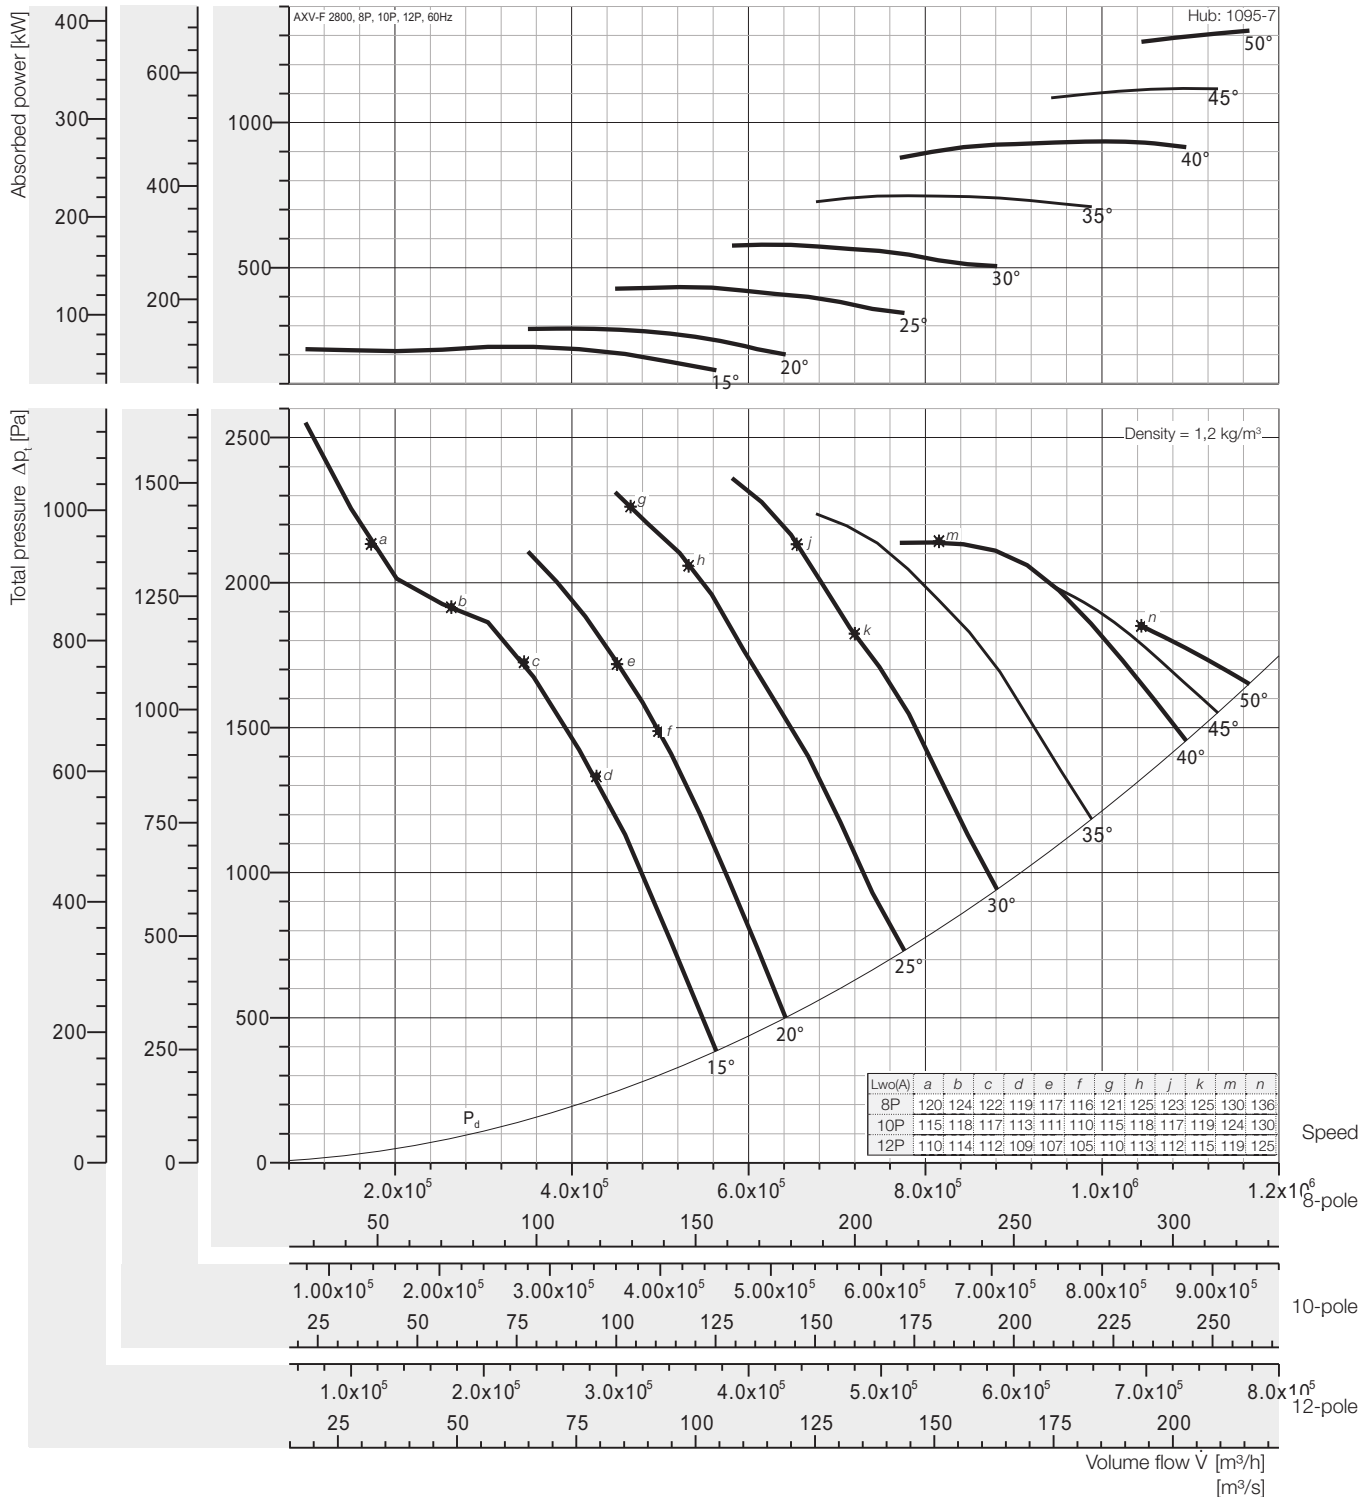

### Peak absorbed power [kW]

8-pole = 900 rpm; 10-pole = 720 rpm; 12-pole = 600 rpm;

N Poles	Pitch angle [°]							
	15	20	25	30	35	40	45	50
8P motor	227,0 250	289,6 315	433,4 450	578,9 630	748,1 -	935,2 -	1117 -	1317 -
10P motor	116,2 132	148,3 160	221,9 250	296,4 315	383,0 400	478,8 500	572,0 630	674,5 710
12P motor	67,26 75	85,82 90	128,4 132	171,5 200	221,7 250	277,1 315	331,0 355	390,3 400

Fan test laboratory AMCA 210/99 Fig.15, Test Chamber. Performance certified for installation type A - Free inlet, Free outlet. Performance ratings do not include the effects of appurtenances (accessories-belt cover, pulley & belt). Power rating (kW) does not include transmission losses.

The A-weighted sound ratings shown have been calculated per AMCA International Standard 301. Values shown are for outlet L<sub>w0</sub>A sound power levels for installation Type A: free inlet, free outlet.




# Axial Mixflow Fans


## Dimensions



### Direct Driven

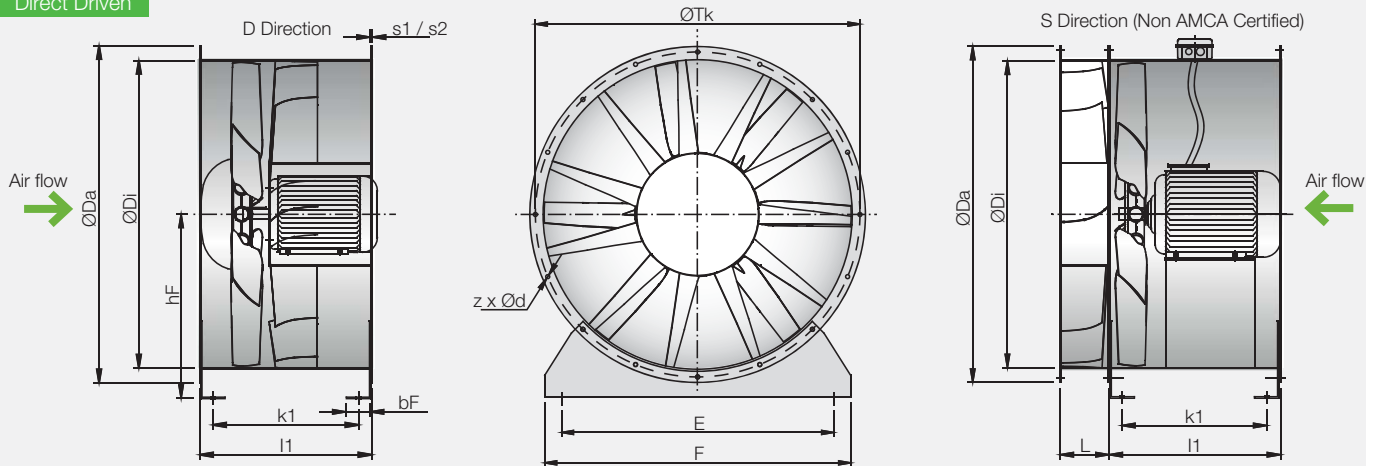

### Belt Driven

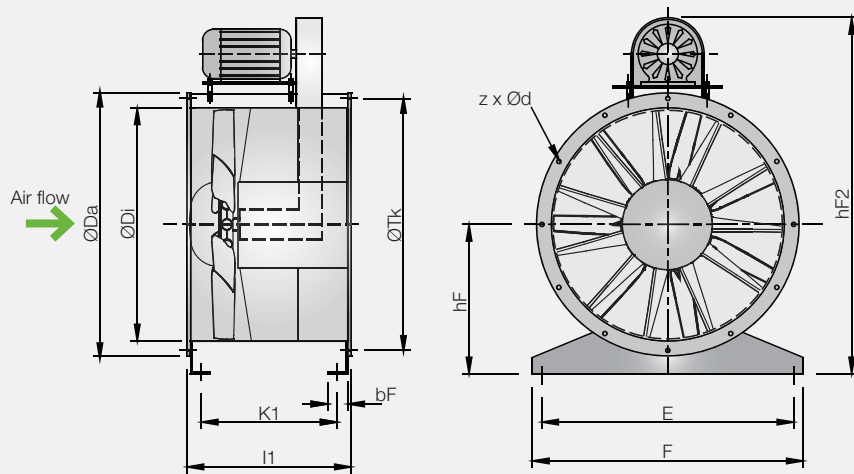

Model size	Da [mm]	Di [mm]	hF [mm]	hF2 [mm]	z x d [mm]	Tk [mm]	E [mm]	F [mm]	L [mm]	bF [mm]
500	584	504	315	910	12 x 12	551	440	500	140	70
560	664	565	345	998	16 x 14	629	500	560	150	70
630	734	634	400	1156	16 x 14	698	570	630	160	70
710	814	711	450	1300	16 x 14	775	650	710	180	70
800	904	797	500	1445	12* x 14	861	730	800	200	80
900	1004	894	580	1676	12* x 14	958	830	900	210	80
1000	1105	1003	630	1821	12* x 14	1067	930	990	280	80
1120	1245	1125	690	1990	16* x 18	1200	1050	1110	300	100
1250	1370	1250	750	2175	16* x 18	1337	1180	1240	330	100
1400	1525	1405	830	2362	16* x 18	1475	1330	1390	370	100
1600	1725	1605	930	2550	20* x 18	1675	1530	1590	420	100

LH/1 size	k1 [mm]	l1 [mm]	s1 [mm]	motor max.	s2 [mm]	motor max.	LH/2 size	k1 [mm]	l1 [mm]	s1 [mm]	motor max.	s2 [mm]	motor max.
500	326	400	2	132	2	112	560	624	700	3	160	-	-
560	326	400	2	132	2	112	630	624	700	3	160	-	-
630	326	400	2	160	2	132	710	490	565	2,5	180	-	-
710	326	400	2,5	160	2	132	800	614	700	3	180	-	-
800	326	400	2,5	160	2	132	900	612	700	4	180	3	160
900	444	530	3	225	2	200	1000	692	780	4	250	3	225
1000	444	530	3	225	2	200	1120	892	1000	4	250	3	225
1120	522	630	4	225	3	200	1250	892	1000	4	280	3	250
1250	522	630	4	250	3	225	1400	892	1000	4	315	3	280
							1600	892	1000	4	315	3	280


We reserve the right to alter measurements without notice in case of technical improvements.

# Axial Mixflow Fans

## Dimensions



Bifurcated

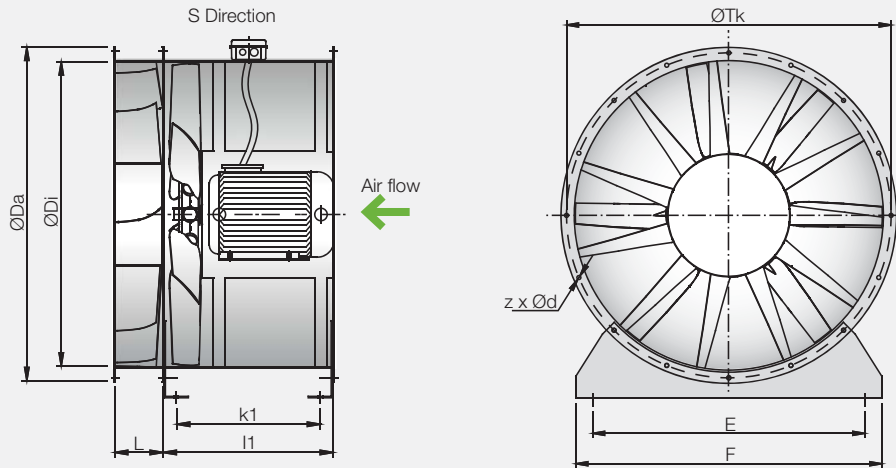

Model size	Da [mm]	Di [mm]	z x d [mm]	Tk [mm]	E [mm]	F [mm]	L [mm]
500	584	504	12 x 12	551	440	500	140
560	664	565	16 x 14	629	500	560	150
630	734	634	16 x 14	698	570	630	160
710	814	711	16 x 14	775	650	710	180
800	904	797	12* x 14	861	730	800	200
900	1004	894	12* x 14	958	830	900	210
1000	1105	1003	12* x 14	1067	930	990	280
1120	1245	1125	16* x 18	1200	1050	1110	300
1250	1370	1250	16* x 18	1337	1180	1240	330
1400	1525	1405	16* x 18	1475	1330	1390	370
1600	1725	1605	20* x 18	1675	1530	1590	420

LH/1 size	k1 [mm]	l1 [mm]	s1 [mm]	motor max.	s2 [mm]	motor max.
500	326	400	2	132	2	112
560	326	400	2	132	2	112
630	326	400	2	160	2	132
710	326	400	2,5	160	2	132
800	326	400	2,5	160	2	132
900	444	530	3	225	2	200
1000	444	530	3	225	2	200
1120	522	630	4	225	3	200
1250	522	630	4	250	3	225


LH/2 size	k1 [mm]	l1 [mm]	s1 [mm]	motor max.	s2 [mm]	motor max.
560	624	700	3	160	-	-
630	624	700	3	160	-	-
710	490	565	2,5	180	-	-
800	614	700	3	180	-	-
900	612	700	4	180	3	160
1000	692	780	4	250	3	225
1120	892	1000	4	250	3	225
1250	892	1000	4	280	3	250
1400	892	1000	4	315	3	280
1600	892	1000	4	315	3	280

The bifurcated axial mixflow fan are not licensed by AMCA International.

We reserve the right to alter measurements without notice in case of technical improvements.


# Axial Mixflow Fans

## Dimensions

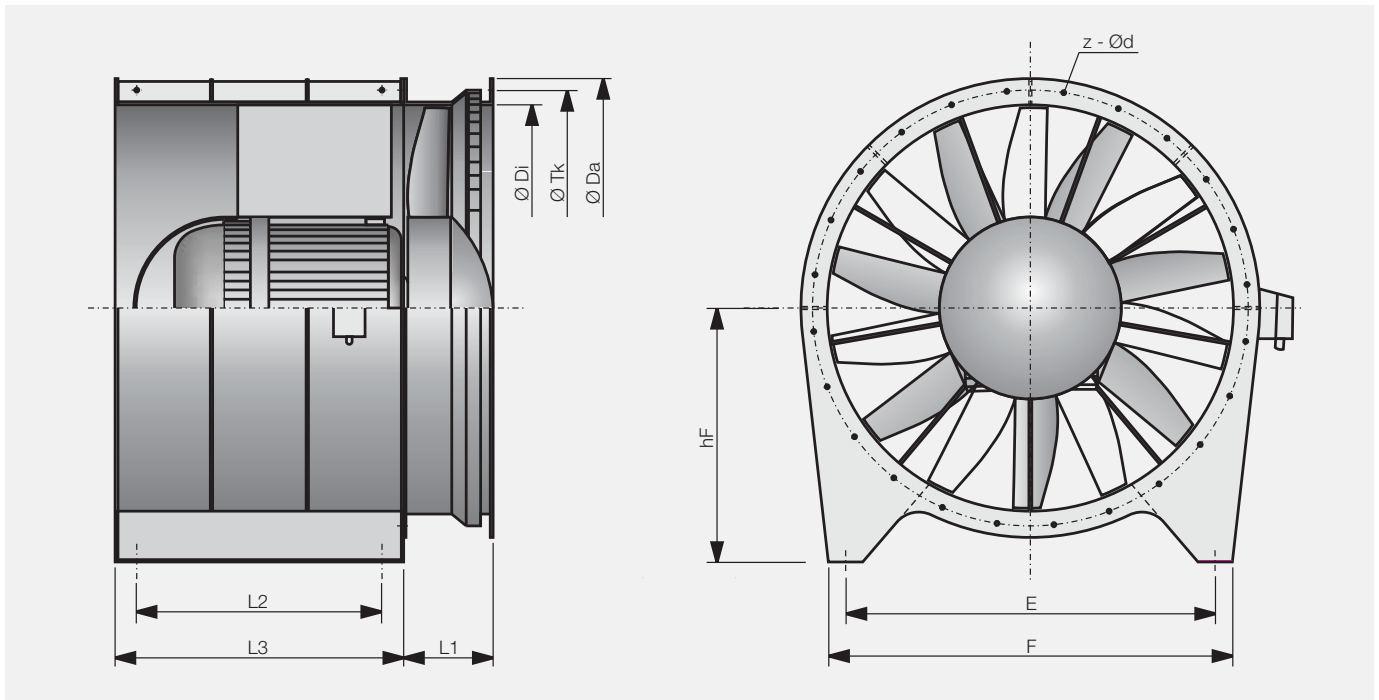


Model size	Da [mm]	Di [mm]	hF [mm]	z x d [mm]	Tk [mm]	E [mm]	F [mm]	L1 [mm]	L2 [mm]	L3 [mm]
1800	2010	1805	1120	24x18	1920	1660	1800	400	1200	1400
2000	2210	2005	1165	32x18	2120	1820	2000	445	1300	1500
2200	2440	2205	1265	32x18	2340	2020	2200	490	1400	1650
2400	2630	2405	1370	32x18	2530	2220	2400	550	1500	1800
2500	2740	2505	1420	36x24	2640	2320	2500	555	1530	1820
2600	2840	2605	1470	36x24	2740	2380	2600	590	1580	1850
2800	3150	2805	1570	36x24	3000	2500	2800	1300	1680	1900


**ED**  
Bellmouth inlet

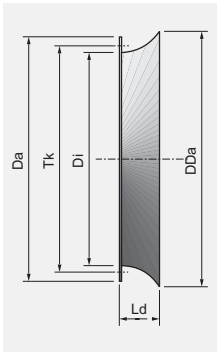


**GL-AXV**  
Matching flange

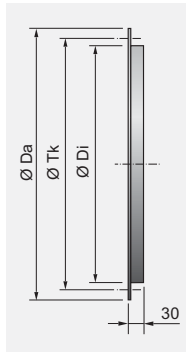

**EV-AXV**  
Flexible connector

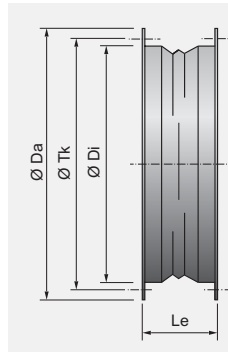

**LRK**  
Air-operated damper

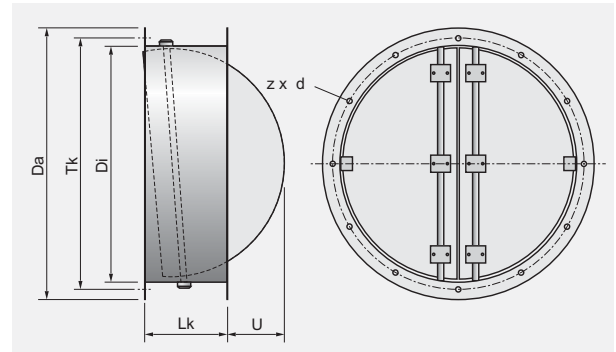

Model size	Da [mm]	Di [mm]	Tk [mm]	z x d [mm]	DDa [mm]	Ld [mm]	Lk [mm]	Le [mm]	U [mm]
500	584	504	551	12 x 12	617	165	250	130	45
560	664	565	629	16 x 14	667	165	250	130	80
630	734	634	698	16 x 14	757	165	250	130	120
710	814	711	775	16 x 14	816	170	350	130	60
800	904	797	861	12* x 14	915	250	350	130	110
900	1004	894	958	12* x 14	1015	250	350	130	170
1000	1105	1003	1067	12* x 14	1115	250	350	130	225
1120	1245	1125	1200	16* x 18	1243	250	350	130	255
1250	1370	1250	1337	16* x 18	1364	250	400	170	375
1400	1525	1405	1475	16* x 18	1523	250	400	170	450
1600	1725	1605	1675	20* x 18	1723	250	400	170	550

## Sound power levels


This term refers to the power which a source radiates as sound. Sound power levels are expressed in decibels with a reference level of 1 picowatt. The sound power level of a source remains the same regardless of its environment and the distance to the listener.

If the sound power frequency spectrum is needed, for as follows: example, the design of sound attenuators, the A-weighted rated sound power levels at particular octave band frequency  $L_{WA}$  can be calculated by subtracting the relative sound  $L_{wrel}$ .

$$L_{WA} = L_{wi} + L_{wrel}$$

## Sound pressure level

These are pressure fluctuations generated by a source expressed in decibels with a reference level of 20  $\mu$ Pa. The sound pressure level varies with the distance of a sound source to the listener and its environment.

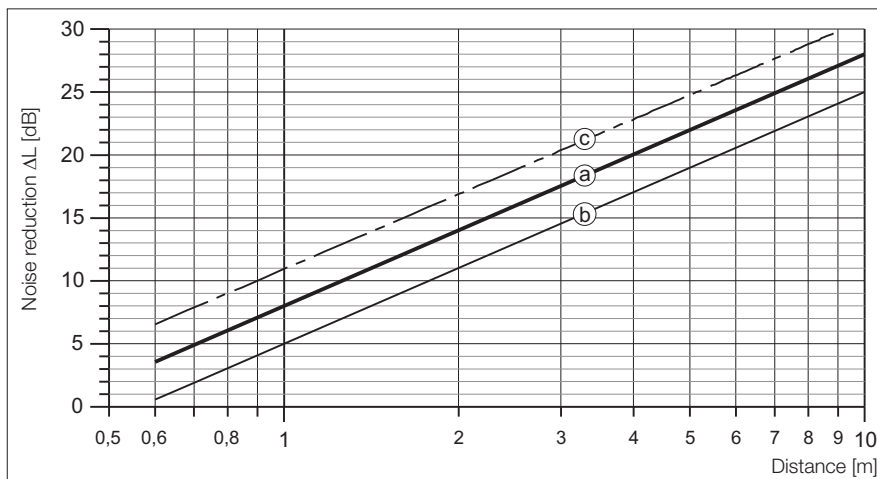

Sound level reduction half sphere

- a: without reflexion
- b: with reflexion
- c: full sphere without reflexion

## Frequencies

Sound is split into different frequencies. Frequencies of human hearing range from about 20 cycles per second (Hz) to 20,000 cycles per second (Hz). For practical purposes, WOLTER publishes noise data in eight octave bands with the centre frequencies of (63,) 125, 250, 500, 1000, 2000, 4000 and 8000 Hz.

Each fan has its own specific correction factor which is to be deducted from sound power according to the octave band.

## A-weighted sound pressure level in dB (A)

The human ear is more sensitive to sound in some frequencies than in others. The A-weighting is an attempt to reflect this natural perception of sound. The A-weighting is a set of figures which are applied to the sound pressure levels. The levels in each of the octave bands are added logarithmically to give a single figure. The A-weighting over the octave band is as follows:

Table 1)

Frequency [Hz]	63	125	250	500	1000	2000	4000	8000
A-weighting [dB]	-26,2	-16,1	-8,6	-3,2	0	+1,2	+1,0	-1,1

Table 2)

Addition of sound levels

Difference between two sound levels [dB]	Add to the higher level [dB]
0 - 1	3
2 - 3	2
4 - 9	1
$\geq 10$	0

$$L_{\Sigma} = 10 \cdot \lg(10^{0,1 \cdot L_1} + 10^{0,1 \cdot L_2} + \dots + 10^{0,1 \cdot L_n})$$

where:

$L_1$  = sound level of a source 1  
 $L_{\Sigma}$  = resulting summation sound level

## Summation of several congeneric sound levels

$$L_{\Sigma} = L_1 + 10 \cdot \lg(z)$$

where:

$z$  = number of sources  
 $L_1$  = sound level of a single source  
 $L_{\Sigma}$  = resulting summation sound level

**Relative Sound Power Frequency Spectrum ( $L_{wrel}$ ) [dB]**

Fan Model	Poles	63	125	250	500	1000	2000	4000	8000
Size	[-]	[Hz]	[Hz]	[Hz]	[Hz]	[Hz]	[Hz]	[Hz]	[Hz]
500	2	-11	-8	-10	-7	-8	-12	-16	-21
	4	-8	-10	-6	-8	-11	-16	-21	-26
	6	-8	-8	-5	-10	-13	-18	-23	-28
560	2	-11	-8	-10	-7	-8	-12	-16	-21
	4	-8	-10	-6	-8	-11	-16	-21	-26
	6	-8	-8	-5	-10	-13	-18	-23	-28
630	2	-11	-8	-10	-7	-8	-12	-16	-21
	4	-8	-10	-6	-8	-11	-16	-21	-26
	6	-8	-8	-5	-10	-13	-18	-23	-28
710	2	-11	-8	-10	-7	-8	-12	-16	-21
	4	-8	-10	-6	-8	-11	-16	-21	-26
	6	-8	-8	-5	-10	-13	-18	-23	-28
800	4	-8	-10	-6	-8	-11	-16	-21	-26
	6	-8	-8	-5	-10	-13	-18	-23	-28
	8	-9	-5	-6	-10	-15	-19	-24	-30
900	4	-7	-10	-6	-8	-11	-16	-21	-26
	6	-8	-8	-5	-10	-13	-18	-23	-28
	8	-9	-5	-6	-10	-15	-19	-24	-30
1000	4	-10	-5	-6	-8	-14	-18	-24	-29
	6	-7	-6	-5	-10	-15	-20	-26	-31
	8	-7	-5	-6	-11	-15	-21	-27	-32
1120	4	-10	-5	-6	-8	-14	-18	-24	-29
	6	-7	-6	-5	-11	-15	-20	-26	-31
	8	-6	-5	-6	-11	-16	-22	-27	-32
1250	4	-9	-5	-6	-8	-14	-18	-24	-30
	6	-6	-6	-6	-11	-15	-21	-26	-31
	8	-6	-5	-6	-12	-16	-22	-27	-32
1400	4	-9	-5	-4	-5	-7	-9	-12	-15
	6	-11	-6	-5	-6	-9	-13	-16	-20
	8	-11	-6	-6	-9	-13	-18	-22	-26
1600	4	-9	-5	-4	-5	-7	-9	-12	-15
	6	-11	-6	-6	-6	-9	-13	-16	-20
	8	-10	-6	-7	-9	-13	-18	-22	-26

• Sound power frequency spectrum calculated with this  $L_{wrel}$  are not licensed by AMCA International.

### Relative Sound Power Frequency Spectrum ( $L_{wrel}$ ) [dB]

Fan Model	Poles	63	125	250	500	1000	2000	4000	8000
Size	[-]	[Hz]	[Hz]	[Hz]	[Hz]	[Hz]	[Hz]	[Hz]	[Hz]
1800	6	-7	-4	-4	-6	-8	-11	-13	-17
	8	-9	-5	-5	-7	-10	-14	-18	-22
	10	-8	-6	-7	-10	-15	-19	-23	-27
2000	6	-7	-4	-4	-6	-8	-11	-13	-17
	8	-8	-5	-5	-7	-10	-14	-18	-22
	10	-8	-6	-7	-10	-15	-19	-23	-27
2200	8	-6	-3	-4	-6	-9	-11	-14	-18
	10	-7	-5	-5	-8	-12	-15	-19	-23
	12	-7	-6	-7	-11	-16	-20	-24	-28
2400	8	-5	-3	-4	-6	-9	-12	-15	-18
	10	-7	-5	-5	-8	-12	-15	-19	-23
	12	-6	-6	-8	-11	-16	-20	-24	-28
2500	8	-5	-3	-4	-6	-9	-12	-15	-18
	10	-7	-5	-5	-8	-12	-15	-19	-23
	12	-6	-6	-8	-11	-16	-20	-24	-28
2600	8	-5	-3	-4	-7	-9	-12	-15	-18
	10	-7	-5	-5	-8	-12	-15	-19	-23
	12	-6	-6	-8	-11	-16	-20	-24	-28
2800	8	-5	-3	-4	-7	-9	-12	-15	-18
	10	-7	-5	-6	-8	-12	-15	-19	-23
	12	-6	-6	-8	-11	-16	-20	-24	-28

• Sound power frequency spectrum calculated with this  $L_{wrel}$  are not licensed by AMCA International.





# Tubular Sound Attenuator for AXV-F

## SA, SPA



### SPA 1000 -1D

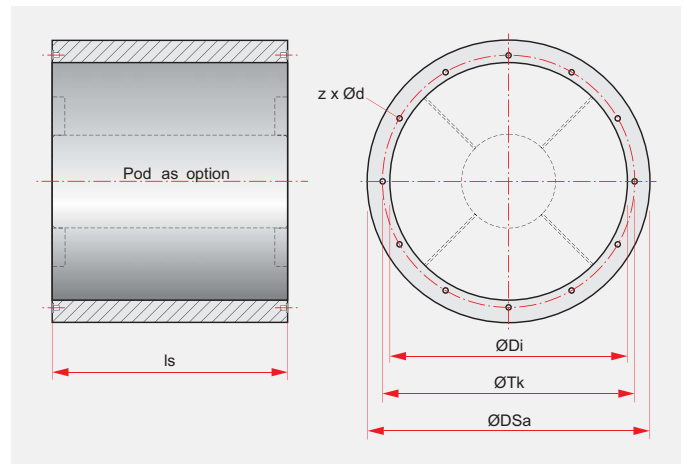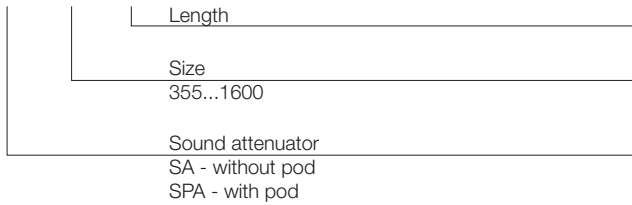

Attenuators made of galvanised sheet steel. Connecting flanges correspond to those of the axial fan series.


Size	DSa	Tk	Di	ls		Pitch angle				Length	Type	Pitch angle	Octave band mid-frequency [Hz]																			
				x 1D	x 2D	SA-1D	SPA-1D	SA-2D	SPA-2D				63	125	250	500	1k	2k	4k	8k												
	[mm]	[mm]	[mm]	[mm]	[mm]	[kg]	[kg]	[kg]	[kg]			setting																				
355 400 450	459 601 650	405 448 497	359 401 450	355 400 450	710 800 900	12 14 18	18 23 29	16 19 23	23	1D	SA-1D	all	2	4	6	10	14	10	7	8												
												low	4	6	8	13	20	21	18	16												
													4	6	8	12	18	19	18	14												
													4	6	8	11	13	16	16	11												
												500 560 630 710 800	704 765 834 911 997	551 629 698 775 861	504 565 634 711 797	500 560 630 710 800	1000 1120 1260 1420 1600	22 25 29 37 69	36 41 47 60 108	28 31 37 47 90	43	1D	SA-1D	all	3	4	8	14	14	9	8	7
																								low	4	6	9	17	26	21	18	12
4	6	9	17	23	20	18	11																									
4	6	9	16	17	16	14	11																									
900 1000 1120 1250	1094 1203 1325 1450	958 1067 1200 1337	894 1003 1125 1250	900 1000 1120 1250	1800 2000 2240 2500	86 125 132 146	135 190 210 234	112 156 169 185	176	1D	SA-1D													all	3	4	9	14	12	8	7	7
																								low	4	6	11	22	21	16	14	11
												4	6	11	20	19	15	13	11													
												4	6	11	17	17	14	12	11													
												1400 1600	1605 1805	1475 1675	1405 1605	1400 1600	2800 3200	197 275	316 540	250 348	397	1D	SA-1D	all	4	5	10	14	11	7	6	6
																								low	5	7	12	21	20	14	12	9
5	7	12	19	18	13	11	9																									
5	7	12	15	16	12	10	8																									
										2D	SA-2D													low	8	9	15	20	19	12	11	9
																								med.	8	9	14	20	17	11	10	9
												high	8	9	13	19	14	10	9	9												
												low	10	14	22	28	31	29	18	15												
													10	14	22	25	27	25	16	15												
													10	14	22	21	21	21	15	14												

• Low, Medium and High Pitch Angle setting correspond to 10°, 22° and 35° pitch angle approximately; for other pitch angles use interpolation.


• Sizes 1800 - 2800 TBA.



**Pressure Loss SPA - 1D**

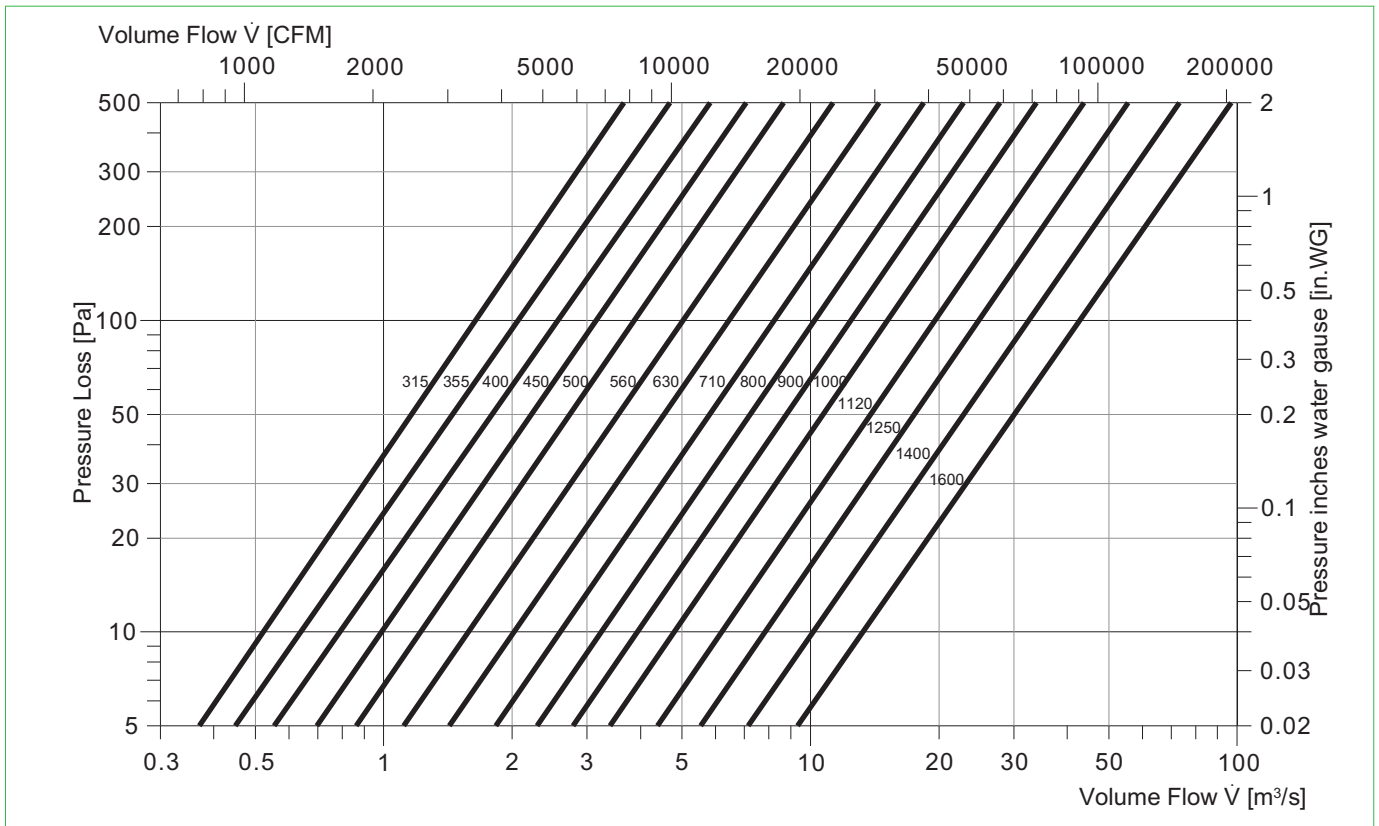

**Pressure Loss SPA - 2D**

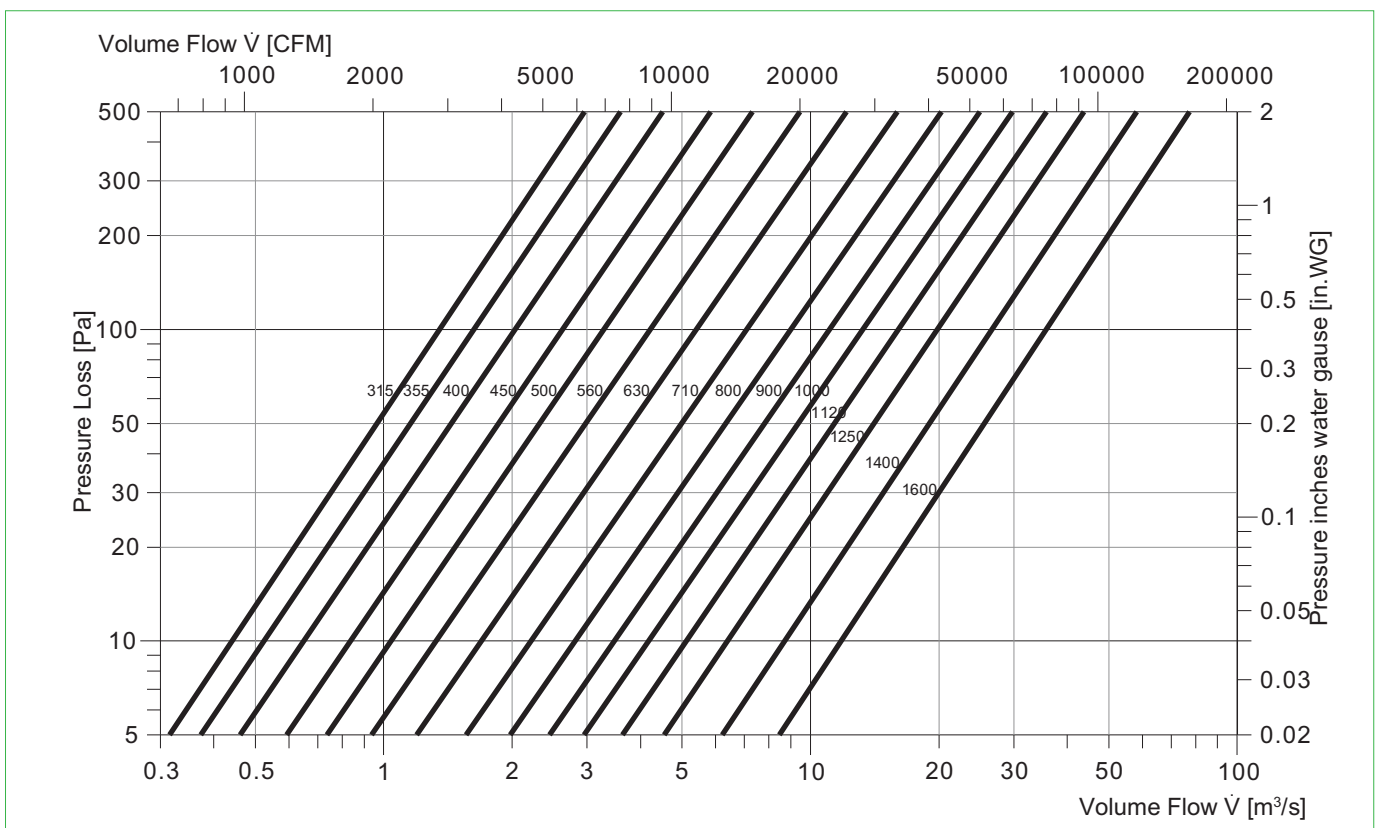

• Performance of sound attenuator are not licensed by AMCA International.

# Wolter Sales Network

## Inland

Ing. Günther Rößler  
D-07619 Schkölen  
Tel. (+49) 03 66 94 / 22 359  
Fax (+49) 03 66 94 / 22 357  
guenther.roessler@wolterfans.de

Mattias Industrievertretungen  
D-16259 Bad Freienwalde  
Tel. (+49)03344/301994  
Fax (+49)03344/301996  
thomas.mattias@wolterfans.de

Industrieservice Drexler  
D-49080 Osnabrück  
Tel. (+49) 0 541 / 20 04 88 3  
Fax (+49) 0 541 / 20 04 88 4  
wolfgang.drexler@wolterfans.de

Burkhardt Projekt GmbH  
D-67583 Guntersblum  
Tel. (+49) 0 62 49 / 82 01  
Fax (+49) 0 62 49 / 88 58  
info@bp-wolter.de

Friedrich Glock  
D-97980 Bad Mergentheim  
Tel. (+49) 0 79 31 / 37 44  
Fax (+49) 0 79 31 / 28 58  
friedrich.glock@wolterfans.de

## Europe

### Danmark:

Aircon Teknik A/S  
DK-8200 Aarhus N  
Tel. +45 (0) 86 / 34 51 11  
Fax +45 (0) 86 / 34 58 10  
post@airconteknik.dk

### The Netherlands:

AirFan B. V.  
NL-7442 CX Nijverdal  
Tel. (+31)054/8366366  
Fax (+31)054/8365320  
ventilatie@airfan.nl

### Poland:

Wentoprodukt  
44-100 Gliwice  
Tel. (+48)32 33 13 424  
Fax (+48)32 72 97 653 75  
biuro@wentoprodukt.pl

### Russia:

Daichi Co. Ltd  
RU-123022 Moscow  
Tel. +7 (0) 495 / 73 73 733  
Fax +7 (0) 495 / 73 73 732  
info@daichi.ru

### Switzerland:

Anson AG Zürich  
CH-8055 Zürich  
Tel. (+41) 0 44 / 46 11 111  
Fax (+41) 0 44 / 46 13 111  
info@anson.ch

Ventra Technik AG  
CH-8599 Salmsach  
Tel. (+41) 0 71 / 46 11 447  
Fax (+41) 0 71 / 46 11 448  
ventra@bluewin.ch

### Turkey:

Air Trade Centre Ltd Sti Türkiye,  
TR-34418 Seyrantepe / Istanbul  
Tel. (+90) 02 12 / 28 34 510  
Fax (+90) 02 12 / 27 83 964  
atc.turkey@airtradecentre.com

### United Kingdom:

Wolter (UK) Ltd.  
GB-Leicestershire LE65 1AL  
Tel. (+44) 01530 / 412 473  
info@wolteruk.com

## Middle East and North Africa

### Israel:

Pach Taas (Ashkelon) Ltd.  
IL-78100 Ashkelon  
Tel. (+972) 0 8 / 67 19 770  
Fax (+972) 0 8 / 67 19 771  
info@pachtaas.com

### UAE, Qatar, Lebanon, Jordan, Saudi Arabia:

Energy International Co.  
UAE-Sharjah, P.O. Box 3562  
Tel. (+971) 06 / 53 43 477  
Fax (+971) 06 / 53 43 756  
fsalibi@energysa.ae

Energy International Co.  
P.O. Box 45217 Abu Dhabi, UAE  
Tel. (+971) 2 67 11 10 8  
Fax (+971) 2 67 69 669  
amohsen@energyintl.ae

Energy International Co.(Dubai-Sharjah)  
P.O. Box 3562 Sharjah, UAE  
Tel. (+971) 65 34 34 77  
Fax (+971) 65 34 37 56  
fsalibi@energysa.ae

Energy International Corporation  
Malaz Area, Siteen Highway Beside BANK  
ALBILAD Riyadh, Saudi Arabia  
Tel. (+966) 14 15 39 59  
msheet@energyintl.com

Energy International Corporation  
P.O. Box 37364 Doha, Qatar  
Tel. (+974) 45 80 765  
Fax (+974) 45 81 126  
aassi@energyintl.com

Energy International  
234 Balbesi Blg 2nd floor Al-Madinah,  
Al Munawarah St Amman, Jordan  
Tel. (+962) 65 67 19 15  
Fax (+962) 65 67 19 16  
eabuzahra@energyintl.com

Energy International & Engineering  
Mar Roukoz Center-Block B - First Floor,  
Hazmieh, Lebanon  
Tel. (+961) 54 50 61 0  
Fax (+961) 54 51 16 9  
bsaab@energyintl.com

## Asia

### China Mainland:

Dongguan Wolter Chemco Ventilation Ltd.  
Chemco Building, Miao Bian Wang Ind.  
Shipai, Dongguan City, Guangdong  
Tel. (+86) 0 769 / 8655 7298  
Fax (+86) 0 769 / 8655 7278  
info@wolterfans.com

Taizhou Wolter Ventilation Co. Ltd.  
Hengjie, Luqiao District  
Taizhou City, Zhejiang  
Tel. (+86) 0 576 / 26 22 666 (26 52 888)  
Fax (+86) 0 576 / 26 56 830

### Hongkong:

Wolter Asia Ltd.  
Hong Kong  
Tel. (+852) 0 2456 0198  
Fax (+852) 0 2456 0290  
info@wolter.com.hk

### India:

Wolter Ventilators India Pvt. Ltd.  
867 D, Block-A, Sushant Lok, Phase-I,  
Gurgaon - 122009 (Haryana)  
Tel. +91 124 2577797, 4261001-3  
sales@wolterindia.in

### Indonesia:

PT. Agung Kipas Kastara.  
ID-14440 Jakarta Indonesia  
Tel. +62 (0) 21 / 6667 6925, 6667 6926  
Fax +62 (0) 21 / 6667 6927  
indowolter@cbn.net.id

### Korea:

Kaceco-Wolter  
14-1, Dang-dong, Gunpo-shi, Gyeonggi-do  
Tel. +82 (0) 31 / 4773 104  
Fax +82 (0) 31 / 4773 132  
wolter@kaceco.com / info@kaceco.com

### Malaysia:

Vibrantech (M) Sdn Bhd.  
47200 Petaling Jaya Selangor, Malaysia  
Tel. +603 (0) 7847 3500  
Fax +603 (0) 7847 3380  
sales@vibrantech-sb.com

### Singapore:

Wolter Pte. Ltd.  
SG-569738 Singapore  
Tel. (+65) 0 63 / 52 95 48  
Fax (+65) 0 63 / 52 95 47  
info@wolterfans.com.sg

### Sri Lanka:

Sirocco Air Technologies (Pvt) Ltd.  
28/12, Gemunu Mawatha, Kotuwegoda,  
Rajagiriya, Sri Lanka  
Tel. +94 11 7 392 010  
Fax +94 11 7 392 015  
suren@sairt.com

### Taiwan:

Waxlink International Co., Ltd.  
8F-2 No.218 Roosevelt Rd., Sec.6,  
Taipei, Taiwan  
Tel. (+886) 02 / 8932 1196  
Fax (+886) 02 / 8932 1197  
waxlink@mail.waxlinktw.com

### Thailand:

Wolter Ventilation Co., Ltd.  
Thamai Kratumban Samutsakorn 74110  
Thailand  
Tel. +66 (0) 3486 6555  
Fax +66 (0) 3486 6599  
natiphan@wolterfan.com

## Australia

The Sydney Fan Company.  
NSW 2147, Sydney, Australia  
Tel. +61 (0) 2 / 9624 4000  
Fax +61 (0) 2 / 9624 4100  
sales@thesydneyfancompany.com

## Wolter GmbH

### Maschinen-und Apparatebau KG

Am Wasen 11  
D-76316 Malsch / Germany  
Tel. +49 (0) 7204/9201-0  
Fax +49 (0) 7204/9201-11  
www.wolter.eu  
info@wolter.eu





Reference: **A09-F(MY)**, V2017/November, Printed in November, 2017

**Vibrantech (Malaysia) Sdn. Bhd.**

No.20, Jalan PJU 1A/12, Petaling Jaya Selangor Darul Ehsan, MALAYSIA 47200 Tel. (+603) 7847 3500  
Fax (+603) 7847 3380 • [www.wolterfans.com](http://www.wolterfans.com) • [sales@vibrantech-sb.com](mailto:sales@vibrantech-sb.com)